



**WEAVER CONSTRUCTION MANAGEMENT, INC.**  
 3679 S. Huron St., Suite 404  
 Englewood, CO 80110  
 Phone: (303) 789-4111 FAX: (303) 789-4310

## SUBMITTAL TRANSMITTAL

October 17, 2011

WGC Submittal No: 05500-001-A

**PROJECT:** Harold Thompson Regional WRF  
 Birdsall Rd.  
 Fountain, CO 80817  
 Job No. 2908

**ENGINEER:** **GMS, Inc.**  
 611 No. Weber St., #300  
 Colorado Springs, CO 80903  
 719-475-2935 Roger Sams

**OWNER:** **Lower Fountain Metropolitan  
 Sewage Disposal District**  
 901 S. Santa Fe Ave.  
 Fountain, CO 80817  
 719-382-5303 James Heckman

**CONTRACTOR:** **Rocky Mountain Railings**  
 11839 E. 51<sup>st</sup> Ave.  
 Denver, CO 80239  
 303-432-0003 Scot Hooper

**SUBJECT:** Resubmittal of Handrail includes the following:

- WCM Additional Submittal Review Comments Page
- Aluminum Railing Design Calculations
- Hilti HIT-RE 500 Epoxy Adhesive Anchoring System
- Load Testing of Aluminum Hand Rail by TABCO
- System layout and sectional drawings D-1, D-2, FPI, 1, 2, 3, 4.

**SPEC SECTION:** 05500 - Metal Fabrications

**PREVIOUS SUBMISSION DATES:** 7/28/11

**DEVIATIONS FROM SPEC:**  YES  NO

**CONTRACTOR'S STAMP:** This submittal has been reviewed by Weaver Construction Management and approved with respect to the means, methods, techniques, & safety precautions & programs incidental thereto. Weaver General Construction also warrants that this submittal complies with contracted documents and comprises on deviations thereto:

<p><b>Contractor's Stamp:</b></p> <p>Date: 10/17/11          Reviewed by: H.C. Myers  <input checked="" type="checkbox"/> Reviewed Without Comments  <input type="checkbox"/> Reviewed With Comments</p> <p><b>ENGINEER'S          COMMENTS:</b></p>	<p style="text-align: center;"><b>Engineer's Stamp:</b></p>          
--	---



**Project: HDTWRF Project**

**Location: Fountain, CO**

**Supplier: Rocky Mountain Railings**

**Date: 10/13/11**

**Additional Submittal Review Comments 05500-1.A**

- 1. The attached submittal document from Rocky Mountain Railings is a deviation from the specification which we are submitting as a substitute.**
- 2. Please note, a sample of the handrail connections has been "given" to GMS for review.**
- 3. Calculations provided are for a system installed in Texas.**
- 4. Aluminum post, rails and components are Aluminum 6105-T5. Specs identify Aluminum 6061-T5**
- 5. WCM to verify rail dimensions based on actual construction dimensions.**
- 6. Handrail for alternating tread stair by others.**
- 7. GMS – verify the use of detail 80KD-7A is acceptable at the top of the stairs on the west side of the chain opening.**

# **ATEC Associates, Inc.**



5150 East 65th Street  
Indianapolis, Indiana 46220-4871  
317-843-1990  
Telex 232 0055 ASAS

**Corporate Offices:**  
Indianapolis, IN

**Offices:**

Atlanta, GA  
Baltimore, MD  
Birmingham, AL  
Calumet City, IL  
Chicago, IL  
Cincinnati, OH  
Dallas, TX  
Dayton, OH  
Denver, CO  
Des Moines, IA  
Gary, IN  
Gaithersburg, MD  
Harrisburg, PA  
Huntsville, AL  
Lexington, KY  
Little Rock, AR  
Newport, NC  
Raleigh, NC  
Salisbury, MD  
Savannah, GA  
Washington, DC

**Affiliates:**  
Alexandria, VA  
Norfolk, VA

February 10, 1986

Tuttle Aluminum and Bronze Company  
120 Shadow Lawn Drive  
Noblesville, Indiana 46060

ATTN: Mr. Doug Waugh

RE: Load Testing of Aluminum Hand  
Rail Structure - TABCO 2500  
Tuttle Aluminum and Bronze Company  
Noblesville, Indiana  
ATEC Job No. 21-62016

Gentlemen:

Submitted herewith are results of load testing of an aluminum hand rail structure at the referenced site. This testing was performed on February 7, 1986 on the railing configuration noted below.

Three independent loads were applied to the rail structure. (See attached sketch of the rail structure) The loads were applied horizontally at a midspan, horizontally at a post and vertically at a midspan. The load was applied by a hydraulic jack attached to a fork lift. A calibrated proving ring was attached to the rail at loading locations for measurement of load. The loads were then applied by jacking the pump against the proving ring until the desired load was reached.

Deflection readings were made at maximum loading (200#) and then again after release of load to determine any permanent deflection. This was measured as deflection of the top rail horizontally (for horizontal loading) and the top rail vertically (for vertical loading).

The following is the construction description of the TABCO 2500 - Mechanical Connections railing system:

February 10, 1986  
Tuttle Aluminum & Bronze  
Page 2

TABCO 2500 CONSTRUCTION


---

Aluminum rail was constructed of 1-1/2" (Sch 40) aluminum pipe, top, intermediate, and post. All pipe to pipe connections were mechanically attached with fittings and rivets. The posts were welded to 3/8" X 2-1/2" x 6" aluminum base plates and mounted to a concrete floor with two (2) 3/8" x 2-3/4" stainless steel TRUBOLTS.

We appreciate the opportunity to be of service to you on this project. If you have any questions, please give me a call at this office.

Very truly yours;

ATEC ASSOCIATES, INC.

  
Thomas J. Struewing  
Project Engineer


TJS/cas

Load Test of Aluminum Railing  
Tuttle Aluminum and Bronze Company  
Noblesville, Indiana  
ATEC Job No. 21-62016

TABCO 2500 - Mechanical Connections  
Deflection                      Permanent Set \*

Horizontal load at Midspan = 200# (Fh)	1-9/16"	1/16"
Vertical Load at Midspan = 200# (Fv)	0.127"	0.00"
Horizontal Load at Post = 200# (P)	1-5/16"	0"

\* Deflection after release of load

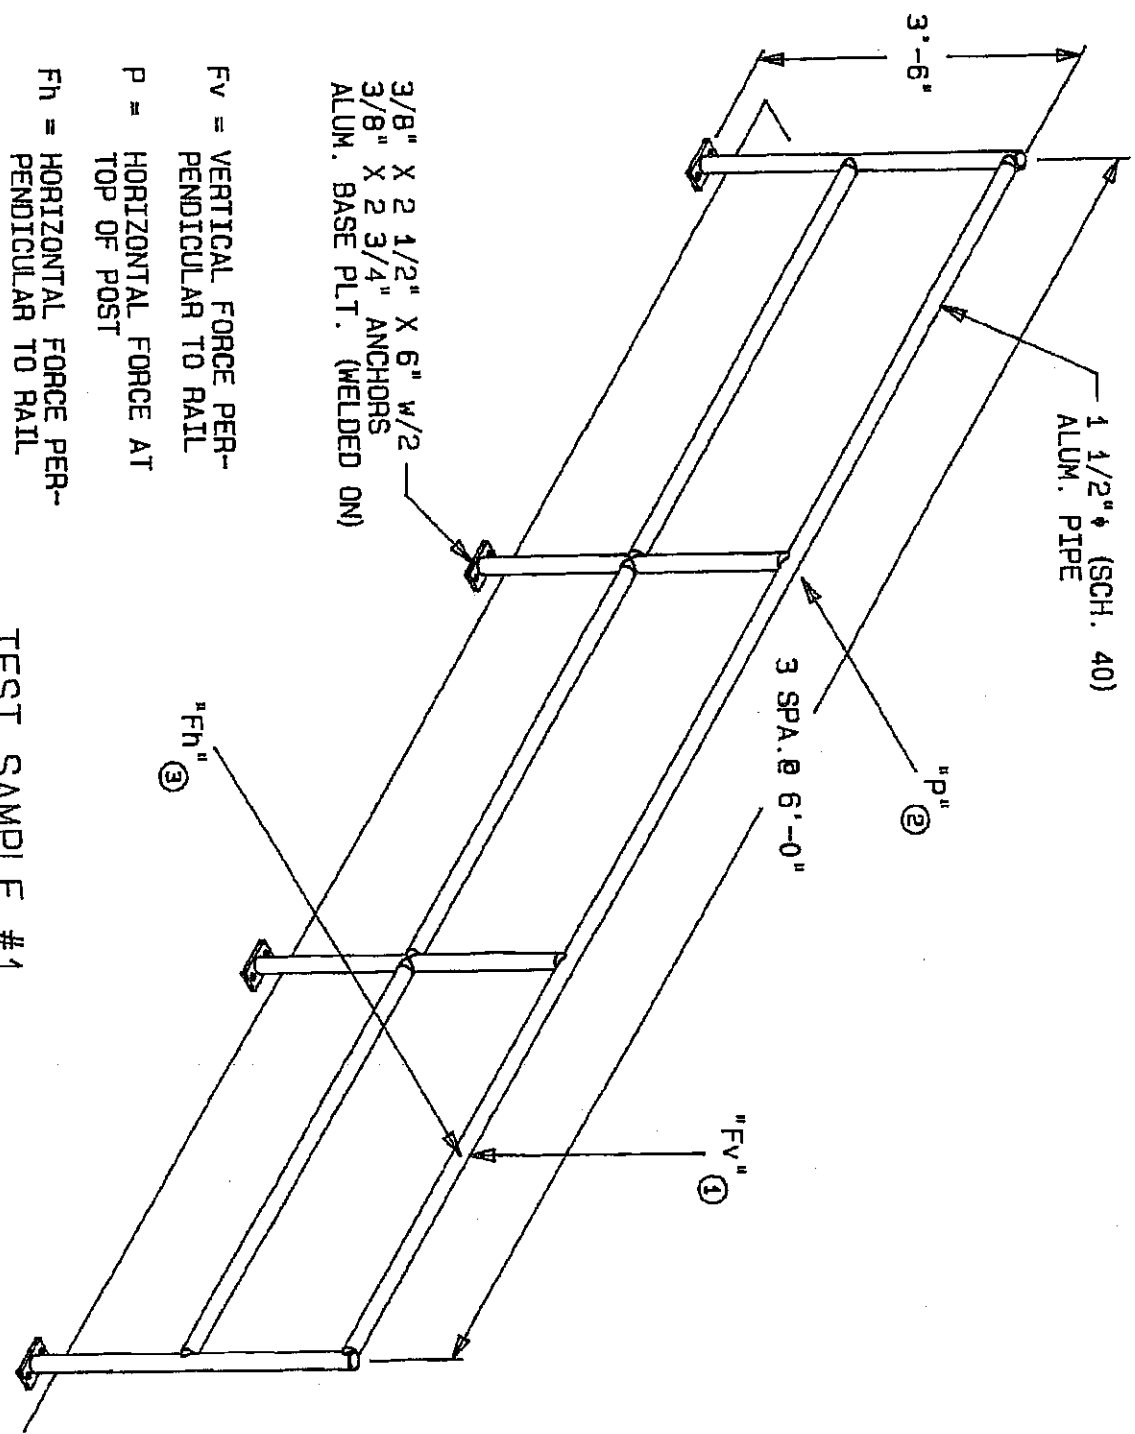

FV = VERTICAL FORCE PER-  
PENDICULAR TO RAIL

P = HORIZONTAL FORCE AT  
TOP OF POST

Fh = HORIZONTAL FORCE PER-  
PENDICULAR TO RAIL

TEST SAMPLE #1



**ROCKY MOUNTAIN RAILINGS**

---

**Re: Alloy Temper for Rocky Mountain Railings, Inc. Aluminum Pipe**

**Subject: Increased Yield Strength and Anodizing**

As of 01/01/2007, Rocky Mountain Railings, Inc. has changed the use of alloy 6063-T6, 1-1/2" Sch. 40 pipe to the use of Aluminum Alloy 6105-T5. The reasons for the change is as follows:

- 1). 6105-T5 has an ultimate minimum tensile strength of 38 KSI, and 6063-T6 has 22 KSI ( See Alcoa Conformance Chart) This alloy meets or exceeds OSHA and UBC loading requirements.
- 2). Alloy 6105-T5 is also equivalent to alloy 6061-T6 in terms of tensile and yield strength. Alloy 6061-T6 is also a commonly specified alloy due to its superior strength. However the anodizing finish of 6061-T6 does not match Rocky Mountain Railings, Inc. standard clear anodize of our fittings 6105-T5 is a near perfect match in finish, Therefore a more aesthetic appearance.

Although Rocky Mountain Railings, Inc. has endured cost impact for the use of alloy 6105-T5, We have not passed this cost to our customers. We feel that the increased strength of alloy and the appearance of the finish have helped in the submittal process and a feeling of satisfaction, knowing that we are supplying a quality product to our customer.

If you have any questions, Please call at (303)-432-0003



Alcoa Engineered Products

# ALLOY 6005/6105

## Understanding Extruded Aluminum Alloys

Among Alcoa Engineered Products' structural 6XXX series alloys, 6005 and 6105 are medium strength alloys that are very similar to alloy 6061 except they contain higher amounts of silicon. These alloys are used in designs that require moderate strength, but are generally not recommended for applications where the structure may be susceptible to impact or overloading.

When bending is required, the naturally aged -T1 temper is preferred. However, due to the excess silicon content, properties may increase more rapidly with room temperature aging than typically experienced with 6063 and 6061 alloys. In comparison to 6061, alloys 6005 and 6105 are easier to extrude and are less quench sensitive, allowing them to be used for more complex shapes. Alloys 6005 and 6105, when produced to a -T5 temper, have the same minimum tensile and yield strength as 6061-T6. In comparison to 6063, alloys 6005 and 6105 in -T5 tempers have better machinability and strength properties than 6063-T6.

Alloys 6005 and 6105 can also be welded or brazed using various commercial methods (caution: direct contact with dissimilar materials can cause galvanic corrosion). The heat from welding or brazing can reduce strength in the weld region. Consult the Material Safety Data Sheet (MSDS) for proper safety and handling precautions when using 6005 and 6105 alloys.

These alloys also offer good finishing characteristics and respond well to common anodizing methods such as clear, clear and color dye and hardcoat.

Typical applications for alloys 6005 and 6105 include:

- Automotive connector stock
- Structural members
- Hand rail tubing
- Seamless tubing
- Ladder structures

### 6005/6105 Temper Designations and Definitions

Standard Temper	Standard Temper Definition
F	As fabricated. There is no special control over thermal conditions and there are no mechanical property limits.
T1	Cooled from an elevated temperature shaping process and naturally aged. (See Note A.)
T5	Cooled from an elevated temperature shaping process & artificially aged. (See Note A.)
Alcoa Special Tempers	
(For 6005 Alloy only)	
T1S14	A maximum formability special temper for product that will be formed within 1 to 2 weeks after shipment. Samples are aged and tested in the -T5 condition to verify heat treat capability.
T5S3	An underaged temper to increase formability at a sacrifice of mechanical properties.
T5S11	Same mechanical property limits as -T5. Stretched 1-3% for stress relief.

\*For further details of definitions, see Aluminum Association's Aluminum Standards and Data manual and Temper for Aluminum and Aluminum Alloy Products.  
**Note A:** Applies to products that are not cold worked after cooling from an elevated temperature shaping process, or in which the effect of cold work in flattening or straightening may not be recognized in mechanical properties.  
 \*\*Alcoa Special Temper designations are unregistered tempers for reference only and provided for customer use to identify unique processing, material, or end use application characteristics.

Alloy 6005 Chemical Analysis		Liquidus Temperature: 1210°F								Solidus Temperature: 1125°F		Density: 0.097 lb./in. <sup>3</sup>
Percent Weight		Elements								Others Each	Others Total	Aluminum
		Si	Fe	Cu	Mn	Mg	Cr	Zn	Ti			
Minimum		.6	—	—	—	.40	—	—	—	—	—	Remainder
Maximum		.9	.35	.10	.10	.6	.10	.10	.10	.05	.15	Remainder

Alloy 6105 Chemical Analysis		Liquidus Temperature: 1200°F								Solidus Temperature: 1110°F		Density: 0.097 lb./in. <sup>3</sup>
Percent Weight		Elements								Others Each	Others Total	Aluminum
		Si	Fe	Cu	Mn	Mg	Cr	Zn	Ti			
Minimum		.6	—	—	—	.45	—	—	—	—	—	Remainder
Maximum		1.0	.35	.10	.15	.8	.10	.10	.10	.05	.15	Remainder

Alloy	Average Coefficient of Thermal Expansion (68° to 212°F)
6005	13.0 X 10 <sup>-6</sup> (inch per inch per °F)
6105	13.0 X 10 <sup>-6</sup> (inch per inch per °F)



## Alloy 6005/6105 Mechanical and Physical Property Limits

Temper	Specified Section or Wall Thickness (inches) <sup>2</sup>		Tensile Strength (ksi)				Elongation <sup>3</sup> Percent Min. in 2 inch or 4D <sup>4</sup>	Typical Thermal Conductivity at 77°F btu-in./ft <sup>2</sup> hr°F	Typical Electrical Conductivity <sup>5</sup> (% IACS)
			Ultimate		Yield (0.2% offset)				
	Min.	Max.	Min.	Max.	Min.	Max.			
<b>Alloy 6005 Standard Tempers</b>									
F	All		No Properties Apply					N/A	N/A
T1	—	.500	25.0	—	15.0	—	16	1250	47
T5	—	.124	38.0	—	35.0	—	8	1310	49
T5	.125	—	38.0	—	35.0	—	10	1310	49
<b>Alloy 6105 Standard Tempers</b>									
F	All		No Properties Apply					N/A	46
T1	—	.500	25.0	—	15.0	—	16	1220	—
T5	—	.500	38.0	—	35.0	—	8	1340	50
<b>Alloy 6005 Special Tempers</b>									
T1S14 <sup>6</sup>	—	.124	38.0	—	35.0	—	8	1250	47
T1S14 <sup>6</sup>	.125	—	38.0	—	35.0	—	10	1250	47
T5S3	All		35.0	—	30.0	—	8	N/A	N/A
T55117	—	.124	38.0	—	35.0	—	8	1310	49
T55117	.125	—	38.0	—	35.0	—	10	1310	49

⊕ The mechanical property limits for standard tempers are listed in the Property Limits section of the Aluminum Association's Aluminum Standards and Data manual and Temperatures for Aluminum and Aluminum Alloy Products. ⊕ The thickness of the cross section from which the tension test specimen is taken determines the applicable mechanical properties. ⊕ For materials of such dimensions that a standard test specimen cannot be taken, or for shapes thinner than .062", the test for elongation is not required. ⊕ D=Specimen diameter. ⊕ Minimum, unless stated as typical. ⊕ These properties apply to the material after proper artificial aging. No properties apply to shipped product. ⊕ For stress-relieved tempers, the characteristics and properties other than those specified may differ somewhat from the corresponding characteristics and properties of material in the basic temper.

\*Alcoa Special Temper designations are unregistered tempers for reference only and provided for customer use to identify unique processing, material, or end use application characteristics.

## Comparative Characteristics of Related Alloys/Tempers<sup>1</sup>

Alloy	Temper	Formability				Machinability				General Corrosion Resistance				Weldability (Arc with Inert Gas)				Brazeability				Anodizing Response			Typical Conductivity (%IACS)		
		D	C	B	A	D	C	B	A	D	C	B	A	D	C	B	A	D	C	B	A	D	C	B	A		
6005	-T1	N/A				N/A				N/A				████████				████████				████████			████████		
	-T5, T511	N/A				N/A				N/A				████████				████████				████████			████████		
6105	-T1	N/A				N/A				N/A				████████				████████				████████			████████		
	-T5	N/A				N/A				N/A				████████				████████				████████			████████		
6061	-T4	████████				████████				████████				████████				████████				████████			████████		
	-T6	████████				████████				████████				████████				████████				████████			████████		
6063	-T4	████████				████████				████████				████████				████████				████████			████████		
	-T6	████████				████████				████████				████████				████████				████████			████████		
6262	-T6	████████				████████				████████				████████				████████				████████			████████		

⊕ Rating: A=Excellent B=Good C=Fair D=Poor For further details of explanation of ratings for, see Aluminum Association's Aluminum Standards and Data manual.

## Alcoa Distribution and Industrial Products

53 Pottsville Street  
Cressona, PA 17929  
Phone: 800-233-3165  
FAX: 800-252-4646

eral information

general information | wrought products

VARIOUS TEMPERATURES<sup>⊙</sup>  
Table 3 (continued)

TYPICAL TENSILE PROPERTIES AT VARIOUS TEMPERATURES<sup>⊙</sup>  
Table 3 (continued)

Elongation in 2 in., percent	Alloy and Temper	Temp., °F	Tensile Strength, ksi		Elongation in 2 in., percent
			Ultimate	Yield <sup>⊙</sup>	
46	5456-O	-320	62	26	32
35		-112	46	23	25
32		-18	45	23	22
30		75	45	23	20
26		212	42	22	31
20		300	31	20	30
18		400	22	17	60
15		500	17	11	80
11		600	11	7.5	110
10		700	6	4.2	130
46	6053-T6, -T651	75	37	32	13
35		212	32	28	13
32		300	25	24	13
30		400	13	12	25
26		500	3.5	4	70
20		600	4	2.7	80
15		700	2.9	2	90
39	6061-T6, -T651	-320	60	47	22
30		-112	49	42	18
27		-18	47	41	17
25		75	45	40	17
21		212	42	38	18
18		300	34	31	20
15	400	19	15	28	
11	500	7.5	5	60	
10	600	4.6	2.7	85	
10	700	3	1.8	95	
32	6063-T1	-320	34	16	44
23		-112	26	15	36
20		-18	24	14	34
18		75	22	13	33
20		212	22	14	18
17		300	21	13	20
15		400	9	6.5	40
11		500	4.5	3.5	75
10		600	3.2	2.5	80
10		700	2.3	2	105
36	6063-T5	-320	37	24	28
21		-112	29	22	24
18		-18	28	22	23
18		75	27	21	22
18		212	24	20	18
15		300	20	18	20
11		400	9	6.5	40
10		500	4.5	3.5	75
10	600	3.2	2.5	80	
10	700	2.3	2	105	

31,000 YIELD  
x .06 = 20,000 DS

40,000\* YIELD  
x .06 = 24,000 DS

Alloy and Temper	Temp., °F	Tensile Strength, ksi		Elongation in 2 in., percent	Alloy and Temper	Temp., °F	Tensile Strength, ksi		Elongation in 2 in., percent
		Ultimate	Yield <sup>⊙</sup>				Ultimate	Yield <sup>⊙</sup>	
6063-T6	-320	47	36	24	7075-T6, -T651	-320	102	92	9
	-112	38	33	20		-112	90	79	11
	-18	36	32	18		-18	86	75	11
	75	35	31	18		75	83	73	11
	212	31	28	15		212	70	65	14
	300	21	20	20		300	31	27	30
	400	9	6.5	40		400	16	13	55
	500	4.5	1.5	75		500	11	9	65
	600	3.3	2.5	80		600	8	6.5	70
	700	2.3	2	105		700	6	4.6	70
6151-T6	-320	57	50	20	7075-T73, -T7331	-320	92	72	14
	-112	50	46	17		-112	79	67	14
	-18	49	45	17		-18	76	65	13
	75	48	43	17		75	73	63	13
	212	43	40	17		212	63	58	15
	300	28	27	20		300	31	27	30
	400	14	12	30		400	16	13	55
6262-T651	500	6.5	5	50	500	11	9	65	
	600	5	3.9	43	600	8	6.5	70	
	700	4	3.2	35	700	6	4.6	70	
	-320	60	47	22	7079-T6, -T651	-320	82	80	12
	-112	49	42	18		-112	82	70	14
	-18	47	41	17		-18	79	68	14
	75	45	40	17		75	78	68	14
212	42	38	18	212		67	60	18	
300	34	31	20	300		33	28	37	
6262-T9	400	16	13	30	400	16	13	60	
	500	8.5	6	48	500	11	8.5	100	
	600	4.6	2.7	85	600	7.5	6	175	
	700	3	1.8	95	700	5.5	4.3	175	


⊙ Lowest strengths during 10,000 hours of exposure at testing temperature under no load; stress applied at 5,000 psi/min to yield strength and then at strain rate of 0.05 in./in./min to failure.

Under some conditions of temperature and time, the application of heat will adversely affect certain other properties of some alloys. For specific information concerning the suitability of the various alloys for use at elevated temperatures, the nearest sales office of Aluminum Company of America should be consulted.

⊙ Effect equals 0.2 percent.

⊙ Preferred alloy designation is 6101.

21,000\* YIELD x .06 = 13,000 DS

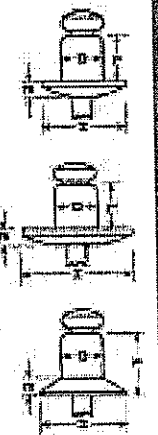

## Stainless Rivet • Stainless Mandrel • IFI Grade 51

Part No.	D Rivet Dia. Nom. Inch (mm)	Drill No. & Hole Size (mm)	H Head Dia. Nom. Inch (mm)	E Head Height Max. Inch (mm)	L Rivet Length Max. (mm)	Grip Range Inch (mm)	Typical Ultimate Strength (Lbs.) (newtons)			
							Shear	Tensile		
SSB4-18	1/8" (125)	#30 (129-139)	250	040	212	5.4	622-692	0.6-1.6	520	600
SSB4-25	3/2	3/32 (25-33)	6.35	1.02	275	7.0	669-125	1.7-3.2	2310	2650
SSB4-35					337	8.9	126-187	3.3-4.8		
SSB4-45					400	10.2	189-250	4.9-6.4		
SSB4-55					462	11.7	251-312	6.5-7.0		
SSB4-65					525	13.4	313-375	8.0-9.5		
SSB4-85					650	16.5	376-500	9.0-12.7		
SSB5-25	5/32" (156)	#20 (160-164)	312	045	300	7.6	622-125	1.6-3.2	785	1040
SSB5-35	4.0	4/16 (25-4.16)	7.92	1.14	338	8.0	126-187	3.2-4.8	3490	4620
SSB5-45					425	10.2	189-250	4.9-6.4		
SSB5-65					550	14.0	251-375	6.5-9.5		
SSB5-85					675	17.2	376-500	9.0-12.7		
SSB5-105					800	20.3	501-625	12.8-16.8		
SSB6-25	3/16" (187)	#11 (192-196)	375	066	325	8.3	622-125	1.6-3.2	1150	1300
SSB6-45	4.9	4/16 (25-4.9)	9.53	1.40	450	11.5	126-250	3.3-4.8	5110	5780
SSB6-65					575	14.6	251-375	6.5-9.5		
SSB6-85					700	17.8	376-500	9.0-12.7		
SSB6-105					825	21.0	501-625	12.8-16.8		
SSB6-125					950	24.2	626-750	16.0-19.1		
SSB6-165					1200	30.5	751-1000	19.1-25.4		
SSB8-45	1/4" (250)	F (257-261)	500	074	500	13.7	622-250	1.6-6.4	1700	2100
SSB8-65	6.4	6/16 (25-6.4)	12.70	1.89	625	15.9	251-375	6.5-9.5	7330	9340
SSB8-85					750	19.1	376-500	9.0-12.7		
SSB8-105					875	21.0	501-625	12.8-16.8		
SSB8-125					1000	25.4	626-750	16.0-19.1		

### Large Flange


SSB14-25	1/8" (125)	#30 (129-139)	375	045	275	7.0	622-125	0.6-3.2	520	600
SSB14-35	3.2	3/32 (25-3.2)	9.53	1.14	337	8.9	126-187	3.3-4.8	2310	2650
SSB14-45					400	10.2	189-250	4.9-6.4		
SSB16-45	3/18" (187)	#11 (192-196)	615	082	450	11.5	622-250	1.6-6.4	1150	1300
SSB16-65	4.8	4/16 (25-4.9)	15.03	1.08	575	14.6	251-375	6.5-9.5	5110	5780
SSB16-85					700	17.8	376-500	9.0-12.7		
SSB16-105					825	21.0	501-625	12.8-16.8		
SSB16-125					950	24.2	626-750	16.0-19.1		

### 120° Countersunk

SSC4-25	1/8" (125)	#30 (129-139)	220	045	275	7.0	622-125	1.6-3.2	520	600
SSC4-35	3.2	3/32 (25-3.2)	5.99	1.14	337	8.9	126-187	3.3-4.8	2310	2650
SSC4-45					400	10.2	189-250	4.9-6.4		
SSC4-55					462	11.7	251-312	6.5-7.0		
SSC4-65					525	13.4	313-375	8.0-9.5		
SSC4-85					650	16.5	376-500	9.0-12.7		

RIK-FAST RIVETS conform to IFI-114 (inch) and IFI-505 (metric). Millimeters (mm) and newtons (N) are in green.

# Meet our Stainless lineup

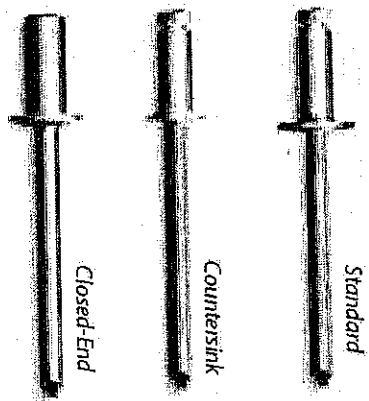

# Tnemecol

## COVERAGES RATES

	Dry Mil (Microns)	Wet Mil (Microns)	Sq Ft/Gal (m <sup>2</sup> /Gal)
Suggested	10.0 (255)	15.5 (395)	103 (9.5)
Minimum	8.0 (205)	12.5 (320)	128 (11.9)
Maximum	12.0 (305)	19.0 (480)	86 (7.9)

Allow for overspray and surface irregularities. Film thickness is rounded to the nearest 0.5 mil or 5 microns. Application of coating below minimum or above maximum recommended dry film thicknesses may adversely affect coating performance.

**MIXING** Stir thoroughly, making sure no pigment remains on the bottom of the can.

**THINNING** Use No. 2 Thinner. For air or airless spray, brush or roller, thin up to 5% or ¼ pint (190 mL) per gallon if necessary. Drum heaters or inline heaters may be necessary to maintain application viscosity during cool weather.

**SURFACE TEMPERATURE** Minimum 40°F (4°C) Maximum 135°F (57°C)  
The surface should be dry and at least 5°F (3°C) above the dew point.

## APPLICATION EQUIPMENT

### Air Spray

Gun	Fluid Tip	Air Cap	Air Hose ID	Mat'l Hose ID	Atomizing Pressure	Pot Pressure
DeVilbiss MBC or JGA	E	704	3/8" or 1/2" (9.5 or 12.7 mm)	1/2" or 3/4" (12.7 or 19 mm)	50 psi (3.4 bar)	20 psi (1.4 bar)

Low temperatures or longer hoses require higher pot pressure.

### Airless Spray

Tip Orifice	Atomizing Pressure	Mat'l Hose ID	Manifold Filter
0.017"-0.031" (430-785 microns)	2400-3000 psi (165-207 bar)	3/8" or 1/2" (9.5 or 12.7 mm)	60 mesh (250 microns)

Use appropriate tip/atomizing pressure for equipment, applicator technique and weather conditions.

**Roller:** Use high quality synthetic nap covers. Short nap for smooth surfaces. Long nap for rough surfaces. **Note:** Two or more coats may be required to obtain recommended film thicknesses.

**Brush:** Use high quality nylon or synthetic bristle brushes. **Note:** Two or more coats may be required to obtain recommended film thicknesses.

**CLEANUP** Flush and clean all equipment immediately after use with the recommended thinner or xylol.

**WARRANTY & LIMITATION OF SELLER'S LIABILITY:** Tnemec Company, Inc. warrants only that its coatings represented herein meet the formulation standards of Tnemec Company, Inc. THE WARRANTY DESCRIBED IN THE ABOVE PARAGRAPH SHALL BE IN LIEU OF ANY OTHER WARRANTY, EXPRESSED OR IMPLIED, INCLUDING BUT NOT LIMITED TO, ANY IMPLIED WARRANTY OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE. THERE ARE NO WARRANTIES THAT EXTEND BEYOND THE DESCRIPTION ON THE FACE HEREOF. The buyer's sole and exclusive remedy against Tnemec Company, Inc. shall be for replacement of the product in the event a defective condition of the product should be found to exist and the exclusive remedy shall not have failed its essential purpose as long as Tnemec is willing to provide comparable replacement product to the buyer. NO OTHER REMEDY (INCLUDING, BUT NOT LIMITED TO, INCIDENTAL OR CONSEQUENTIAL DAMAGES FOR LOST PROFITS, LOST SALES, INJURY TO PERSON OR PROPERTY, ENVIRONMENTAL INJURIES OR ANY OTHER INCIDENTAL OR CONSEQUENTIAL LOSS) SHALL BE AVAILABLE TO THE BUYER. Technical and application information herein is provided for the purpose of establishing a general profile of the coating and proper coating application procedures. Test performance results were obtained in a controlled environment and Tnemec Company makes no claim that these tests or any other tests, accurately represent all environments. As application, environmental and design factors can vary significantly, due care should be exercised in the selection and use of the coating. FOR INDUSTRIAL USE ONLY.

DATA SHEET

TUTTLE ALUMINUM  
120 SHADOWLAWN DRIVE

FISHERS IN 46038

COAL TAR CTG. H.B. TNEMEC

FOR COATINGS, RESINS, AND RELATED MATERIALS  
(APPROVED BY THE U.S. DEPARTMENT OF LABOR AS  
'ESSENTIALLY SIMILAR' TO FORM OSHA-20)  
(MEETS REQUIREMENTS OF CFR 29 PART 1910.1200,  
OSHA'S HAZARD COMMUNICATION STANDARD)

NPCA 1-84

SECTION 1 - MANUFACTURER AND PRODUCT INFORMATION

CHEMICAL PRODUCT IDENTIFICATION:

PRODUCT ID : F046-0465 5G  
PRODUCT CLASS : COAL TAR  
TRADE NAME : COAL TAR CTG. H.B. TNEMEC  
FORMULA VERSION NUMBER : 5  
MSDS PREPARATION DATE : 01/18/2001

MANUFACTURER IDENTIFICATION:

NAME : TNEMEC COMPANY, INC.  
ADDRESS : 123 WEST 23RD AVENUE  
NORTH KANSAS CITY, MO. 64116-3064  
TELEPHONE : 816-474-3400  
EMERGENCY TELEPHONE : 816-474-1425

SECTION 2 - HAZARDOUS INGREDIENTS

1 MAGNESIUM SILICATE  
CAS# 14807-96-6  
TALC (NO ASBESTOS FIBERS/RESPIRABLE DUST)  
PCT BY WT: 11-20  
EXPOSURE LIMIT:  
ACGIG TVL/TWA: 0002.00 MG/M3  
OSHA PEL/TWA: 0002.00 MG/M3

2  
CAS# 7727-43-7  
BARIUM SULFATE (TOTAL DUST)  
PCT BY WT: 21-30  
EXPOSURE LIMIT:  
ACGIG TVL/TWA: 0010.00 MG/M3  
OSHA PEL/TWA: 0010.00 MG/M3

3  
CAS# 65996-93-2  
REFINED COAL TAR PITCH (CONTAINS PPAH'S)  
PCT BY WT: 34.4860  
EXPOSURE LIMIT:  
ACGIG TVL/TWA: 0000.20 MG/M3  
OSHA PEL/TWA: 0000.20 MG/M3

4 METHYLBENZENE  
CAS# 108-88-3  
TOLUENE  
PCT BY WT: 5.6690 VAPOR PRESSURE: 22.000 MMHG @ 68F  
EXPOSURE LIMIT:  
ACGIG TVL/TWA: 0050.00 PPM  
OSHA PEL/TWA: 0100.00 PPM  
OSHA STEL: 0150.00 PPM

5  
CAS# 100-41-4  
ETHYL BENZENE  
PCT BY WT: 2.6770 VAPOR PRESSURE: 6.000 MMHG @ 68F  
EXPOSURE LIMIT:  
ACGIG TVL/TWA: 0100.00 PPM  
ACGIH TLV/STEL: 0125.00 PPM  
OSHA PEL/TWA: 0100.00 PPM  
OSHA STEL: 0125.00 PPM

6 XYLENE  
CAS# 1330-20-7  
DIMETHYLBENZENE  
PCT BY WT: 11.0730 VAPOR PRESSURE: 5.100 MMHG @ 68F  
EXPOSURE LIMIT:  
ACGIG TVL/TWA: 0100.00 PPM  
ACGIH TLV/STEL: 0150.00 PPM  
OSHA PEL/TWA: 0100.00 PPM  
OSHA STEL: 0150.00 PPM

\*\*\*\*\*  
This product contains one or more reported carcinogens or suspected  
carcinogens which are noted NTP, IARC, or OSHA-Z in the other limits  
\*\*\*\*\*

TNEMEC COMPANY, INC.  
MATERIAL SAFETY DATA SHEET

F046-0465 5G

COAL TAR CTG. H.B. TNEMEC

SECTION 4 - FIRST AID MEASURES

EYE CONTACT:

Flush immediately with large amounts of clean water under low pressure for at least 15 minutes. Consult a physician.

SKIN CONTACT:

Wash affected area with soap and water. Remove contaminated clothing. Dispose of or launder accordingly. Consult a physician if skin irritation persists.

INHALATION:

Remove affected individual to fresh air. Treat symptomatically. If breathing is difficult, administer oxygen. If breathing has stopped give artificial respiration. Consult a physician.

INGESTION:

Drink 1 or 2 glasses of water to dilute. Do not induce vomiting. Consult a physician or poison control center IMMEDIATELY. Treat symptomatically.

NOTE TO PHYSICIAN:

SECTION 5 - FIRE AND EXPLOSION HAZARD DATA

FIRE AND EXPLOSIVE PROPERTIES OF THE CHEMICAL:

Flammability Classification . . . . .	:		
Flashpoint . . . . .	:	80.0	
Explosion Level . . . . .	:	Low	- 1.0
		High	- -N/A
Flammability Limits . . . . .	:	Lower	- -N/A
		Higher	- -N/A

EXTINGUISHING MEDIA:

Foam, carbon dioxide, and dry chemical.

FIRE-FIGHTING PROCEDURES AND EQUIPMENTS:

Keep away from heat, open flames, sparks, and areas where static charge may be generated. Do not apply to hot surfaces due to possible fire and explosion risk. For closed containers, pressure build-up and possible explosion might occur due to extreme heat exposure. Solvent vapors are heavier than air and may travel considerable distance to a source of ignition and flash back. Water may be used to cool unruptured containers. Wear self-contained breathing apparatus with a full facepiece operated in pressure-demand or other positive pressure mode to prevent inhalation of hazardous decomposition products. Use appropriate extinguishing media to control fire. Water may cause violent frothing if sprayed directly into containers of burning liquid.

SECTION 6 - SPILL OR LEAK PROCEDURES

CLEAN-UP:

Remove all sources of ignition. Spills may be collected with inert, absorbent material for proper disposal. Use non-sparking tools, protective gloves, goggles and clothing, adequate ventilation, avoid the breathing of vapors and use respiratory protective devices. Transfer absorbent material to suitable containers for proper disposal.

SECTION 7 - SPECIAL PRECAUTIONS

HANDLING AND STORAGE:

Store in dry area. Keep closures tight and upright to prevent leakage. Do not store in high temperature areas or near fire or open flame. Refer to product data sheet for recommended storage temperatures.

SPECIAL COMMENTS:

Prevent prolonged breathing of airborne contaminants such as vapor, spray mists, or dusts. Prevent contact with skin and eyes. Do not take internally. Keep out of reach of children. Do not reuse or alter containers without proper industrial cleaning. Do not weld or flame cut empty, uncleaned containers due to potential fire and explosion hazard. Consult product data sheet for proper application instructions.

TNEMEC COMPANY, INC.  
MATERIAL SAFETY DATA SHEET

F046-0465 5G

COAL TAR CTG. H.B. TNEMEC

SECTION 12 - ECOLOGICAL INFORMATION

ECOTOXICOLOGICAL INFORMATION:

SECTION 13 - DISPOSAL CONSIDERATIONS

WASTE DISPOSAL:

Dispose of in accordance with Federal, state, and local regulations regarding pollution.

SECTION 14 - TRANSPORT INFORMATION

DOT HAZARD CLASS . . . . . :

TRANSPORTATION ASSISTANCE:

Contact Tnemec's Traffic department @ (816) 474-3400.

SECTION 15 - REGULATORY INFORMATION

FEDERAL REGULATIONS:

This product contains the following toxic chemicals subject to the reporting requirements of Section 313 of the Emergency Planning and Community Right-To-Know Act of 1986 and of 40 CFR 372:

TOLUENE

CAS# 108-88-3 PCT BY WT: 5.6690

ETHYL BENZENE

CAS# 100-41-4 PCT BY WT: 2.6770

DIMETHYLBENZENE

CAS# 1330-20-7 PCT BY WT: 11.0730

STATE REGULATIONS:

SECTION 16 - OTHER INFORMATION

Prepared by . . . . . : Kevin Settles

Date of issue . . . . . : 01/18/2001

Last Revision Date . . . . . : 02/23/1997

MSDS Prepared for . . . . . : TUTTLE ALUMINUM  
120 SHADLOWLAWN DRIVE

FISHERS IN 46038

MSDS Last Prepared . . . . . : 04/27/2000

HMIS Information: Health- 3\* Flammability- 3  
Reactivity- 1

For specific information regarding occupational safety and health standards, please refer to the Code of Federal Regulations, Title 29, Part 1910.  
To the best of our knowledge, the information contained herein is accurate. However, neither the Tnemec Company or any of its subsidiaries assume any liability whatsoever for the accuracy of completeness of the information contained herein. Final determination of suitability of any material is the sole responsibility of the user. All materials may present unknown health hazards and should be used with caution. Although certain hazards are described herein, we cannot guarantee that these are the only hazards which exist.



FOR COATINGS, RESINS, AND RELATED MATERIALS  
(APPROVED BY THE U.S. DEPARTMENT OF LABOR AS  
'ESSENTIALLY SIMILAR' TO FORM OSHA-20)  
(MEETS REQUIREMENTS OF CFR 29 PART 1910.1200,  
OSHA'S HAZARD COMMUNICATION STANDARD)

NPCA 1-84

-----  
SECTION 1 - MANUFACTURER AND PRODUCT INFORMATION  
-----

CHEMICAL PRODUCT IDENTIFICATION:

PRODUCT ID : F041-0002 5G  
PRODUCT CLASS : THINNER  
TRADE NAME : THINNER CLEAR  
FORMULA VERSION NUMBER : 2  
MSDS PREPARATION DATE : 01/18/2001

MANUFACTURER IDENTIFICATION:

NAME : TNEMEC COMPANY, INC.  
ADDRESS : 123 WEST 23RD AVENUE  
NORTH KANSAS CITY, MO. 64116-3064  
TELEPHONE : 816-474-3400  
EMERGENCY TELEPHONE : 816-474-1425  
-----

SECTION 2 - HAZARDOUS INGREDIENTS  
-----

1  
CAS# 100-41-4  
ETHYL BENZENE  
PCT BY WT: 19.9980 VAPOR PRESSURE: 6.000 MMHG @ 68F  
EXPOSURE LIMIT:  
ACGIH TVL/TWA: 0100.00 PPM  
ACGIH TLV/STEL: 0125.00 PPM  
OSHA PEL/TWA: 0100.00 PPM  
OSHA STEL: 0125.00 PPM  
-----

2 XYLENE  
CAS# 1330-20-7  
DIMETHYLBENZENE  
PCT BY WT: 80.0020 VAPOR PRESSURE: 5.100 MMHG @ 68F  
EXPOSURE LIMIT:  
ACGIH TVL/TWA: 0100.00 PPM  
ACGIH TLV/STEL: 0150.00 PPM  
OSHA PEL/TWA: 0100.00 PPM  
OSHA STEL: 0150.00 PPM  
-----

\*\*\*\*\*  
This product contains one or more reported carcinogens or suspected  
carcinogens which are noted NTP, IARC, or OSHA-Z in the other limits  
recommended column.  
\*\*\*\*\*  
This substance contains a material classified as a hazardous air  
pollutant.  
\*\*\*\*\*

-----  
SECTION 3 - HEALTH HAZARD INFORMATION  
-----

EMERGENCY OVERVIEW:

POTENTIAL HEALTH EFFECTS:

EYE:  
Severe irritation.  
Redness, tearing, blurred vision.

SKIN:  
Moderate irritation, drying of skin, defatting and possible  
dermatitis.

INHALATION - OVEREXPOSURE TO SOLVENT VAPORS OR SPRAY MIST:  
Nasal and respiratory irritation, anesthetic effects, dizziness,  
possible unconsciousness and asphyxiation, stupor, weakness,  
fatigue, nausea, and headache.

INHALATION - OVEREXPOSURE TO FREE PIGMENT DUST:

INGESTION:  
Gastrointestinal irritation, nausea, vomiting, diarrhea, death,  
aspiration into the lungs which can be fatal.

CHRONIC EFFECTS:

NOTICE: Reports have associated repeated and prolonged occupational  
overexposure to solvents with permanent brain and nervous system  
damage. Intentional misuse by deliberately concentrating and  
inhaling the vapors may be harmful or fatal.  
Based on an International Agency for Research on Cancer (IARC) conclusion

TNEMEC COMPANY, INC.  
MATERIAL SAFETY DATA SHEET

F041-0002 5G

THINNER CLEAR

SECTION 6 - SPILL OR LEAK PROCEDURES

CLEAN-UP:

Remove all sources of ignition. Spills may be collected with inert, absorbent material for proper disposal. Use non-sparking tools, protective gloves, goggles and clothing, adequate ventilation, avoid the breathing of vapors and use respiratory protective devices. Transfer absorbent material to suitable containers for proper disposal.

SECTION 7 - SPECIAL PRECAUTIONS

HANDLING AND STORAGE:

Store in dry area. Keep closures tight and upright to prevent leakage. Do not store in high temperature areas or near fire or open flame. Refer to product data sheet for recommended storage temperatures.

SPECIAL COMMENTS:

Prevent prolonged breathing of airborne contaminants such as vapor, spray mists, or dusts. Prevent contact with skin and eyes. Do not take internally. Keep out of reach of children. Do not reuse or alter containers without proper industrial cleaning. Do not weld or flame cut empty, uncleaned containers due to potential fire and explosion hazard. Consult product data sheet for proper application instructions.

SECTION 8 - SAFE HANDLING AND USE INFORMATION

HYGIENIC PRACTICES:

Wash hands and other contaminated skin areas with warm soap and water before eating.

EYE PROTECTION:

Use chemical resistant splash type goggles.

RESPIRATORY PROTECTION:

Respiratory protective devices must be used when engineering and administration controls are not adequate to maintain Threshold Limit Values (TLV) and Permissible Exposure Limits (PEL) of airborne contaminants below the listed values for those hazardous ingredients identified in Section II of this MSDS. Observe OSHA regulations for respirator use (CFR 29, 1910.134) whenever a respirator is used. Particulate, chemical cartridge, air purifying half-mask respirators can be used within certain limitations; consult the respirator manufacturer for specific uses and limitations. Where airborne contaminant concentrations are unknown, the use of a NIOSH/MSHA approved fresh-air supplied respirator is mandatory.

OTHER PROTECTION:

Use Chemical resistant gloves.  
Use chemical resistant coveralls or apron to protect against skin and clothing contamination.  
Use protective cream where skin contact is likely.

VENTILATION:

Sufficient ventilation, in volume and pattern, should be provided through both local and general exhaust to keep the air contaminant concentration below current applicable OSHA Permissible Exposure Limits (PEL) and ACGIH's Threshold Limit Values (TLV). Appropriate ventilation should be employed to remove hazardous decomposition products formed during welding or flame cutting operations of surfaces coated with this product. Heavier than air solvent vapors should be removed from lower levels of work area due to potential explosion hazard and all ignition sources (non-explosion proof equipment) should be eliminated if flammable mixtures will be encountered.

SECTION 9 - PHYSICAL AND CHEMICAL PROPERTIES

Vapor Pressure	6.00
Vapor Density	-N/A
Boiling Range	Lower - 275.0 °F Higher - 288.0 °F
Formula Weight per Volume	7.2000 LB/GL
VOC IN LBS PER GALLON	7.200
Evaporation Rate	9.400 (Ether = 1)

TNEMEC COMPANY, INC.  
MATERIAL SAFETY DATA SHEET

F041-0002 5G

THINNER CLEAR

MSDS Last Prepared . . . . . : 04/27/2000

HMIS Information: Health- 2 Flammability- 3  
Reactivity- 1

For specific information regarding occupational safety and health standards, please refer to the Code of Federal Regulations, Title 29, Part 1910.

To the best of our knowledge, the information contained herein is accurate. However, neither the Tnemec Company or any of its subsidiaries assume any liability whatsoever for the accuracy or completeness of the information contained herein. Final determination of suitability of any material is the sole responsibility of the user. All materials may present unknown health hazards and should be used with caution. Although certain hazards are described herein, we cannot guarantee that these are the only hazards which exist.

## **Basic Cleaning Procedures for Anodic Finishes**

**Cleaning of light surface soil may be accomplished using the following methods:**

- Flush surface with water using moderate pressure to remove soil. If soil is still adhering after drying, a mild detergent may be necessary.
- When mild detergent or soap is necessary, it should be used with brushing (non-metal) or sponging. The surface must be thoroughly rinsed with clean water after the use of any cleaning agent. It may be necessary to sponge the surface while rinsing, particularly if the cleaner is permitted to dry on the surface. Mild detergents ruled safe for bare hands should be safe for coated aluminum. Stronger detergents should be carefully spot tested and may necessitate the use of rubber gloves, long handled brushes, etc.
- If surface soil still adheres after following the procedures above, cleaning using a palm-sized nylon pad can be employed. Thoroughly wet pad with clean water or a mild detergent. Rub the metal surface in the direction of the metal grain with uniform pressure. After scrubbing, the metal surface should be rinsed thoroughly using clean water to remove all residues. Solvents may be used to remove non-water soluble deposits. Extreme care must be exercised when solvents are used since they may damage organic sealants, gaskets and painted finishes. If solvents are used, rinse the surface completely with clean water.

### **Cleaning Precautions**

- Never use aggressive alkaline or acid cleaners on aluminum finishes. Do not use cleaners containing trisodium phosphate, phosphoric acid, hydrochloric acid, hydrofluoric acid, fluorides, or similar compounds on anodized aluminum surfaces. Always follow the cleaner manufacturer's recommendations as to the proper cleaner and concentration. Test-clean a small area first. Different cleaners should not be mixed.
- It is preferable to clean the metal when shaded. Do not attempt to clean hot, sun-heated surfaces since possible chemical reactions on hot metal surfaces will be highly accelerated and non-uniform. Also, avoid cleaning in freezing temperatures or when metal temperatures are sufficiently cold to cause condensation. Surfaces cleaned under these adverse conditions can become streaked or tainted that they cannot be restored to their original appearance.

**References**

VOLUNTARY GUIDE SPECIFICATION FOR CLEANING AND MAINTENANCE  
OF ARCHITECTURAL ANODIZED ALUMINUM, AAMA 609.1  
American Architectural Manufacturers Association

**R1843 Austin WTP #4**  
**Aluminum Railing Design Calculations – REI # R11-09-01H**  
Austin, TX

Prepared for  
**Rocky Mountain Railings**  
Denver, CO

Date: 9/26/11

**Design Criteria:**

1. Railing live loads per Project Specifications (IBC 2006):

Guardrails

- 50 plf uniform load in any direction on top rail
- 200 pound concentrated load in any direction on top rail
- 50 pound concentrated load over 1 ft<sup>2</sup> of infill area
- Concentrated load and uniform loads need not be assumed to act concurrently

Railing deflections per ASTM E985

Members designed per Aluminum Association Inc, "Aluminum Design Manual"

2. Aluminum member sizes shall be as recommended in the calculation booklet
3. Aluminum alloys shall be as recommended in the calculation booklet
4. Stainless steel fasteners to be minimum Condition "CW", Fy= 65 ksi
5. Aluminum welds to be filler alloy 5356, unless noted otherwise
6. Concrete strength is assumed to be F'c= 4,000 psi, normal weight
7. Additional RISA Finite Element Analysis model data available upon request.

**RICE**  
**ENGINEERING**


105 School Creek Trill  
Luxemburg, WI 64217  
Phone: 920.845.1042  
Fax: 920.845.1048  
www.rice-inc.com

Texas Firm No: F-2183  
L. David Rice  
Registration No: 81248

This Certification is limited to the structural design of structural components of this handrail or divider system. It does NOT include responsibility for:


- Structural design of misc. hardware (latches, hinges, etc.).
- Structural design of concrete slabs and other masonry units
- Structural design of wood blocking or wood framing
- Structural design of all other anchorage substrates
- The manufacture, assembly, or installation of the system.
- Quantities of materials or dimensional accuracy of drawings

Engineers Design Approval Stamp:

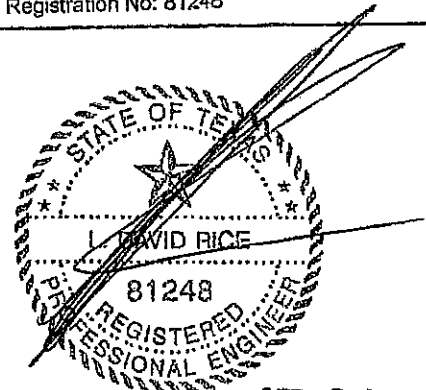

SEP 26 2011



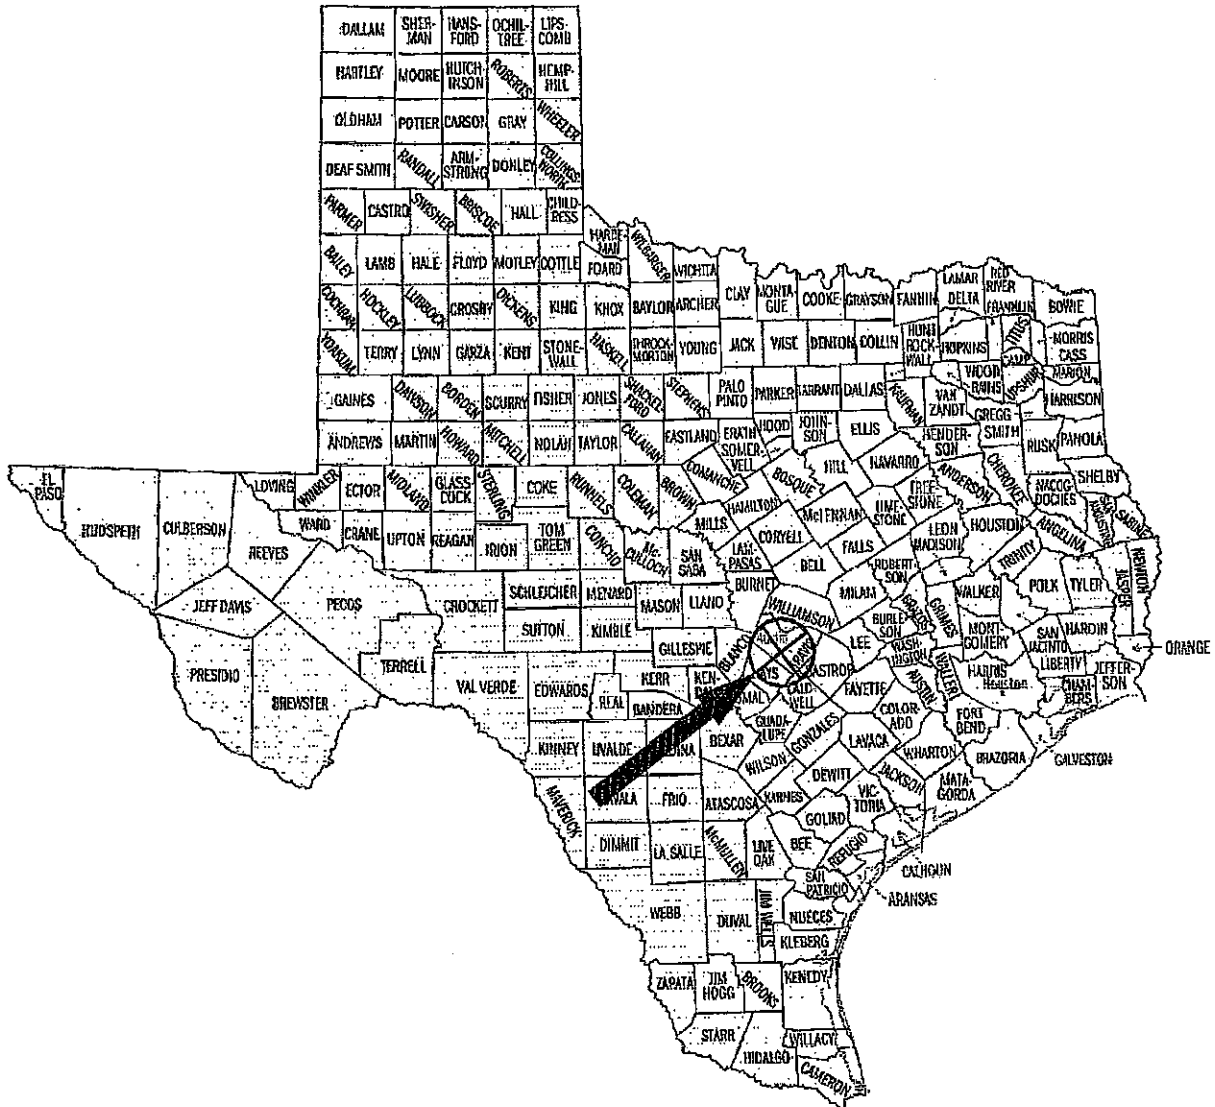


**Project Location: Austin, TX**

- Design Loads per Project Specification (IBC 2006)
- 50 plf uniform load in any direction on top rail
- 200# concentrated load in any direction on top rail
- 50# concentrated load applied laterally over 1 ft<sup>2</sup> of infill

<b>RICE</b> <b>ENGINEERING</b> Template:	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  <b>R1843 Austin WTP #4</b>	Job No: R11-09-01H Engineer: JDB Date: 9/16/11 Chk By:	Sheet No: PL Rev: Date:
--	---	--	---	-------------------------------



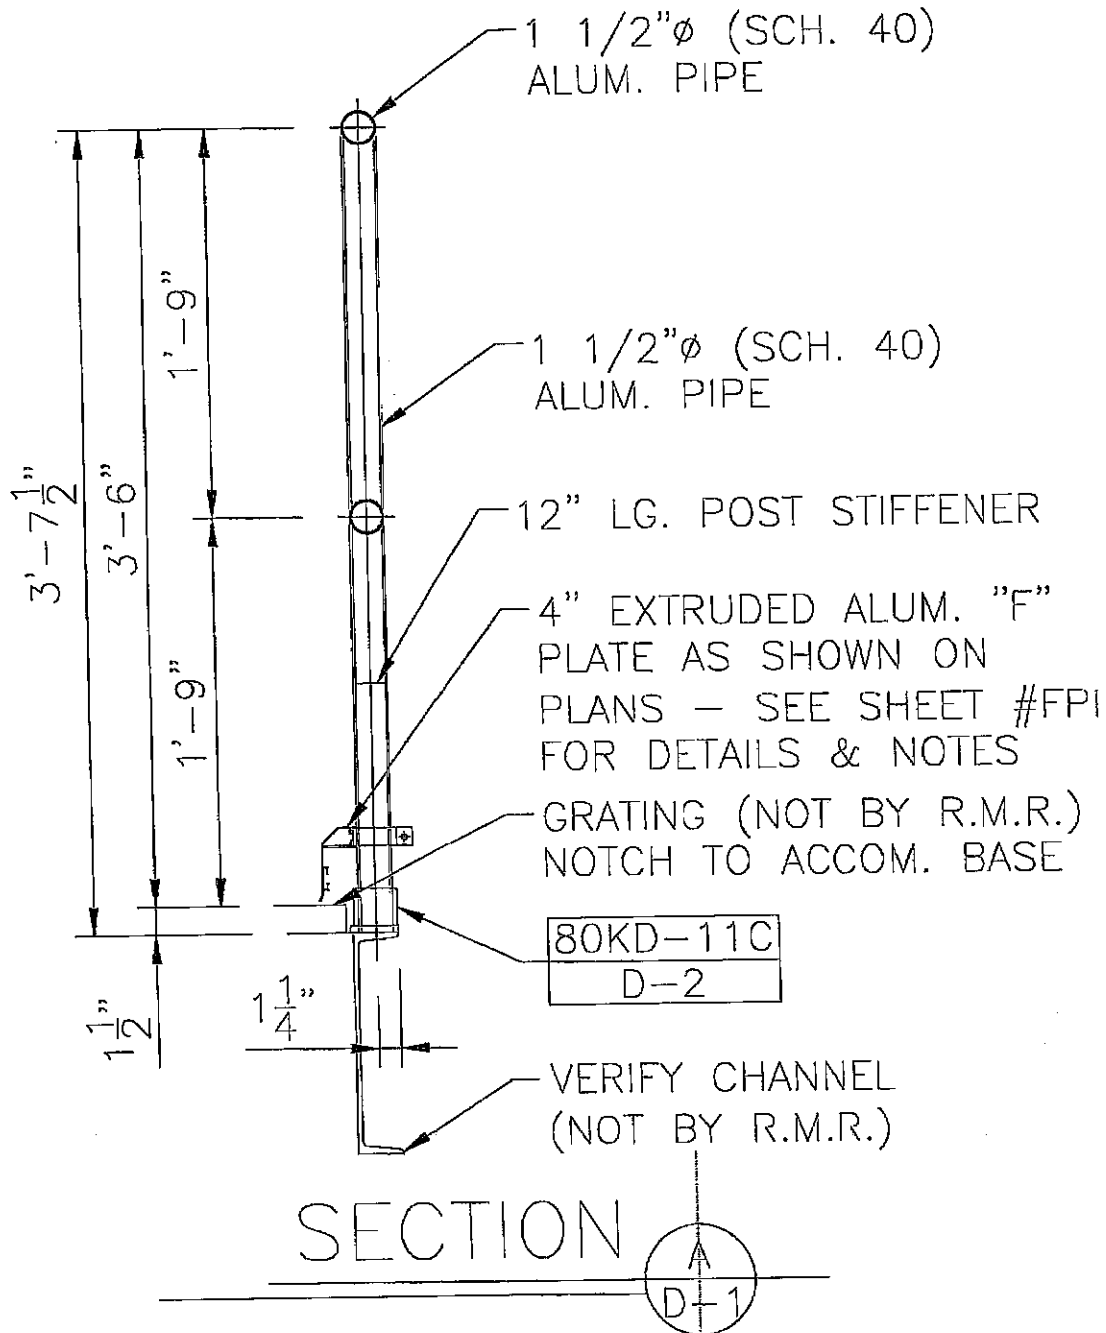

**Note:** Structural steel, Concrete, CMU and all other anchorage substrates designed by others



ROCKY MOUNTAIN RAILINGS

<b>RICE</b> <b>ENGINEERING</b> Template: REL-MC-5707	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01H	
			Engineer: JDB	Sheet No: A
			Date: 9/16/11	Rev:
			Chk By:	Date:

# Pipe Railing & Post

These calculations are based on empirical test data performed by Julius Blum & Co., Inc.

Guardrail "A" Analysis

SHT  
A1

## Input Variables:

$F_H = 50$  plf Load Case 1 (Uniform Load)  
 $F_V = 0$  plf Simultaneous Vertical Uniform Load  
 $P = 200$  lb Load Case 2 (Point Load)  
 $L_{bp} = 20$  in Unbraced Length of Post  
 $h = 43.5$  in Railing Height  
 $L = 60$  in **5'-0" MAX POST SPACING**

## Number of Railing Spans:

1 span  
 2 span  
 3 or more spans

## Railing Section:

1 1/4" Schd. 40  
 1 1/4" Schd. 80  
 1 1/2" Schd. 40  
 1 1/2" Schd. 80  
 1 1/2" tube  
 2" Schd. 40  
 2" Schd. 80

## Railing Temper:


6063-T5  
 6063-T8  
 6061-T6 or 6105-T5  
 4/3 increase allowed

## Post Section:

1 1/4" Schd. 40  
 1 1/4" Schd. 80  
 1 1/2" Schd. 40  
 1 1/2" Schd. 80  
 1 1/2" tube  
 2" Schd. 40  
 2" Schd. 80

## Post Temper:

6063-T6  
 6005-T5  
 6061-T6 or 6105-T5  
 Post Welded to Base Plate

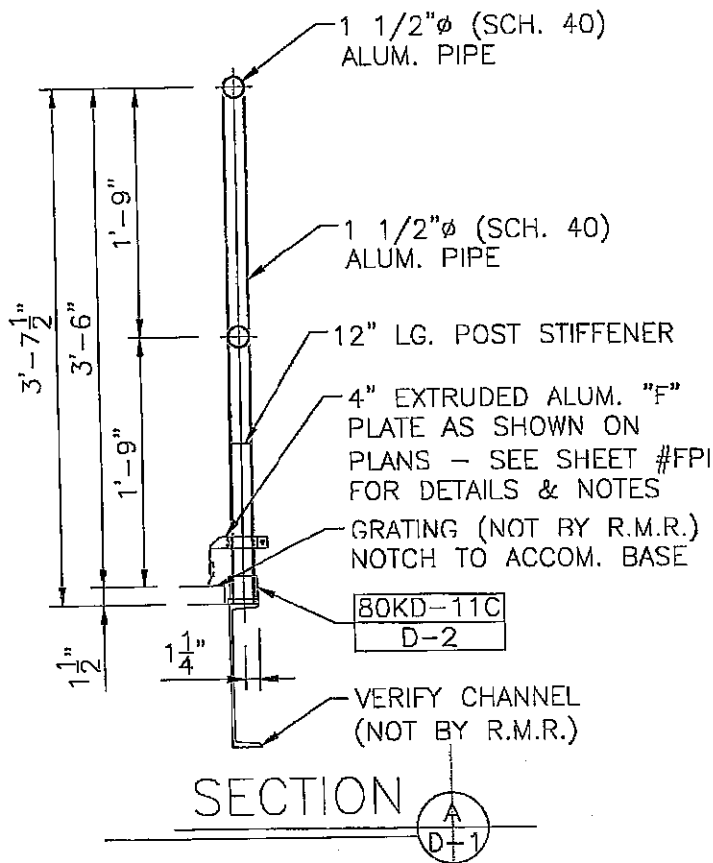

All calculations below this line are automatic

## Railing Properties

$k_r =$	0.31
$l_y r =$	0.31
$S_{x r} =$	0.326
$S_{y r} =$	0.326
$R =$	0.95
$t =$	0.145

## Post Properties

$k_r =$	0.31
$l_y r =$	0.31
$S_{x r} =$	0.326
$S_{y r} =$	0.326
$R =$	0.95
$t =$	0.145

## Computational Factors

$S_{R1} = \frac{R_r}{l_r} \quad S_{R1} = 6.55 \quad K_1 = (8 \cdot q_1) + (8 \cdot q_2) + (9.5 \cdot q_3) \quad K_1 = 8$   
 $S_{R2} = \frac{R_p}{l_p} \quad S_{R2} = 6.55 \quad K_2 = (4 \cdot q_1) + (5 \cdot q_2) + (5 \cdot q_3) \quad K_2 = 5$   
 $S_{R3} = \frac{R_p}{l_p} \quad S_{R3} = 6.55 \quad K_3 = (48 \cdot q_1) + (66 \cdot q_2) + (87 \cdot q_3) \quad K_3 = 66$

$E_r = 10100000$  psi

$I_{xtot} = I_{xr} \quad I_{xtot} = 0.31 \text{ in}^4 \quad I_{xtot} = I_{xp} \quad I_{xtot} = 0.31 \text{ in}^4$   
 $I_{ytot} = I_{yr} \quad I_{ytot} = 0.31 \text{ in}^4 \quad I_{ytot} = I_{yp} \quad I_{ytot} = 0.31 \text{ in}^4$

## 12" Min. Length AL. Ribbed Tube Stub

$I_{st} = 0.174 \text{ in}^4 \quad L_{st} = 12 \text{ in}$   
 $S_{st} = 0.224 \text{ in}^3 \quad F_{bst} = 25000 \text{ psi}$

<b>RICE</b> ENGINEERING Template: REL-MC-5707	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:		Job No:	R11-09-01H		
		R1843 Austin WTP #4		Engineer:	JDB	Sheet No:	A1
				Date:	9/16/11	Rev:	
				Chk By:		Date:	

# Railing Analysis:

$$W_h := \frac{F_H}{12}$$

$$W_v := \frac{F_V}{12}$$

Guardrail "A" Analysis

SHT  
A1 A

## Case 1 Uniform Load:

$$\Delta_{yr1} := \frac{5 \cdot W_h \cdot L^4}{384 \cdot E_r \cdot I_{ytotr}}$$

$$\Delta_{yr1} = 0.225 \quad \text{in} \quad \text{Modeled as a simple span}$$

$$\Delta_{xr1} := \frac{5 \cdot W_v \cdot L^4}{384 \cdot E_r \cdot I_{xtotr}}$$

$$\Delta_{xr1} = 0 \quad \text{in}$$

$$\Delta_{allr} := \frac{L}{96}$$

$$\Delta_{allr} = 0.63 \quad \text{in} \quad \text{Per ASTM Specification E985}$$

$$M_{yrmax} := \frac{W_h \cdot L^2}{K_1}$$

$$M_{yrmax} = 1875 \quad \text{lb-in}$$

$$M_{xrmax} := \frac{W_v \cdot L^2}{K_1}$$

$$M_{xrmax} = 0 \quad \text{lb-in}$$

$$f_{bry1} := \frac{M_{yrmax}}{S_{yr}}$$

$$f_{bry1} = 5752 \quad \text{psi}$$

$$f_{brx1} := \frac{M_{xrmax}}{S_{xr}}$$

$$f_{brx1} = 0 \quad \text{psi}$$

## Case 2 - Point Load:

$$\Delta_{yr2} := \frac{P \cdot L^3}{K_3 \cdot E_r \cdot I_{ytotr}}$$

$$\Delta_{yr2} = 0.209 \quad \text{in}$$

$$M_{yrmax2} := \frac{P \cdot L}{K_2}$$

$$M_{yrmax2} = 2400 \quad \text{lb-in}$$

$$f_{bry2} := \frac{M_{yrmax2}}{S_{yr}}$$

$$f_{bry2} = 7362 \quad \text{psi}$$

$$F_{bry} := \begin{cases} (f_{bry1} \cdot 1.33) & \text{if IBC} = 1 \\ f_{bry1} & \text{otherwise} \end{cases}$$

$$F_{bry} = 25000 \quad \text{psi}$$

## Calculation Results:

$$Int_1 := \left( \frac{f_{brx1}}{F_{bry}} \right) + \left( \frac{f_{bry1}}{F_{bry}} \right)$$

$$Int_1 = 0.23$$

$$Int_2 := \frac{f_{bry2}}{F_{bry}}$$

$$Int_2 = 0.29$$

$$RAILS := \begin{cases} \text{"OK"} & \text{if } \frac{\max(\Delta_{yr1}, \Delta_{xr1}, \Delta_{yr2})}{\Delta_{allr}} \leq 1 \wedge \left( \frac{f_{brx1}}{F_{bry}} \right) + \left( \frac{f_{bry1}}{F_{bry}} \right) \leq 1 \wedge \frac{f_{bry2}}{F_{bry}} \leq 1 \\ \text{"FAIL"} & \text{otherwise} \end{cases}$$

RAILS = "OK"

<b>RICE</b> <b>ENGINEERING</b> Template: REI-MC-5707	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01H
		Engineer: JDB	Sheet No: A1 A
		Date: 9/16/11	Rev:
		Chk By:	Date:

**Post Analysis:**

$E_p := E_r$

Guardrail "A" Analysis	SHT A1 B
------------------------	-------------

$\Delta_{xp1} := \frac{W_h \cdot L \cdot (h - L_{st})^3}{3 \cdot E_p \cdot (I_{xp})}$

$\Delta_{xp1} = 0.832$  in

$\Delta_{xp2} := \frac{P \cdot 0.85 \cdot (h - L_{st})^3}{3 \cdot E_p \cdot (I_{xp})}$

$\Delta_{xp2} = 0.566$  in

**Max Deflection:**

$\Delta_{tot} := \frac{W_h \cdot L \cdot (h - L_{st})^3}{3 \cdot E_p \cdot I_{xp}} + \frac{W_h \cdot L \cdot [h^3 - (h - L_{st})^3]}{3 \cdot [(E_p \cdot I_{xp}) + (E_p \cdot I_{st})]}$

$\Delta_{tot} = 1.702$  in

$\Delta_{allp} := \frac{h}{12}$

$\Delta_{allp} = 3.63$  in Per ASTM Specification E985

**Case 1 - Uniform Load:**

$M_{xp} := (W_h \cdot L \cdot h) + W_v \cdot L \cdot \Delta_{tot}$

$M_{xpmax} := 0.5 \cdot M_{xp} \cdot q1 + M_{xp} \cdot q2 + M_{xp} \cdot q3$

$M_{xpmax} = 10875$  lb-in

$M_{xp2} := W_h \cdot L \cdot (h - L_{st}) + W_v \cdot L \cdot \Delta_{xp1}$

$M_{xpmax2} := 0.5 \cdot M_{xp2} \cdot q1 + M_{xp2} \cdot q2 + M_{xp2} \cdot q3$

$M_{xpmax2} = 7875$  lb-in

**Case 2 - Point Load:**

$M_{xpmax4} := P \cdot (h - L_{st}) \cdot 0.85$

$M_{xpmax4} = 5355$  lb-in

$M_{xpmax3} := (P \cdot h \cdot 0.85)$

$M_{xpmax3} = 7395$  lb-in

**Max Post Stress:**

$f_{bpx} := \frac{\max(M_{xpmax2}, M_{xpmax4})}{S_{xp}}$

$f_{bpx} = 24156$  psi

$F_{bpx} := \begin{cases} (F_{bpx1} \cdot 1.33) & \text{if IBC} = 1 \\ F_{bpx1} & \text{otherwise} \end{cases}$

$F_{bpx} = 25000$  psi

**Max Post/Stub Combined Stress:**

$f_{bpx2} := \max(M_{xpmax}, M_{xpmax3}) \cdot \frac{I_{xp}}{(I_{xp} + I_{st}) \cdot S_{xp}}$

$f_{bpx2} = 21366$  psi

$F_{bpx} = 25000$  psi

**Max Stub Stress:**

$f_{bst} := \max(M_{xpmax}, M_{xpmax3}) \cdot \frac{I_{st}}{(I_{xp} + I_{st}) \cdot S_{st}}$

$f_{bst} = 17454$  psi

$F_{bst} = 25000$  psi

**Calculation Results:**

$Intp1 := \max\left(\frac{f_{bpx}}{F_{bpx}}, \frac{f_{bpx2}}{F_{bpx}}, \frac{f_{bst}}{F_{bst}}\right)$

$Intp1 = 0.97$



$POSTS := \begin{cases} \text{"OK"} & \text{if } Intp1 \leq 1 \wedge \frac{\max(\Delta_{xp1}, \Delta_{xp2}, \Delta_{tot})}{\Delta_{allp}} \leq 1 \\ \text{"FAIL"} & \text{otherwise} \end{cases}$

$POSTS = \text{"OK"}$

<b>RICE</b> <b>ENGINEERING</b> Template: REI-MC-5707	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description: R1843 Austin WTP #4	Job No: R11-09-01H Engineer: JDB Date: 9/16/11 Chk By:	Sheet No: A1 B Rev: Date:
--	---	---	---	---------------------------------

$R_{max} := 250$  lb

$M_{max} := 10875$  lb-in  $d := 2.5$  in (sleeve dia.)

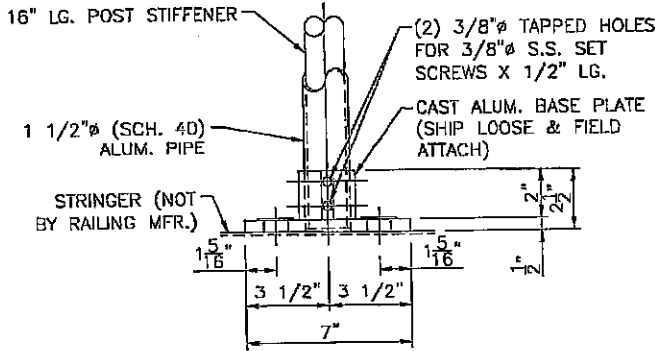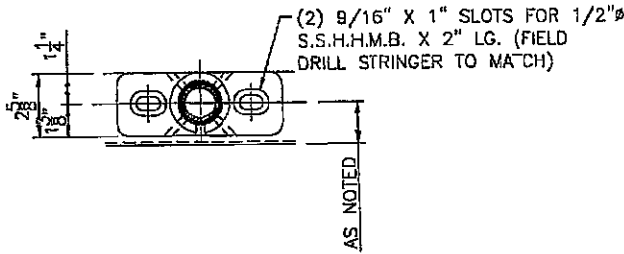

LEVEL STL. LINE POST

BOKD-11C

**Chk shear on shoe wall:**

$P := \frac{M_{max}}{0.67 \cdot (2.375)}$   $P = 6834$  lb

$f_v := \frac{(P + R_{max})}{2 \cdot (0.315) \cdot (2)}$   $f_v = 5622$  psi

$F_v := \frac{0.57 \cdot (18000)}{1.65}$   $F_v = 6218$  psi

$I := \frac{f_v}{F_v}$   $I = 0.9$  **Shear Stress "OK"**

**Chk Aluminum Base Plate:**

$L1 := 7$  in  $D1 := 1.3125$  in

$L2 := 2.625$  in  $D2 := 1.25$  in

$t := 0.563$  in

$L := L1 - (2 \cdot D1)$   $L = 4.38$  in

$P := \frac{M_{max}}{d}$   $P = 4350$  lb

$M_{p1} := 0.5 \cdot P \cdot 0.9375$   $M_{p1} = 2039$  in-lb

$F_y := \frac{1.3 \cdot (18000)}{1.65}$   $F_y = 14182$  psi

$t_{req1} := \sqrt{\frac{M_{p1} \cdot 6}{F_y \cdot L2}}$   $t_{req1} = 0.573$  in

$I_2 := \frac{t_{req1}}{t}$   $I_2 = 1.02$  2% Over Ok

**Chk Bolts to Steel Stringer:**

$V_b := \frac{R_{max}}{2}$   $V_b = 125$  lb

$T_b := \frac{M_{max}}{2 \cdot 1.25}$   $T_b = 4350$  lb

$V_{all} := 0.196 \cdot 23094$   $V_{all} = 4526$  lb


$T_{all} := 0.142 \cdot 40000 \cdot \frac{0.375}{0.456}$   $T_{all} = 4671$  lb

$I_3 := \left( \frac{V_b}{V_{all}} \right)^2 + \left( \frac{T_b}{T_{all}} \right)^2$   $I_3 = 0.87$

**Use (2) - 1/2" Dia. S.S. Thru-Bolts  
or Drill & Tap w/ 3/8" Min. Thread Engagement  
Condition "CW" - Fy = 65 ksi**

**Use Cast Aluminum Base, as shown  
535 casting alloy, Fu = 35 ksi min.**

<p><b>RICE</b> ENGINEERING</p> <p>Template: REI-MC-2002</p>	<p>105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com</p>	<p>Project Description:  R1843 Austin WTP #4</p>	Job No: R11-09-01H	
			Engineer: JDB	Sheet No: A2
			Date: 9/16/11	Rev:
			Chk By:	Date:

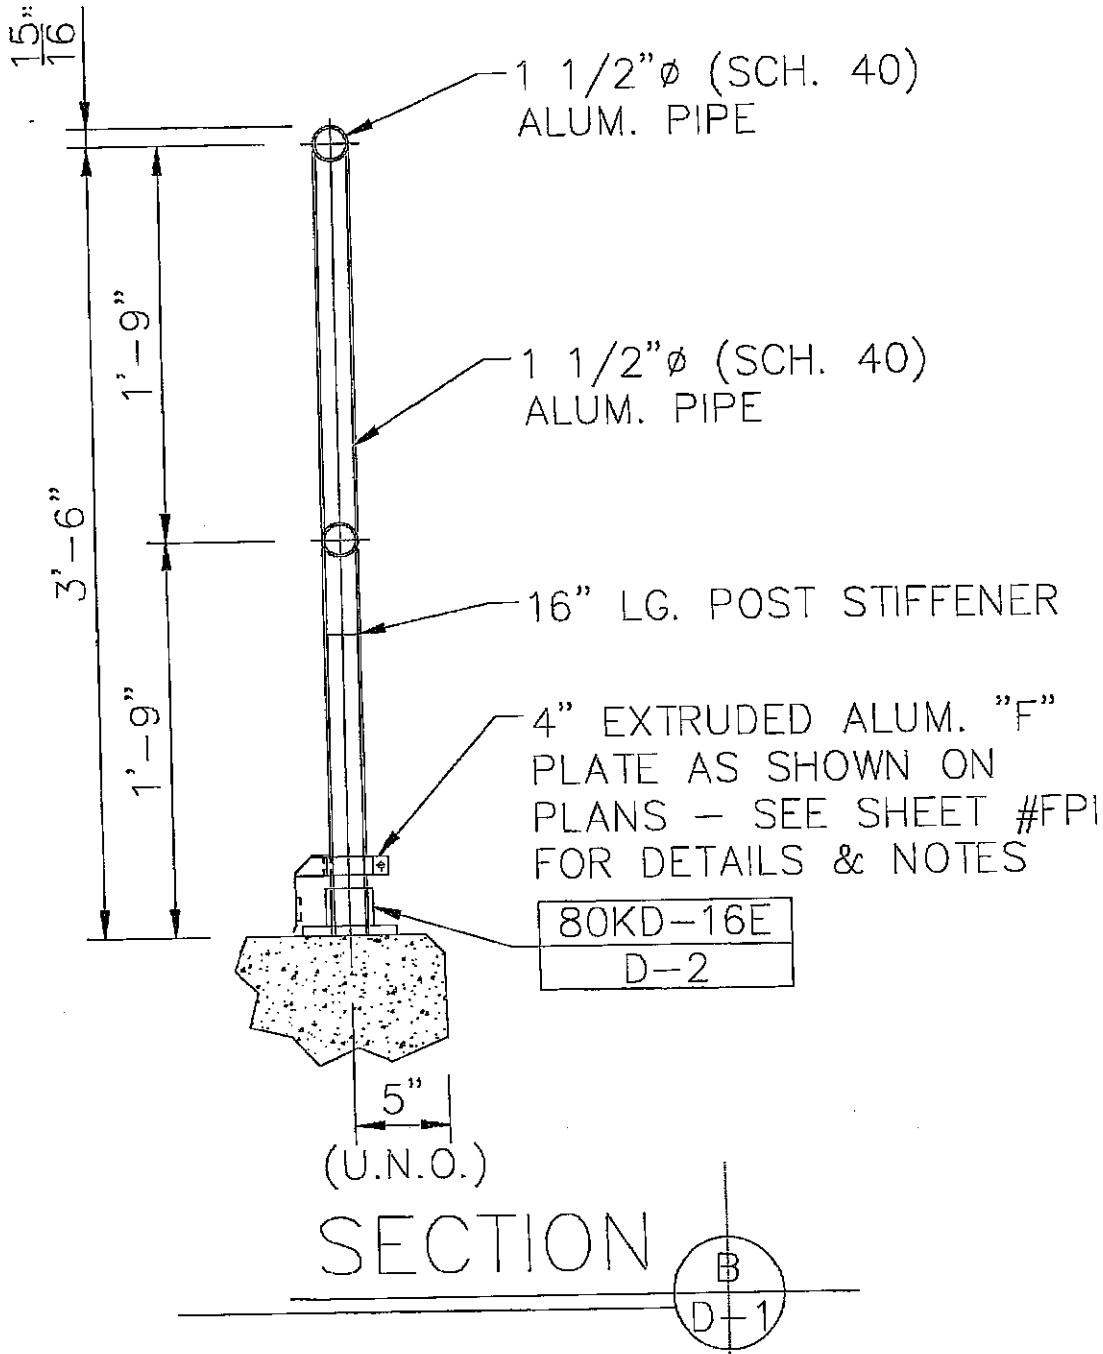

**Note:** Structural steel, Concrete, CMU and all other anchorage substrates designed by others



ROCKY MOUNTAIN RAILINGS

<b>RICE</b> ENGINEERING Template: REI-MC-5707	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01H	
			Engineer: JDB	Sheet No: B
			Date: 9/16/11	Rev:
			Chk By:	Date:

# Pipe Railing & Post

These calculations are based on empirical test data performed by Julius Blum & Co., Inc.

Guardrail "B" Analysis

SHT  
B1

## Input Variables:

FH := 50      plf      Load Case 1 (Uniform Load)  
 FV := 0      plf      Simultaneous Vertical Uniform Load  
 P := 200      lb      Load Case 2 (Point Load)  
 Lbp := 20      in      Unbraced Length of Post  
 h := 42      in      Railing Height  
 L := 60      in      **5'-0" MAX POST SPACING**

## Number of Railing Spans:

1 span        
 2 span        
 3 or more spans     

## Railing Section:

1 1/4" Schd. 40  
 1 1/4" Schd. 80  
 1 1/2" Schd. 40  
 1 1/2" Schd. 80  
 1 1/2" tube  
 2" Schd. 40  
 2" Schd. 80

## Railing Temper:


6063-T5  
 6063-T6  
 6061-T6 or 6105-T5  
 4/3 increase allowed

## Post Section:

1 1/4" Schd. 40  
 1 1/4" Schd. 80  
 1 1/2" Schd. 40  
 1 1/2" Schd. 80  
 1 1/2" tube  
 2" Schd. 40  
 2" Schd. 80

## Post Temper:

6063-T6  
 6005-T5  
 6061-T6 or 6105-T5  
 Post Welded to Base Plate

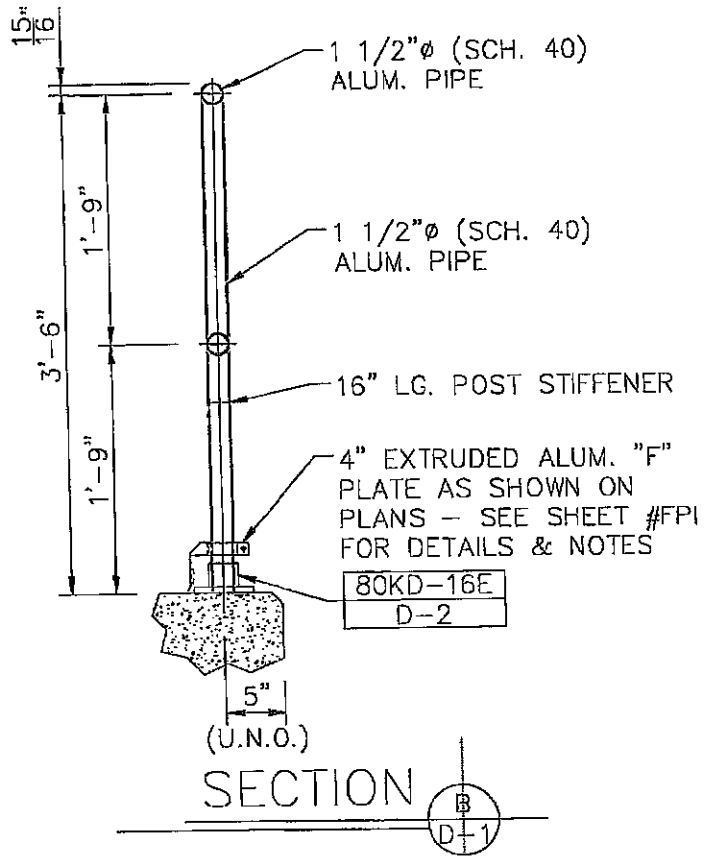

All calculations below this line are automatic

## Railing Properties

$I_{xr} = 0.31$   
 $I_{yr} = 0.31$   
 $S_{xr} = 0.326$   
 $S_{yr} = 0.326$   
 $R = 0.95$   
 $F = 0.145$

## Post Properties

$I_{xp} = 0.31$   
 $I_{yp} = 0.31$   
 $S_{xp} = 0.326$   
 $S_{yp} = 0.326$   
 $R = 0.95$   
 $F = 0.145$

## Computational Factors

$SR_1 = \frac{R_y}{t_r} = 6.55$        $K_1 = (8 \cdot q_1) + (8 \cdot q_2) + (9.5 \cdot q_3) = 8$   
 $SR_3 = \frac{R_p}{t_p} = 6.55$        $K_2 = (4 \cdot q_1) + (5 \cdot q_2) + (5 \cdot q_3) = 5$   
 $K_3 = (48 \cdot q_1) + (66 \cdot q_2) + (87 \cdot q_3) = 66$

$F_y := 10100000$       psi

$I_{xtot} := I_{xr}$        $I_{xtot} = 0.31$       in<sup>4</sup>       $I_{xtot} := I_{xp}$        $I_{xtot} = 0.31$       in<sup>4</sup>  
 $I_{ytot} := I_{yr}$        $I_{ytot} = 0.31$       in<sup>4</sup>       $I_{ytot} := I_{yp}$        $I_{ytot} = 0.31$       in<sup>4</sup>

## 12" Min. Length AL. Ribbed Tube Stub

$I_{st} = 0.174$       in<sup>4</sup>       $L_{st} = 12$       in  
 $S_{st} = 0.224$       in<sup>3</sup>       $F_{bst} = 25000$       psi

<b>RICE</b> ENGINEERING Template: REL-MC-5707	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:		Job No:	R11-09-01H		
		R1843 Austin WTP #4		Engineer:	JDB	Sheet No:	B1
				Date:	9/16/11	Rev:	
				Chk By:		Date:	

# Railing Analysis:

$$W_h := \frac{F_H}{12}$$

$$W_v := \frac{F_V}{12}$$

Guardrail "B" Analysis

SHT  
B1 A

## Case 1 Uniform Load:

$$\Delta_{yr1} := \frac{5 \cdot W_h \cdot L^4}{384 \cdot E_r \cdot I_{ytotr}}$$

$$\Delta_{yr1} = 0.225 \quad \text{in} \quad \text{Modeled as a simple span}$$

$$\Delta_{xr1} := \frac{5 \cdot W_v \cdot L^4}{384 \cdot E_r \cdot I_{xtotr}}$$

$$\Delta_{xr1} = 0 \quad \text{in}$$

$$\Delta_{allr} := \frac{L}{96}$$

$$\Delta_{allr} = 0.63 \quad \text{in} \quad \text{Per ASTM Specification E985}$$

$$M_{yrmax} := \frac{W_h \cdot L^2}{K_1}$$

$$M_{yrmax} = 1875 \quad \text{lb-in}$$

$$M_{xrmax} := \frac{W_v \cdot L^2}{K_1}$$

$$M_{xrmax} = 0 \quad \text{lb-in}$$

$$f_{bry1} := \frac{M_{yrmax}}{S_{yr}}$$

$$f_{bry1} = 5752 \quad \text{psi}$$

$$f_{brx1} := \frac{M_{xrmax}}{S_{xr}}$$

$$f_{brx1} = 0 \quad \text{psi}$$

## Case 2 - Point Load:

$$\Delta_{yr2} := \frac{P \cdot L^3}{K_3 \cdot E_r \cdot I_{ytotr}}$$

$$\Delta_{yr2} = 0.209 \quad \text{in}$$

$$M_{yrmax2} := \frac{P \cdot L}{K_2}$$

$$M_{yrmax2} = 2400 \quad \text{lb-in}$$

$$f_{bry2} := \frac{M_{yrmax2}}{S_{yr}}$$

$$f_{bry2} = 7362 \quad \text{psi}$$

$$F_{bry} := \begin{cases} (f_{bry1} \cdot 1.33) & \text{if IBC} = 1 \\ f_{bry1} & \text{otherwise} \end{cases}$$

$$F_{bry} = 25000 \quad \text{psi}$$

## Calculation Results:

$$Int_1 := \left( \frac{f_{brx1}}{F_{bry}} \right) + \left( \frac{f_{bry1}}{F_{bry}} \right)$$

$$Int_1 = 0.23$$

$$Int_2 := \frac{f_{bry2}}{F_{bry}}$$

$$Int_2 = 0.29$$

$$RAILS := \begin{cases} \text{"OK"} & \text{if } \frac{\max(\Delta_{yr1}, \Delta_{xr1}, \Delta_{yr2})}{\Delta_{allr}} \leq 1 \wedge \left( \frac{f_{brx1}}{F_{bry}} \right) + \left( \frac{f_{bry1}}{F_{bry}} \right) \leq 1 \wedge \frac{f_{bry2}}{F_{bry}} \leq 1 \\ \text{"FAIL"} & \text{otherwise} \end{cases}$$

RAILS = "OK"

<b>RICE</b> <b>ENGINEERING</b> Template: REI-MC-5707	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:		Job No:	R11-09-01H	
		R1843 Austin WTP #4		Engineer:	JDB	Sheet No: B1 A
				Date:	9/16/11	Rev:
				Chk By:		Date:



**Post Analysis:**

$$E_p := E_r$$

Guardrail "B" Analysis	SHT B1 B
------------------------	-------------

$$\Delta_{xp1} := \frac{W_h \cdot L \cdot (h - L_{st})^3}{3 \cdot E_p \cdot I_{xp}}$$

$$\Delta_{xp1} = 0.719 \quad \text{in}$$

$$\Delta_{xp2} := \frac{P \cdot 0.85 \cdot (h - L_{st})^3}{3 \cdot E_p \cdot I_{xp}}$$

$$\Delta_{xp2} = 0.489 \quad \text{in}$$

**Max Deflection:**

$$\Delta_{tot} := \frac{W_h \cdot L \cdot (h - L_{st})^3}{3 \cdot E_p \cdot I_{xp}} + \frac{W_h \cdot L \cdot [h^3 - (h - L_{st})^3]}{3 \cdot [E_p \cdot I_{xp} + (E_p \cdot I_{st})]}$$

$$\Delta_{tot} = 1.521 \quad \text{in}$$

$$\Delta_{allp} := \frac{h}{12}$$

$$\Delta_{allp} = 3.5 \quad \text{in} \quad \text{Per ASTM Specification E985}$$

**Case 1 - Uniform Load:**

$$M_{xp} := (W_h \cdot L \cdot h) + W_v \cdot L \cdot \Delta_{tot}$$

$$M_{xpmax} := 0.5 \cdot M_{xp} \cdot q1 + M_{xp} \cdot q2 + M_{xp} \cdot q3$$

$$M_{xpmax} = 10500 \quad \text{lb-in}$$

$$M_{xp2} := W_h \cdot L \cdot (h - L_{st}) + W_v \cdot L \cdot \Delta_{xp1}$$

$$M_{xpmax2} := 0.5 \cdot M_{xp2} \cdot q1 + M_{xp2} \cdot q2 + M_{xp2} \cdot q3$$

$$M_{xpmax2} = 7500 \quad \text{lb-in}$$

**Case 2 - Point Load:**

$$M_{xpmax4} := P \cdot (h - L_{st}) \cdot 0.85$$

$$M_{xpmax4} = 5100 \quad \text{lb-in}$$

$$M_{xpmax3} := (P \cdot h \cdot 0.85)$$

$$M_{xpmax3} = 7140 \quad \text{lb-in}$$

**Max Post Stress:**

$$f_{bpx} := \frac{\max(M_{xpmax2}, M_{xpmax4})}{S_{xp}}$$

$$f_{bpx} = 23006 \quad \text{psi}$$

$$F_{bpx} := \begin{cases} (F_{bpx1} \cdot 1.33) & \text{if IBC} = 1 \\ F_{bpx1} & \text{otherwise} \end{cases}$$

$$F_{bpx} = 25000 \quad \text{psi}$$

**Max Post/Stub Combined Stress:**

$$f_{bpx2} := \max(M_{xpmax}, M_{xpmax3}) \cdot \frac{I_{xp}}{(I_{xp} + I_{st}) \cdot S_{xp}}$$

$$f_{bpx2} = 20629 \quad \text{psi}$$

$$F_{bpx} = 25000 \quad \text{psi}$$

**Max Stub Stress:**

$$f_{bst} := \max(M_{xpmax}, M_{xpmax3}) \cdot \frac{I_{st}}{(I_{xp} + I_{st}) \cdot S_{st}}$$

$$f_{bst} = 16852 \quad \text{psi}$$

$$F_{bst} = 25000 \quad \text{psi}$$

**Calculation Results:**



$$Int_{p1} := \max\left(\frac{f_{bpx}}{F_{bpx}}, \frac{f_{bpx2}}{F_{bpx}}, \frac{f_{bst}}{F_{bst}}\right)$$

$$Int_{p1} = 0.92$$

$$POSTS := \begin{cases} \text{"OK"} & \text{if } Int_{p1} \leq 1 \wedge \frac{\max(\Delta_{xp1}, \Delta_{xp2}, \Delta_{tot})}{\Delta_{allp}} \leq 1 \\ \text{"FAIL"} & \text{otherwise} \end{cases}$$

$$POSTS = \text{"OK"}$$

<b>RICE</b> <b>ENGINEERING</b> Template: REI-MC-5707	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:	Job No:	R11-09-01H
		R1843 Austin WTP #4	Engineer:	JDB Sheet No: B1 B
			Date:	9/16/11 Rev:
			Chk By:	Date:

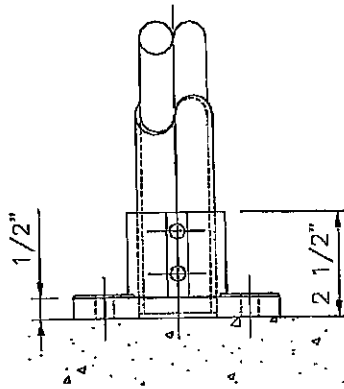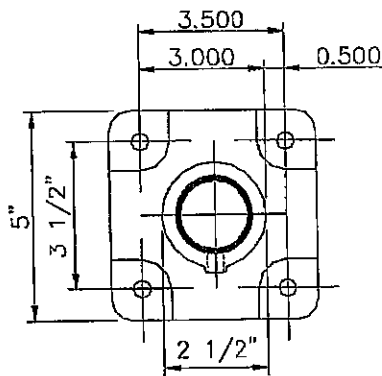

Surface Mount Anchor Analysis	SHT B2
-------------------------------	-----------

$$R_{max} := 250 \text{ lb}$$

$$M_{max} := 10500 \text{ lb-in}$$

$$d := 2.5 \text{ in (sleeve dia.)}$$

**Chk shear on shoe wall:**

$$P := \frac{M_{max}}{0.67 \cdot (2.375)} \quad P = 6599 \text{ lb}$$

$$f_v := \frac{(P + R_{max})}{2 \cdot (0.315) \cdot (2)} \quad f_v = 5435 \text{ psi}$$

$$F_v := \frac{0.57 \cdot (18000)}{1.65} \quad F_v = 6218 \text{ psi}$$

$$I := \frac{f_v}{F_v} \quad I = 0.87 \text{ Shear Stress "OK"}$$

**Chk Anchor Bolts (assume  $f_c = 4,000$  psi conc.):**

$$V_b := \frac{R_{max}}{2} \cdot 1.6 \quad V_b = 200 \text{ lb}$$

$$T_b := \frac{M_{max}}{(L1 - D2) \cdot 0.85 \cdot 1} \cdot 1.6 \quad T_b = 4651 \text{ lb}$$

See Next Sheet for Calculation

**Use (4) - 1/2" Dia. S.S. Threaded Rods  
With Hilti HIT-RE 500 SD Epoxy Adhesive**  
 Embedment = 4-1/2"  
 Edge = 3-1/4"  
 End = 3-1/4"

**Chk Aluminum Base Plate:**

$$L1 := 5 \text{ in} \quad D1 := 0.75 \text{ in}$$

$$L2 := 5 \text{ in} \quad D2 := 0.75 \text{ in}$$

$$L := L2 - (2 \cdot D2) \quad L = 3.5 \text{ in}$$

$$F_y := \frac{1.3 \cdot (18000)}{1.65} \quad F_y = 14182 \text{ psi}$$

$$P := \frac{M_{max}}{d \cdot 2} \quad P = 2100 \text{ lb}$$

$$M_{pl} := \frac{P \cdot 0.5 \cdot 3^2}{3.5^2} \quad M_{pl} = 771 \text{ in-lb}$$

$$t_{req} := \sqrt{\frac{M_{pl} \cdot 6}{F_y \cdot 5}} \quad t_{req} = 0.255 \text{ in}$$

$$I := \frac{t_{req}}{0.5} \quad I = 0.51 \text{ Bending Stress "OK"}$$

**Use Cast Aluminum Base, as shown**  
 535 casting alloy,  $F_u = 35$  ksi min.

<b>RICE</b> ENGINEERING	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01H
	Template:		Engineer: JDB    Sheet No: B2
			Date: 9/16/11    Rev:
			Chk By:    Date:



www.hilti.us

Company:  
 Specifier:  
 Address:  
 Phone | Fax: - | -  
 E-Mail:


Page: 1  
 Project:  
 Sub-Project | Pos. No.:  
 Date: 9/16/2011

Specifier's comments:

**Input data**

**Anchor type and diameter:** HIT-RE 500-SD + HAS-R 304/316, 1/2  
**Effective embedment depth:**  $h_{ef,act} = 4.500$  in. ( $h_{ef,min} = -$  in.)  
**Material:** ASTM F 593  
**Evaluation Service Report:** ESR 2322  
**Issued | Valid:** 4/1/2010 | -  
**Proof:** design method ACI 318 / AC308  
**Stand-off installation:**  $e_a = 0.000$  in. (no stand-off);  $t = 0.500$  in.  
**Anchor plate:**  $l_x \times l_y \times t = 3.000 \times 6.000 \times 0.500$  in. (Recommended plate thickness: not calculated)  
**Profile:** no profile  
**Base material:** uncracked concrete, 4000,  $f_c' = 4000$  psi;  $h = 8.000$  in., Temp. short/long: 32/32°F  
**Installation:** hammer drilled hole, installation condition: dry  
**Reinforcement:** tension: condition B, shear: condition B; no supplemental splitting reinforcement present  
 edge reinforcement: none or < No. 4 bar  
 Seismic loads (cat. C, D, E, or F): no

**Geometry [in.] & Loading [lb, in.-lb]**

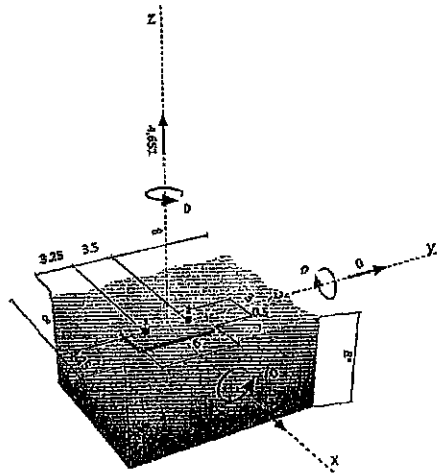

**Proof | Utilization (Governing Cases)**


Loading	Proof	Design values [lb]		Utilization [%]		Status
		Load	Capacity	$\beta_N/\beta_V$		
Tension	Concrete Breakout Strength	4651	4862	96 / -		OK
Shear	Concrete edge failure in direction x+	200	2924	-17		OK
Loading	$\beta_N$	$\beta_V$	$\zeta$	Utilization $\beta_{N,V}$ [%]		Status
Combined tension and shear loads	0.957	0.068	-	85		OK

**Warnings**

- Please consider all details and hints/warnings given in the detailed report!

**Fastening meets the design criteria!**

R3

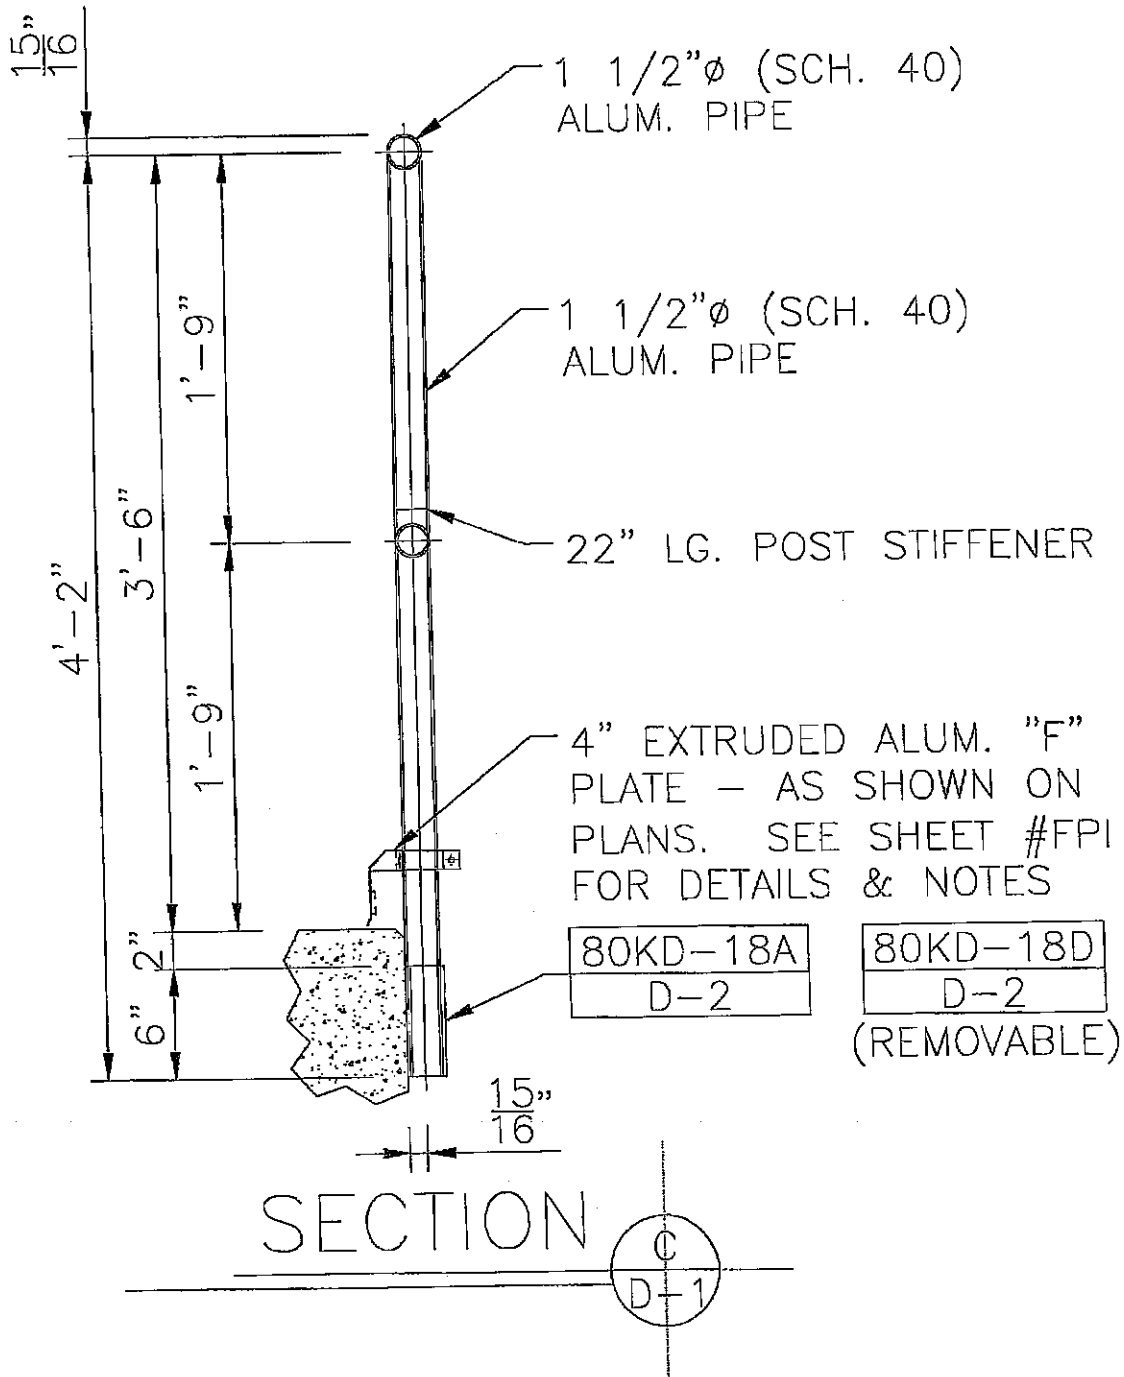

**Note:** Structural steel, Concrete, CMU and all other anchorage substrates designed by others



ROCKY MOUNTAIN RAILINGS

<b>RICE</b> ENGINEERING Template: REI-MC-5707	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01E	
			Engineer: JDB	Sheet No: C
			Date: 9/16/11	Rev:
			Chk By:	Date:

# Pipe Railing & Post

These calculations are based on empirical test data performed by Julius Blum & Co., Inc.

Guardrail "C" Analysis

SHT  
C1

## Input Variables:

$F_H := 50$  plf Load Case 1 (Uniform Load)  
 $F_V := 0$  plf Simultaneous Vertical Uniform Load  
 $P := 200$  lb Load Case 2 (Point Load)  
 $L_{bp} := 26$  in Unbraced Length of Post  
 $h := 47$  in Railing Height  
 $L := 60$  in **5'-0" MAX POST SPACING**

## Number of Railing Spans:

1 span   
 2 span   
 3 or more spans

## Railing Section:

1 1/4" Schd. 40  
 1 1/4" Schd. 80  
 1 1/2" Schd. 40  
 1 1/2" Schd. 80  
 1 1/2" tube  
 2" Schd. 40  
 2" Schd. 80

## Railing Temper:


6063-T5  
 6063-T6  
 6061-T6 or 6105-T5  
 4/3 increase allowed

## Post Section:

1 1/4" Schd. 40  
 1 1/4" Schd. 80  
 1 1/2" Schd. 40  
 1 1/2" Schd. 80  
 1 1/2" tube  
 2" Schd. 40  
 2" Schd. 80

## Post Temper:

6063-T6  
 6005-T5  
 6061-T6 or 6105-T5  
 Post Welded to Base Plate

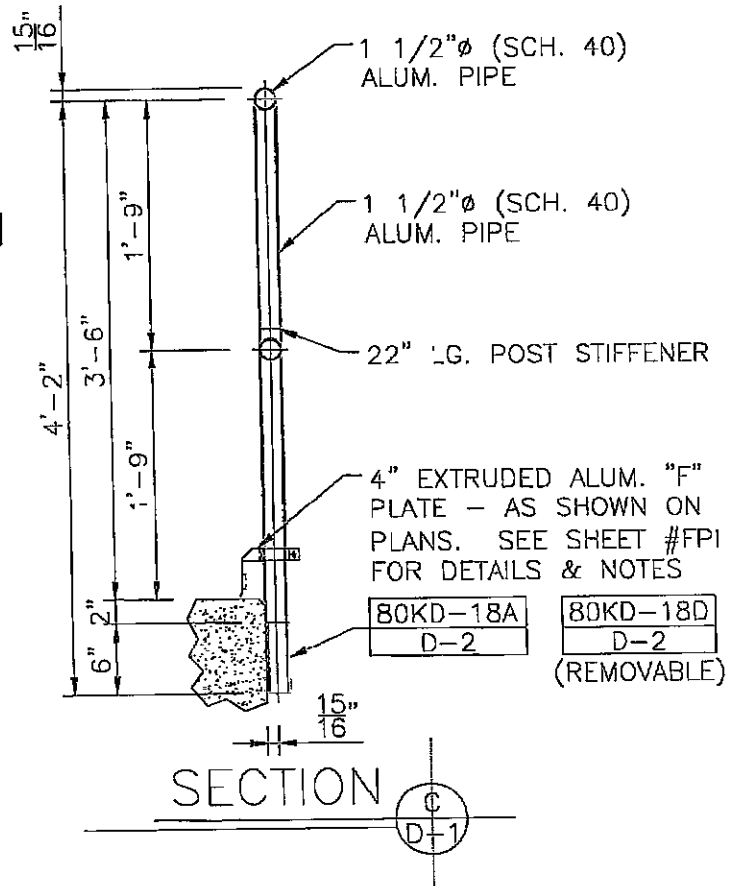

1 1/2"  $\phi$  (SCH. 40) ALUM. PIPE  
 1 1/2"  $\phi$  (SCH. 40) ALUM. PIPE  
 22" LG. POST STIFFENER  
 4" EXTRUDED ALUM. "F" PLATE - AS SHOWN ON PLANS. SEE SHEET #FPI FOR DETAILS & NOTES  
 80KD-18A D-2  
 80KD-18D D-2 (REMOVABLE)

All calculations below this line are automatic

## Railing Properties

$k_r = 0.31$   
 $k_y = 0.31$   
 $S_{xr} = 0.326$   
 $S_{yr} = 0.326$   
 $R = 0.95$   
 $t = 0.145$

$E_r = 10100000$  psi

$I_{xtot} = I_{xr}$   $I_{xtot} = 0.31$  in<sup>4</sup>  
 $I_{ytot} = I_{yr}$   $I_{ytot} = 0.31$  in<sup>4</sup>

## Post Properties

$k_r = 0.31$   
 $k_y = 0.31$   
 $S_{xr} = 0.326$   
 $S_{yr} = 0.326$   
 $R = 0.95$   
 $t = 0.145$

$I_{xtot} = I_{xp}$   $I_{xtot} = 0.31$  in<sup>4</sup>  
 $I_{ytot} = I_{yp}$   $I_{ytot} = 0.31$  in<sup>4</sup>

## Computational Factors

$SR1 = \frac{R_r}{t_r}$   $SR1 = 6.55$   $K_1 = (8 \cdot q_1) + (8 \cdot q_2) + (9.5 \cdot q_3)$   $K_1 = 8$   
 $SR3 = \frac{R_p}{t_p}$   $SR3 = 6.55$   $K_2 = (4 \cdot q_1) + (5 \cdot q_2) + (5 \cdot q_3)$   $K_2 = 5$   
 $K_3 = (48 \cdot q_1) + (66 \cdot q_2) + (87 \cdot q_3)$   $K_3 = 66$

## 18" Min. Length AL. Ribbed Tube Stub

$I_{st} = 0.174$  in<sup>4</sup>  $L_{st} = 15$  in  
 $S_{st} = 0.224$  in<sup>3</sup>  $F_{bst} = 25000$  psi

<b>RICE</b> ENGINEERING Template: REI-MC-5707	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01H
			Engineer: IDB Sheet No: C1
			Date: 9/16/11 Rev:
			Chk By: Date:

# Railing Analysis:

$$W_h := \frac{F_H}{12}$$

$$W_v := \frac{F_V}{12}$$

Guardrail "C" Analysis	SHT
	C1 A

## Case 1 Uniform Load:

$$\Delta_{yr1} := \frac{5 \cdot W_h \cdot L^4}{384 \cdot E_r \cdot I_{ytotr}}$$

$\Delta_{yr1} = 0.225$  in Modeled as a simple span

$$\Delta_{xr1} := \frac{5 \cdot W_v \cdot L^4}{384 \cdot E_r \cdot I_{xtotr}}$$

$\Delta_{xr1} = 0$  in

$$\Delta_{allr} := \frac{L}{96}$$

$\Delta_{allr} = 0.63$  in Per ASTM Specification E985

$$M_{y\max} := \frac{W_h \cdot L^2}{K_1}$$

$M_{y\max} = 1875$  lb-in

$$M_{x\max} := \frac{W_v \cdot L^2}{K_1}$$

$M_{x\max} = 0$  lb-in

$$f_{bry1} := \frac{M_{y\max}}{S_{yr}}$$

$f_{bry1} = 5752$  psi

$$f_{brx1} := \frac{M_{x\max}}{S_{xr}}$$

$f_{brx1} = 0$  psi

## Case 2 - Point Load:

$$\Delta_{yr2} := \frac{P \cdot L^3}{K_3 \cdot E_r \cdot I_{ytotr}}$$

$\Delta_{yr2} = 0.209$  in

$$M_{y\max2} := \frac{P \cdot L}{K_2}$$

$M_{y\max2} = 2400$  lb-in

$$f_{bry2} := \frac{M_{y\max2}}{S_{yr}}$$

$f_{bry2} = 7362$  psi

$$F_{bry} := \begin{cases} (f_{bry1} \cdot 1.33) & \text{if } IBC = 1 \\ f_{bry1} & \text{otherwise} \end{cases}$$

$F_{bry} = 25000$  psi

## Calculation Results:

$$Int_1 := \left( \frac{f_{brx1}}{F_{bry}} \right) + \left( \frac{f_{bry1}}{F_{bry}} \right)$$

$Int_1 = 0.23$

$$Int_2 := \frac{f_{bry2}}{F_{bry}}$$

$Int_2 = 0.29$

$$RAILS := \begin{cases} \text{"OK"} & \text{if } \frac{\max(\Delta_{yr1}, \Delta_{xr1}, \Delta_{yr2})}{\Delta_{allr}} \leq 1 \wedge \left( \frac{f_{brx1}}{F_{bry}} \right) + \left( \frac{f_{bry1}}{F_{bry}} \right) \leq 1 \wedge \frac{f_{bry2}}{F_{bry}} \leq 1 \\ \text{"FAIL"} & \text{otherwise} \end{cases}$$

**RAILS = "OK"**

<b>RICE</b> <b>ENGINEERING</b> Template: REL-MC-5707	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01H
			Engineer: JDB Sheet No: C1 A
			Date: 9/16/11 Rev:
			Chk By: Date:

**Post Analysis:**

$E_p := E_r$

Guardrail "C" Analysis	SHT
	C1 B

$\Delta_{xp1} := \frac{W_h \cdot L \cdot (h - L_{st})^3}{3 \cdot E_p \cdot (I_{xp})}$

$\Delta_{xp1} = 0.872$  in

$\Delta_{xp2} := \frac{P \cdot 0.85 \cdot (h - L_{st})^3}{3 \cdot E_p \cdot (I_{xp})}$

$\Delta_{xp2} = 0.593$  in

**Max Deflection:**

$\Delta_{tot} := \frac{W_h \cdot L \cdot (h - L_{st})^3}{3 \cdot E_p \cdot I_{xp}} + \frac{W_h \cdot L \cdot [h^3 - (h - L_{st})^3]}{3 \cdot [(E_p \cdot I_{xp}) + (E_p \cdot I_{st})]}$

$\Delta_{tot} = 2.083$  in

$\Delta_{allp} := \frac{h}{12}$

$\Delta_{allp} = 3.92$  in Per ASTM Specification E985

**Case 1 - Uniform Load:**

$M_{xp} := (W_h \cdot L \cdot h) + W_v \cdot L \cdot \Delta_{tot}$

$M_{xpmax} := 0.5 \cdot M_{xp \cdot q1} + M_{xp \cdot q2} + M_{xp \cdot q3}$

$M_{xpmax} = 11750$  lb-in

$M_{xp2} := W_h \cdot L \cdot (h - L_{st}) + W_v \cdot L \cdot \Delta_{xp1}$

$M_{xpmax2} := 0.5 \cdot M_{xp2 \cdot q1} + M_{xp2 \cdot q2} + M_{xp2 \cdot q3}$

$M_{xpmax2} = 8000$  lb-in

**Case 2 - Point Load:**

$M_{xpmax4} := P \cdot (h - L_{st}) \cdot 0.85$

$M_{xpmax4} = 5440$  lb-in

$M_{xpmax3} := (P \cdot h \cdot 0.85)$

$M_{xpmax3} = 7990$  lb-in

**Max Post Stress:**

$f_{bpx} := \frac{\max(M_{xpmax2}, M_{xpmax4})}{S_{xp}}$

$f_{bpx} = 24540$  psi

$F_{bpx} := \begin{cases} (F_{bpx1} \cdot 1.33) & \text{if TBC} = 1 \\ F_{bpx1} & \text{otherwise} \end{cases}$

$F_{bpx} = 25000$  psi

**Max Post/Stub Combined Stress:**

$f_{bpx2} := \max(M_{xpmax}, M_{xpmax3}) \cdot \frac{I_{xp}}{(I_{xp} + I_{st}) \cdot S_{xp}}$

$f_{bpx2} = 23085$  psi

$F_{bpx} = 25000$  psi

**Max Stub Stress:**

$f_{bst} := \max(M_{xpmax}, M_{xpmax3}) \cdot \frac{I_{st}}{(I_{xp} + I_{st}) \cdot S_{st}}$

$f_{bst} = 18858$  psi

$F_{bst} = 25000$  psi

**Calculation Results:**

$Int_{p1} := \max\left(\frac{f_{bpx}}{F_{bpx}}, \frac{f_{bpx2}}{F_{bpx}}, \frac{f_{bst}}{F_{bst}}\right)$


$Int_{p1} = 0.98$

$POSTS := \begin{cases} \text{"OK"} & \text{if } Int_{p1} \leq 1 \wedge \frac{\max(\Delta_{xp1}, \Delta_{xp2}, \Delta_{tot})}{\Delta_{allp}} \leq 1 \\ \text{"FAIL"} & \text{otherwise} \end{cases}$

$POSTS = \text{"OK"}$

<b>RICE</b> <b>ENGINEERING</b> Template: REI-MC-5707	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01H
			Engineer: IDB Sheet No: C1 B
			Date: 9/16/11 Rev:
			Chk By: Date:

Side Mount Anchorage	SHT C2
----------------------	-----------

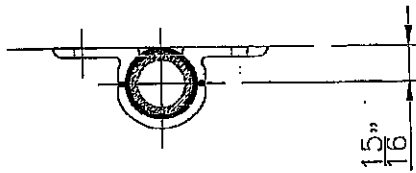

$$R_{max} := 250 \text{ lb}$$

$$M_{max} := 11750 \text{ lb-in}$$

$$L1 := 6 \text{ in}$$

$$L2 := 5.25 \text{ in}$$

**Chk Extruded Aluminum Bracket:**


$$P := \frac{M_{max}}{L1} + R_{max} \quad P = 2208 \text{ lb}$$

$$M_{pl} := \frac{P}{2} \cdot 0.688 \quad M_{pl} = 760 \text{ in-lb}$$

$$t_{req} := \sqrt{\frac{6 \cdot M_{pl}}{28000 \cdot L1 \cdot 0.85}} \quad t_{req} = 0.18 \text{ in}$$

$$I := \frac{t_{req}}{0.25} \quad I = 0.71$$

**Use Side Mount Bracket, As Shown**  
6105-T5 alloy

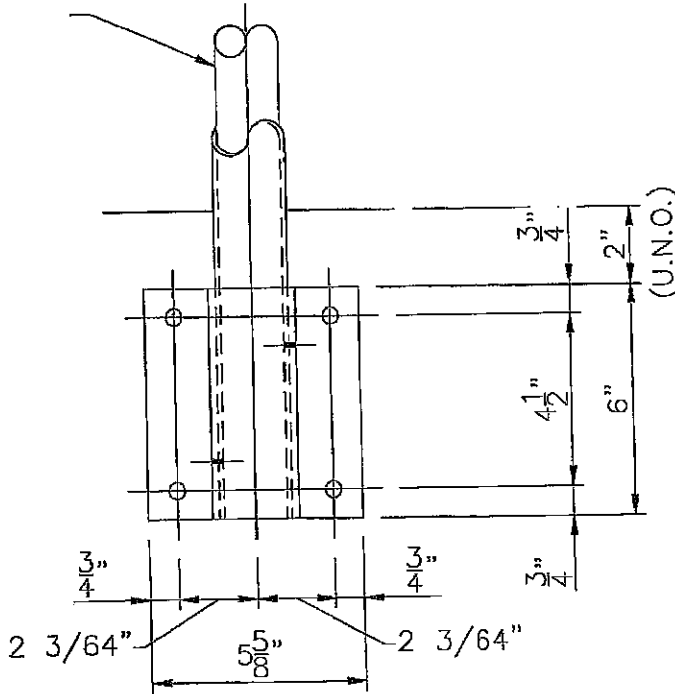

**Chk Anchor Bolts: (Assume  $f_c = 4000$  psi Conc.)**

$$V_b := \frac{R_{max}}{2} \cdot 1.6 \quad V_b = 200 \text{ lb}$$

$$T_b := \left( \frac{M_{max}}{L2 \cdot 1.085} + \frac{R_{max}}{2} \right) \cdot 1.6 \quad T_b = 4413 \text{ lb}$$

See Next Sheet for Calculation

**Use (4) - 1/2" Dia. S.S. Threaded Rods**  
**With Hilti HIT-RE 500 Epoxy Adhesive**  
Embedment = 4-1/2"  
Edge = 2-3/4"  
End = 3"

**Chk TEK Screws:**

$$V := \frac{R_{max}}{(2)} \quad V = 125 \text{ lb}$$

$$V_{all} := 2148 \cdot 0.333 \quad V_{all} = 715 \text{ lb}$$


$$I_2 := \left( \frac{V}{V_{all}} \right) \quad I_2 = 0.17 < 1.0$$

**Use (2) - #17 S.S. TEK Screws**  
300 Series S.S.

<b>RICE</b> ENGINEERING Template: REI-MC-5741	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01H	
			Engineer: JDB	Sheet No: C2
			Date: 9/16/11	Rev:
			Chk By:	Date:



Side Mount Anchorage	SHT C3
----------------------	--------




$$R_{max} := 250 \text{ lb}$$

$$M_{max} := 11750 \text{ lb-in}$$

$$L1 := 6 \text{ in}$$

$$L2 := 5.25 \text{ in}$$

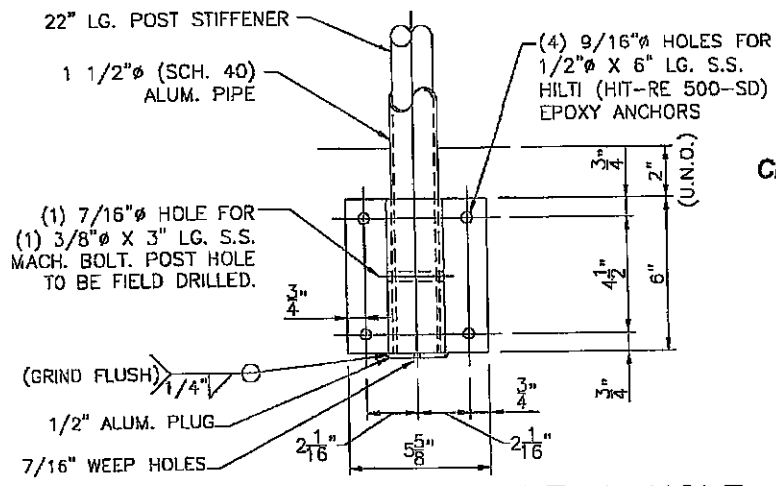

**Chk Extruded Aluminum Bracket:**

$$P := \frac{M_{max}}{L1} + R_{max} \quad P = 2208 \text{ lb}$$

$$M_{pl} := \frac{P}{2} \cdot 0.688 \quad M_{pl} = 760 \text{ in-lb}$$

$$t_{req} := \sqrt{\frac{6 \cdot M_{pl}}{28000 \cdot L1 \cdot 0.85}} \quad t_{req} = 0.18 \text{ in}$$

$$I := \frac{t_{req}}{0.25} \quad I = 0.71$$

**Use Side Mount Bracket, As Shown**  
6105-T5 alloy

**Chk Anchor Bolts: (Assume  $f_c = 4000$  psi Conc.)**

$$V_b := \frac{R_{max}}{2} \cdot 1.6 \quad V_b = 200 \text{ lb}$$

$$T_b := \left( \frac{M_{max}}{L2 \cdot 1.0.85} + \frac{R_{max}}{2} \right) \cdot 1.6 \quad T_b = 4413 \text{ lb}$$

**Chk Thru-Bolt:**

$$V := \frac{R_{max}}{(1)} \quad V = 250 \text{ lb}$$

$$V_{all} := 1614 \quad V_{all} = 1614 \text{ lb}$$

See Next Sheet for Calculation

$$I_2 := \left( \frac{V}{V_{all}} \right) \quad I_2 = 0.15 < 1.0$$

**Use (4) - 1/2" Dia. S.S. Threaded Rods**  
With Hilti HIT-RE 500 Epoxy Adhesive  
Embedment = 4-1/2"  
Edge = 2-3/4"  
End = 3"

**Use (1) - 3/8" Dia. S.S. Thru-Bolt**  
300 Series S.S.

<b>RICE</b> ENGINEERING Template: REI-MC-5741	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01H
			Engineer: JDB Sheet No: C3
			Date: 9/16/11 Rev:
			Chk By: Date:

www.hilti.us


 Company:  
 Specifier:  
 Address:  
 Phone | Fax: - | -  
 E-Mail:

 Page: 1  
 Project:  
 Sub-Project | Pos. No.:  
 Date: 9/16/2011

Specifier's comments:

**Input data**

<b>Anchor type and diameter:</b>	<b>HIT-RE 500-SD + HAS-R 304/316, 1/2</b>
<b>Effective embedment depth:</b>	$h_{e,act} = 4.500$ in. ( $h_{e,req} = -$ in.)
<b>Material:</b>	ASTM F 593
<b>Evaluation Service Report:</b>	ESR 2322
<b>Issued   Valid:</b>	4/1/2010   -
<b>Proof:</b>	design method ACI 318 / AC308
<b>Stand-off installation:</b>	$e_s = 0.000$ in. (no stand-off); $t = 0.500$ in.
<b>Anchor plate:</b>	$l_x \times l_y \times t = 3.000 \times 6.000 \times 0.500$ in. (Recommended plate thickness: not calculated)
<b>Profile:</b>	no profile
<b>Base material:</b>	uncracked concrete, 4000, $f'_c = 4000$ psi; $h = 8.000$ in., Temp. short/long: 32/32°F
<b>Installation:</b>	hammer drilled hole, installation condition: dry
<b>Reinforcement:</b>	tension: condition B, shear: condition B; no supplemental splitting reinforcement present edge reinforcement: none or < No. 4 bar
<b>Seismic loads (cat. C, D, E, or F):</b>	no

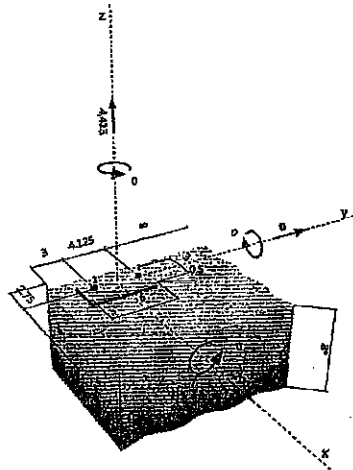**Geometry [in.] & Loading [lb, in.-lb]**

**Proof 1 Utilization (Governing Cases)**


Loading	Proof	Design values [lb]		Utilization [%]	Status
		Load	Capacity	$\beta_N/\beta_V$	
Tension	Concrete Breakout Strength	4413	4623	95 / -	OK
Shear	Concrete edge failure in direction y-	200	3893	- / 5	OK
Loading	$\beta_N$	$\beta_V$	$\zeta$	Utilization $\beta_{NVI}$ [%]	Status
Combined tension and shear loads	0.955	0.051	-	84	OK

**Warnings**

- Please consider all details and hints/warnings given in the detailed report!

**Fastening meets the design criteria!**

Side Mount Anchorage	SHT C4
-------------------------	-----------

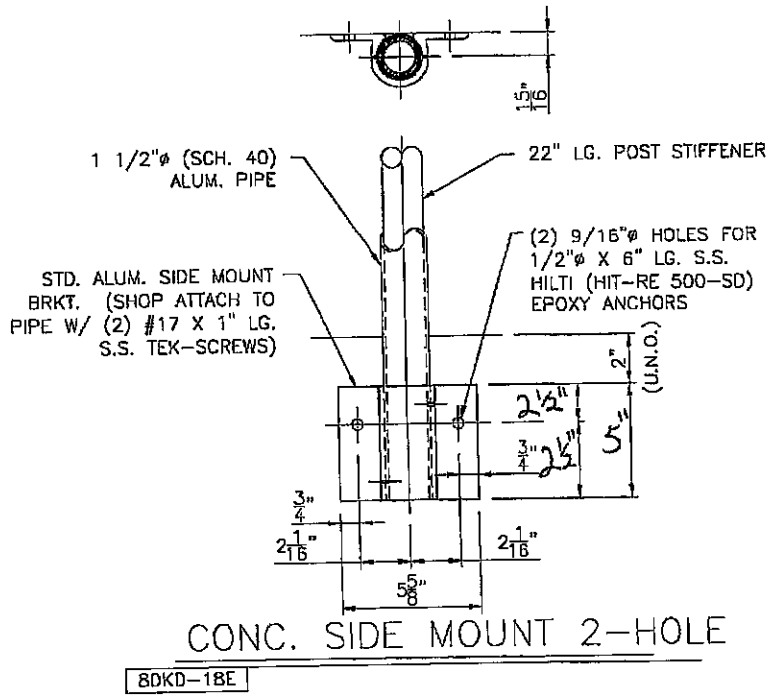

$$R_{max} := 170 \quad \text{lb}$$

$$M_{max} := R_{max} \cdot 47 = 7990 \quad \text{lb} \cdot \text{in}$$

$$L1 := 5 \quad \text{in}$$

$$L2 := 2.5 \quad \text{in}$$

**Chk Extruded Aluminum Bracket:**

$$P := \frac{M_{max}}{L1} + R_{max} \quad P = 1768 \quad \text{lb}$$

$$M_{pl} := \frac{P}{2} \cdot 0.688 \quad M_{pl} = 608 \quad \text{in} \cdot \text{lb}$$

$$t_{req} := \sqrt{\frac{6 \cdot M_{pl}}{28000 \cdot L1 \cdot 0.85}} \quad t_{req} = 0.18 \quad \text{in}$$

$$I := \frac{t_{req}}{0.25} \quad I = 0.7$$

**Use Side Mount Bracket, As Shown**  
6105-T5 alloy

**Chk Anchor Bolts: (Assume  $f_c = 4000$  psi Conc.)**

$$V_b := \frac{R_{max}}{1} \cdot 1.6 \quad V_b = 272 \quad \text{lb}$$

$$T_b := \left( \frac{M_{max}}{L2 \cdot 1 \cdot 0.85} + \frac{R_{max}}{1} \right) \cdot 1.6 \quad T_b = 6288 \quad \text{lb}$$

See Next Sheet for Calculation

**Use (2) - 1/2" Dia. S.S. Threaded Rods**  
With Hilti HIT-RE 500 Epoxy Adhesive  
Embedment = 4-1/2"  
Edge = 4-1/2"  
End = 4-1/8"

**Chk TEK Screws:**

$$V := \frac{R_{max}}{(2)} \quad V = 85 \quad \text{lb}$$

$$V_{all} := 2148 \cdot 0.333 \quad V_{all} = 715 \quad \text{lb}$$

$$I_2 := \left( \frac{V}{V_{all}} \right) \quad I_2 = 0.12 < 1.0$$

**Use (2) - #17 S.S. TEK Screws**  
300 Series S.S.

<b>RICE</b> ENGINEERING Template: REI-MC-5741	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01H	
			Engineer: JDB	Sheet No: C4
			Date: 9/16/11	Rev:
			Chk By:	Date:



www.hilti.us

Company:  
Specifier:  
Address:  
Phone | Fax: - | -  
E-Mail:


Page: 1  
Project:  
Sub-Project | Pos. No.:  
Date: 9/16/2011

Specifier's comments:

Input data

Anchor type and diameter: HIT-RE 500-SD + HAS-R 304/316, 1/2  
Effective embedment depth:  $h_{ef,act} = 4.500$  in. ( $h_{ef,min} = -$  in.)  
Material: ASTM F 593  
Evaluation Service Report: ESR 2322  
Issued | Valid: 4/1/2010 | -  
Proof: design method ACI 318 / AC308  
Stand-off installation:  $e_s = 0.000$  in. (no stand-off);  $t = 0.500$  in.  
Anchor plate:  $l_x \times l_y \times t = 3.000 \times 6.000 \times 0.500$  in. (Recommended plate thickness: not calculated)  
Profile: no profile  
Base material: uncracked concrete, 4000,  $f_c' = 4000$  psi;  $h = 8.000$  in., Temp. short/long: 32/32°F  
Installation: hammer drilled hole, installation condition: dry  
Reinforcement: tension: condition B, shear: condition B; no supplemental splitting reinforcement present  
edge reinforcement: none or < No. 4 bar  
Seismic loads (cat. C, D, E, or F): no

Geometry [in.] & Loading [lb, in.-lb]

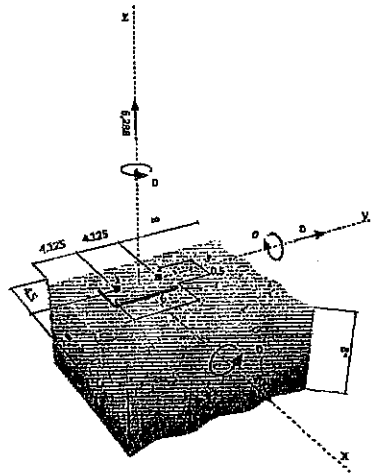

Proof I Utilization (Governing Cases)


Loading	Proof	Design values [lb]		Utilization [%]		Status
		Load	Capacity	$\beta_N/\beta_V$		
Tension	Concrete Breakout Strength	6288	6358	99 / -		OK
Shear	Concrete edge failure in direction y-	200	6729	- / 3		OK
Loading	$\beta_N$	$\beta_V$	$\zeta$	Utilization $\beta_{N,V}$ [%]		Status
Combined tension and shear loads	0.989	0.030	-	85		OK

Warnings

- Please consider all details and hints/warnings given in the detailed report!

**Fastening meets the design criteria!**

C4A

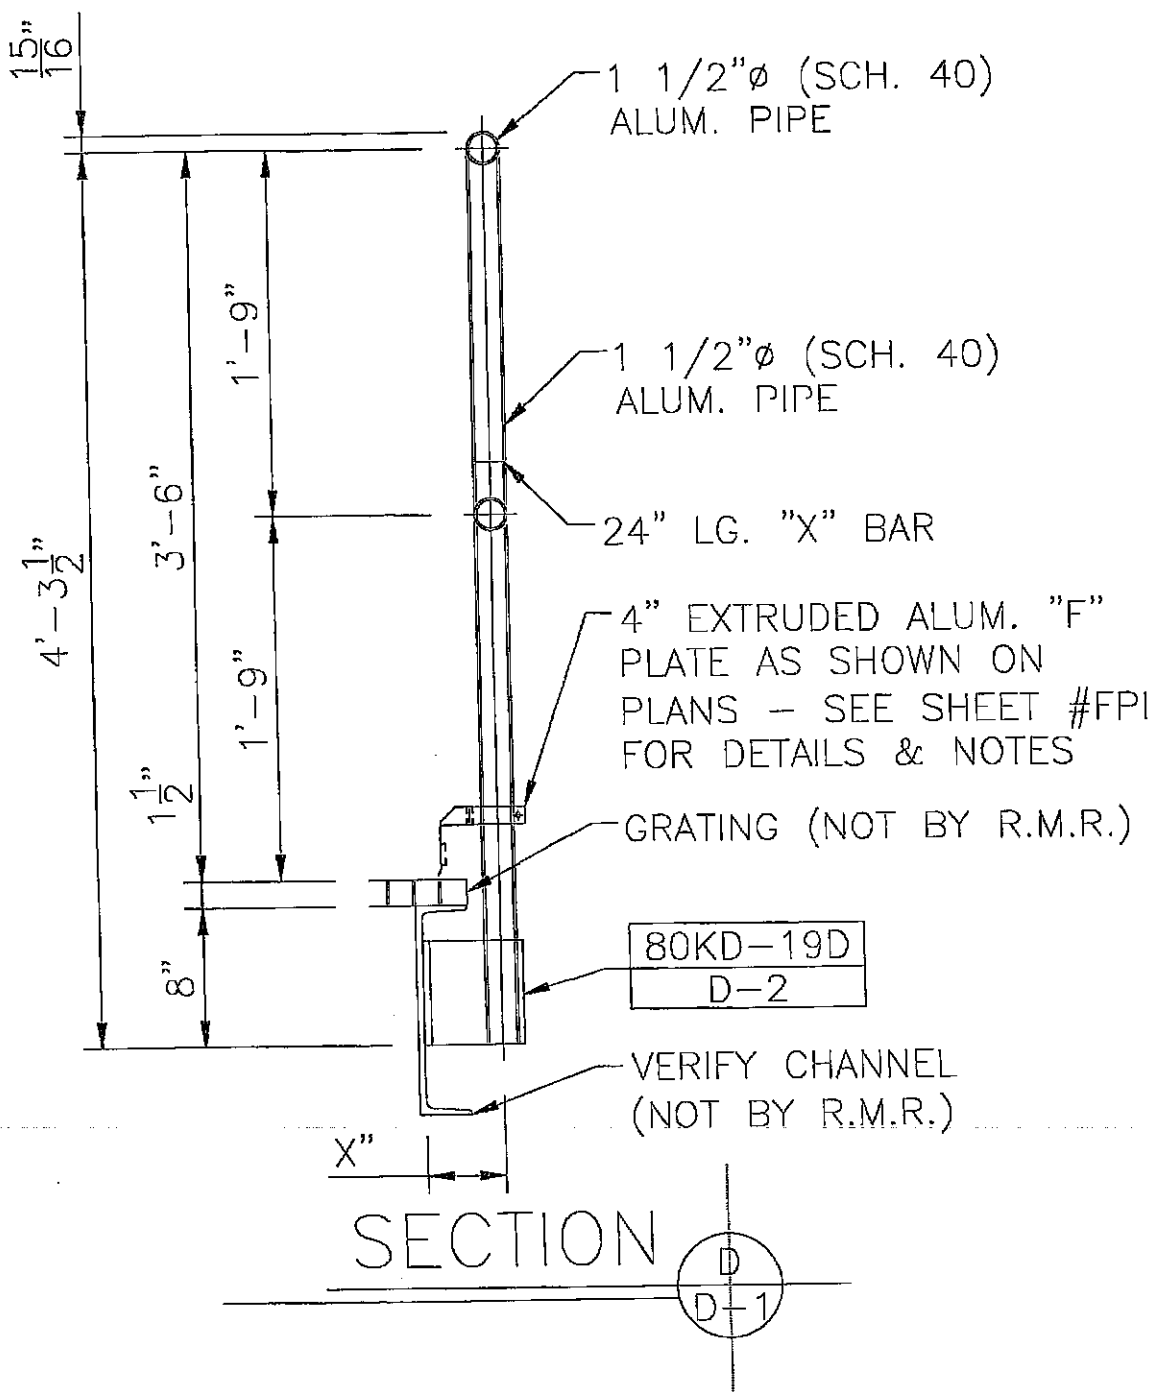

**Note:** Structural steel, Concrete, CMU and all other anchorage substrates designed by others



ROCKY MOUNTAIN RAILINGS

<b>RICE</b> ENGINEERING Template: RHI-MC-5707	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01H Engineer: JDB Date: 9/16/11 Chk By:	Sheet No: D Rev: Date:
---	---	---	---	------------------------------

# Pipe Railing & Post

These calculations are based on empirical test data performed by Julius Blum & Co., Inc.

Guardrail "D" Analysis

SHT  
D1

## Input Variables:

- $F_H := 50$  plf Load Case 1 (Uniform Load)  
 $F_V := 0$  plf Simultaneous Vertical Uniform Load  
 $P := 200$  lb Load Case 2 (Point Load)  
 $L_{bp} := 30.5$  in Unbraced Length of Post  
 $h := 48.5$  in Railing Height  
 $L := 60$  in **5'-0" MAX POST SPACING**

## Number of Railing Spans:

- 1 span  
 2 span  
 3 or more spans

## Railing Section:

- 1 1/4" Schd. 40  
 1 1/4" Schd. 80  
 1 1/2" Schd. 40  
 1 1/2" Schd. 80  
 1 1/2" tube  
 2" Schd. 40  
 2" Schd. 80

## Railing Temper:


- 6063-T5  
 6063-T6  
 6061-T6 or 6105-T5  
 4/3 increase allowed

## Post Section:

- 1 1/4" Schd. 40  
 1 1/4" Schd. 80  
 1 1/2" Schd. 40  
 1 1/2" Schd. 80  
 1 1/2" tube  
 2" Schd. 40  
 2" Schd. 80

## Post Temper:

- 6063-T6  
 6005-T5  
 6061-T6 or 6105-T5  
 Post Welded to Base Plate

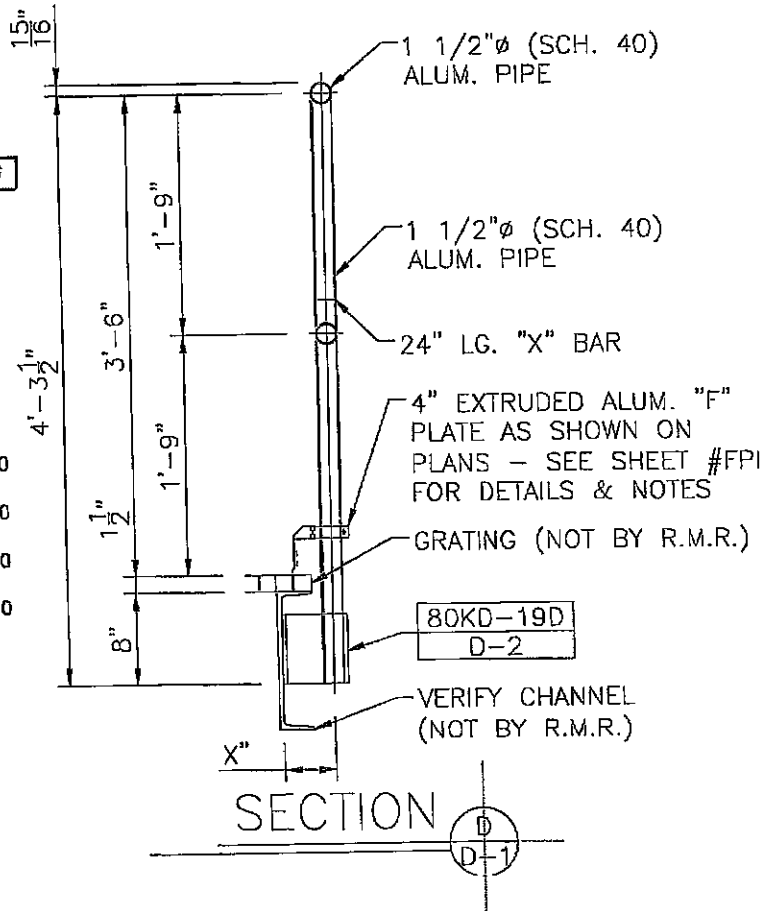

All calculations below this line are automatic

## Railing Properties

$k_x$	0.31
$k_y$	0.31
$S_{x_r}$	0.326
$S_{y_r}$	0.326
$R$	0.95
$t$	0.145

$E_r := 10100000$  psi

$I_{xtot} := I_x$   $I_{xtot} = 0.31$  in<sup>4</sup>

$I_{ytot} := I_y$   $I_{ytot} = 0.31$  in<sup>4</sup>

## Post Properties

$k_x$	0.31
$k_y$	0.31
$S_{x_r}$	0.326
$S_{y_r}$	0.326
$R$	0.95
$t$	0.145

$I_{xtot} := I_x$   $I_{xtot} = 0.31$  in<sup>4</sup>

$I_{ytot} := I_y$   $I_{ytot} = 0.31$  in<sup>4</sup>

## Computational Factors

$S_{R1} := \frac{R_r}{t_r}$   $S_{R1} = 6.55$   $K_1 := (8 \cdot q_1) + (8 \cdot q_2) + (9.5 \cdot q_3)$   $K_1 = 8$   
 $S_{R3} := \frac{R_p}{t_p}$   $S_{R3} = 6.55$   $K_2 := (4 \cdot q_1) + (5 \cdot q_2) + (5 \cdot q_3)$   $K_2 = 5$   
 $K_3 := (48 \cdot q_1) + (66 \cdot q_2) + (87 \cdot q_3)$   $K_3 = 66$

## 19" Min. Length AL. Ribbed Tube Stub

$I_{st} := 0.249$  in<sup>4</sup>  $L_{st} := 16$  in  
 $S_{st} := 0.249$  in<sup>3</sup>  $F_{bst} := 25000$  psi

**RICE**  
ENGINEERING  
Template: REI-MC-5707

105 School Creek Trail  
Luxemburg, WI 54217  
Phone: (920)845-1042  
Fax: (920)845-1048  
www.rice-inc.com

Project Description:  
R1843 Austin WTP #4

Job No:	R11-09-01H	
Engineer:	JDB	Sheet No: D1
Date:	9/16/11	Rev:
Chk By:		Date:

# Railing Analysis:

$$W_H := \frac{F_H}{12}$$

$$W_V := \frac{F_V}{12}$$

Guardrail "D" Analysis

SHT  
D1 A

## Case 1 Uniform Load:

$$\Delta_{yr1} := \frac{5 \cdot W_H \cdot L^4}{384 \cdot E_r \cdot I_{ytotr}}$$

$$\Delta_{yr1} = 0.225 \quad \text{in} \quad \text{Modeled as a simple span}$$

$$\Delta_{xr1} := \frac{5 \cdot W_V \cdot L^4}{384 \cdot E_r \cdot I_{xtotr}}$$

$$\Delta_{xr1} = 0 \quad \text{in}$$

$$\Delta_{allr} := \frac{L}{96}$$

$$\Delta_{allr} = 0.63 \quad \text{in} \quad \text{Per ASTM Specification E985}$$

$$M_{yrmax} := \frac{W_H \cdot L^2}{K_1}$$

$$M_{yrmax} = 1875 \quad \text{lb-in}$$

$$M_{xrmax} := \frac{W_V \cdot L^2}{K_1}$$

$$M_{xrmax} = 0 \quad \text{lb-in}$$

$$f_{bry1} := \frac{M_{yrmax}}{S_{yr}}$$

$$f_{bry1} = 5752 \quad \text{psi}$$

$$f_{brx1} := \frac{M_{xrmax}}{S_{xr}}$$

$$f_{brx1} = 0 \quad \text{psi}$$

## Case 2 - Point Load:

$$\Delta_{yr2} := \frac{P \cdot L^3}{K_3 \cdot E_r \cdot I_{ytotr}}$$

$$\Delta_{yr2} = 0.209 \quad \text{in}$$

$$M_{yrmax2} := \frac{P \cdot L}{K_2}$$

$$M_{yrmax2} = 2400 \quad \text{lb-in}$$

$$f_{bry2} := \frac{M_{yrmax2}}{S_{yr}}$$

$$f_{bry2} = 7362 \quad \text{psi}$$

$$F_{bry} := \begin{cases} (F_{bry1} \cdot 1.33) & \text{if IBC} = 1 \\ F_{bry1} & \text{otherwise} \end{cases}$$

$$F_{bry} = 25000 \quad \text{psi}$$

## Calculation Results:

$$Int_1 := \left( \frac{f_{brx1}}{F_{bry}} \right) + \left( \frac{f_{bry1}}{F_{bry}} \right)$$

$$Int_1 = 0.23$$

$$Int_2 := \frac{f_{bry2}}{F_{bry}}$$

$$Int_2 = 0.29$$

$$RAILS := \begin{cases} \text{"OK"} & \text{if } \frac{\max(\Delta_{yr1}, \Delta_{xr1}, \Delta_{yr2})}{\Delta_{allr}} \leq 1 \wedge \left( \frac{f_{brx1}}{F_{bry}} \right) + \left( \frac{f_{bry1}}{F_{bry}} \right) \leq 1 \wedge \frac{f_{bry2}}{F_{bry}} \leq 1 \\ \text{"FAIL"} & \text{otherwise} \end{cases}$$

RAILS = "OK"

<b>RICE</b> <b>ENGINEERING</b> Template: REL-MC-5707	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01H
		Engineer: JDB	Sheet No: D1 A
		Date: 9/16/11	Rev:
		Chk By:	Date:

**Post Analysis:**

$E_p := E_r$

Guardrail "D" Analysis	SHT D1 B
------------------------	-------------

$\Delta_{xp1} := \frac{W_h \cdot L \cdot (h - L_{st})^3}{3 \cdot E_p \cdot (I_{xp})}$

$\Delta_{xp1} = 0.914$  in

$\Delta_{xp2} := \frac{P \cdot 0.85 \cdot (h - L_{st})^3}{3 \cdot E_p \cdot (I_{xp})}$

$\Delta_{xp2} = 0.621$  in

**Max Deflection:**

$\Delta_{tot} := \frac{W_h \cdot L \cdot (h - L_{st})^3}{3 \cdot E_p \cdot I_{xp}} + \frac{W_h \cdot L \cdot [h^3 - (h - L_{st})^3]}{3 \cdot [(E_p \cdot I_{xp}) + (E_p \cdot I_{st})]}$

$\Delta_{tot} = 2.091$  in

$\Delta_{allp} := \frac{h}{12}$

$\Delta_{allp} = 4.04$  in Per ASTM Specification E985

**Case 1 - Uniform Load:**

$M_{xp} := (W_h \cdot L \cdot h) + W_v \cdot L \cdot \Delta_{tot}$

$M_{xpm1} := 0.5 \cdot M_{xp} \cdot q1 + M_{xp} \cdot q2 + M_{xp} \cdot q3$

$M_{xpm1} = 12125$  lb-in

$M_{xp2} := W_h \cdot L \cdot (h - L_{st}) + W_v \cdot L \cdot \Delta_{xp1}$

$M_{xpm2} := 0.5 \cdot M_{xp2} \cdot q1 + M_{xp2} \cdot q2 + M_{xp2} \cdot q3$

$M_{xpm2} = 8125$  lb-in

**Case 2 - Point Load:**

$M_{xpm4} := P \cdot (h - L_{st}) \cdot 0.85$

$M_{xpm4} = 5525$  lb-in

$M_{xpm3} := (P \cdot h \cdot 0.85)$

$M_{xpm3} = 8245$  lb-in

**Max Post Stress:**

$f_{bpx} := \frac{\max(M_{xpm2}, M_{xpm4})}{S_{xp}}$

$f_{bpx} = 24923$  psi

$F_{bpx} := \begin{cases} (F_{bpx1} \cdot 1.33) & \text{if IBC} = 1 \\ F_{bpx1} & \text{otherwise} \end{cases}$

$F_{bpx} = 25000$  psi

**Max Post/Stub Combined Stress:**

$f_{bpx2} := \max(M_{xpm1}, M_{xpm3}) \cdot \frac{I_{xp}}{(I_{xp} + I_{st}) \cdot S_{xp}}$

$f_{bpx2} = 20626$  psi

$F_{bpx} = 25000$  psi

**Max Stub Stress:**

$f_{bst} := \max(M_{xpm1}, M_{xpm3}) \cdot \frac{I_{st}}{(I_{xp} + I_{st}) \cdot S_{st}}$

$f_{bst} = 21691$  psi

$F_{bst} = 25000$  psi

**Calculation Results:**

$Intp1 := \max\left(\frac{f_{bpx}}{F_{bpx}}, \frac{f_{bpx2}}{F_{bpx}}, \frac{f_{bst}}{F_{bst}}\right)$


$Intp1 = 1$

$POSTS := \begin{cases} \text{"OK"} & \text{if } Intp1 \leq 1 \wedge \frac{\max(\Delta_{xp1}, \Delta_{xp2}, \Delta_{tot})}{\Delta_{allp}} \leq 1 \\ \text{"FAIL"} & \text{otherwise} \end{cases}$

$POSTS = \text{"OK"}$

<b>RICE</b> ENGINEERING Template: REI-MC-5707	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01H
			Engineer: JDB Sheet No: D1 B
			Date: 9/16/11 Rev:
			Chk By: Date:



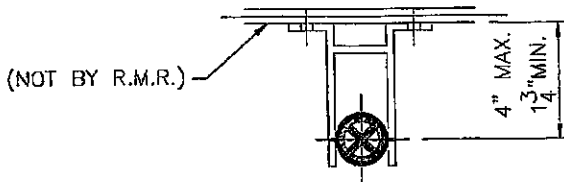


Side Mount Anchorage	SHT D2
----------------------	-----------

$$R_{max} := 250 \text{ lb}$$

$$M_{max} := 12125 \text{ lb-in}$$

$$L1 := 6 \text{ in}$$

$$L2 := 5 \text{ in}$$

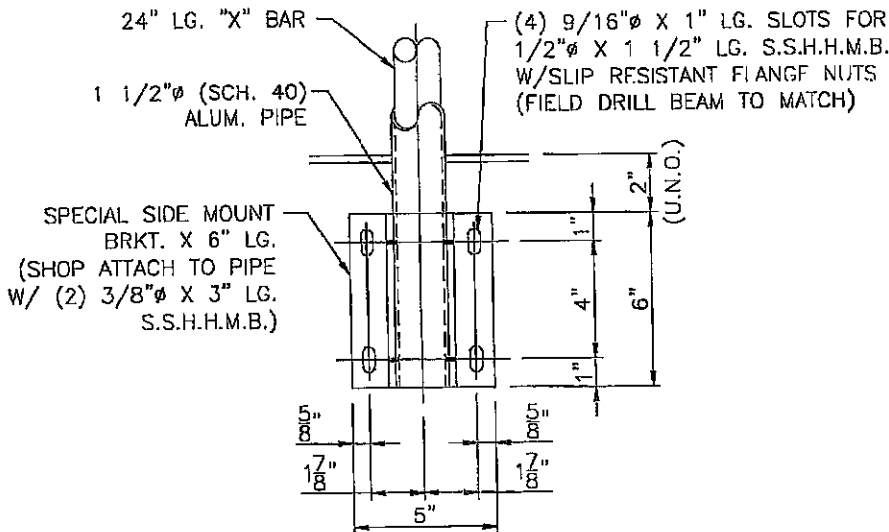

### SPECIAL SIDE MOUNT 4-HOLE

80KD-19D

#### Chk Post Attachment to Bracket:

$$V := \frac{M_{max}}{4 \cdot (1)} + \frac{R_{max}}{(2)} \quad V = 3156 \text{ lb}$$

$$V_{all} := 0.110 \cdot 23000 \cdot (2) \quad V_{all} = 5060 \text{ lb}$$

**Use (2) - 3/8" Dia. S.S. Thru-Bolts @ 4" O.C.**  
300 Series S.S.

#### Chk Anchor Bolts:

$$V_b := \frac{R_{max}}{4} \quad V_b = 63 \text{ lb}$$

$$T_b := \frac{M_{max}}{L2 \cdot 2} + \frac{R_{max}}{4} \quad T_b = 1275 \text{ lb}$$

$$V_{all} := 0.196 \cdot 23000 \quad V_{all} = 4508 \text{ lb}$$

$$T_{all} := 0.142 \cdot 40000 \cdot \frac{0.1875}{0.456} \quad T_{all} = 2336 \text{ lb}$$

$$I := \left( \frac{V_b}{V_{all}} \right)^2 + \left( \frac{T_b}{T_{all}} \right)^2 \quad I = 0.3 < 1.0$$

**Use (4) - 1/2" Dia. S.S. Thru Bolts**  
**(or Drill & Tap - 3/16" Min. Thread Engagement)**  
Cond "CW", Fy= 65 ksi minimum  
Steel Stringers Designed By Others

#### Chk Extruded Aluminum Bracket:

$$P := \frac{M_{max}}{L1} + R_{max} \quad P = 2271 \text{ lb}$$

$$M_{pl} := \frac{P}{2} \cdot 0.8125 \quad M_{pl} = 923 \text{ in-lb}$$

$$t_{req} := \sqrt{\frac{6 \cdot M_{pl}}{28000 \cdot L1 \cdot 0.85}} \quad t_{req} = 0.2 \text{ in}$$

$$I := \frac{t_{req}}{0.25} \quad I = 0.79$$

**Use Side Mount Bracket, As Shown**  
6105-T5 alloy

<b>RICE</b> ENGINEERING Template: REI-MC-5741	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01H	
			Engineer: JDB	Sheet No: D2
			Date: 9/16/11	Rev:
			Chk By:	Date:

# Pipe Railing & Post

These calculations are based on empirical test data performed by Julius Blum & Co., Inc.

Guardrail "K" Analysis	SHT K1
------------------------	-----------

## Input Variables:

- F<sub>H</sub> := 50 plf Load Case 1 (Uniform Load)
- F<sub>V</sub> := 0 plf Simultaneous Vertical Uniform Load
- P := 200 lb Load Case 2 (Point Load)
- L<sub>bp</sub> := 14 in Unbraced Length of Post
- h := 42 in Railing Height
- L := 53 in 4'-5" MAX POST SPACING \*

## Number of Railing Spans:

- 1 span
- 2 span
- 3 or more spans

## Railing Section:

- 1 1/4" Schd. 40
- 1 1/4" Schd. 80
- 1 1/2" Schd. 40
- 1 1/2" Schd. 80
- 1 1/2" tube
- 2" Schd. 40
- 2" Schd. 80

## Post Section:


- 1 1/4" Schd. 40
- 1 1/4" Schd. 80
- 1 1/2" Schd. 40
- 1 1/2" Schd. 80
- 1 1/2" tube
- 2" Schd. 40
- 2" Schd. 80

## Railing Temper:

- 6063-T5
- 6063-T6
- 6061-T6 or 6105-T5
- 4/3 increase allowed

## Post Temper:

- 6063-T6
- 6005-T5
- 6061-T6 or 6105-T5
- Post Welded to Base Plate

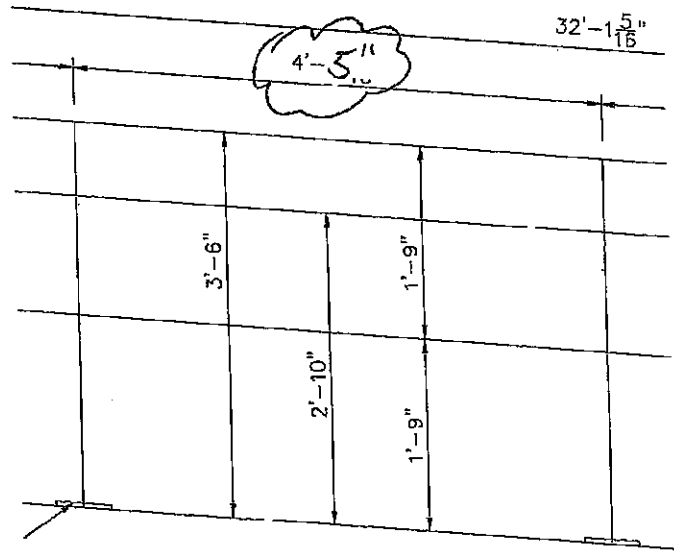

All calculations below this line are automatic

## Railing Properties

I <sub>xr</sub>	0.31
I <sub>yr</sub>	0.31
S <sub>xr</sub>	0.326
S <sub>yr</sub>	0.326
R	0.95
t	0.145

## Post Properties

I <sub>xr</sub>	0.31
I <sub>yr</sub>	0.31
S <sub>xr</sub>	0.326
S <sub>yr</sub>	0.326
R	0.95
t	0.145

## Computational Factors

$SR1 = \frac{R_r}{t_r}$	SR1 = 6.55	$K1 = (8 \cdot q1) + (8 \cdot q2) + (9.5 \cdot q3)$	K1 = 8
$SR3 = \frac{R_p}{t_p}$	SR3 = 6.55	$K2 = (4 \cdot q1) + (5 \cdot q2) + (5 \cdot q3)$	K2 = 5
		$K3 = (48 \cdot q1) + (66 \cdot q2) + (87 \cdot q3)$	K3 = 66

E<sub>r</sub> := 10100000 psi

I <sub>xotr</sub> := I <sub>xr</sub>	I <sub>xotr</sub> = 0.31 in <sup>4</sup>	I <sub>xotp</sub> := I <sub>xp</sub>	I <sub>xotp</sub> = 0.31 in <sup>4</sup>
I <sub>yotr</sub> := I <sub>yr</sub>	I <sub>yotr</sub> = 0.31 in <sup>4</sup>	I <sub>yotp</sub> := I <sub>yp</sub>	I <sub>yotp</sub> = 0.31 in <sup>4</sup>

## 1.59" Dia. x 6" Long Alum. Rod Properties

I <sub>st</sub> := 0.314 in <sup>4</sup>	I <sub>bst</sub> := 6 in
S <sub>st</sub> := 0.395 in <sup>3</sup>	F <sub>bst</sub> := 16000 psi

<b>RICE</b> ENGINEERING Template: REI-MC-5707	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01H
			Engineer: JDB Sheet No: K1
			Date: 9/16/11 Rev:
			Chk By: Date:

**Railing Analysis:** NOTE: Rail Check is based on 6' post spacing and is conservative

Guardrail "K" Analysis	SHT
	K1 A

**Case 1 Uniform Load:**

$$W_h := \frac{F_H}{12}$$

$$W_v := \frac{F_v}{12}$$

$$\Delta_{yr1} := 1.303 \text{ in} \quad \text{horizontal load - Per RISA Model}$$

$$\Delta_{yr1} = 1.303 \text{ in} \quad \text{Modeled as a simple span}$$

$$\Delta_{ally} := \frac{L}{96} + \frac{h}{24}$$

$$\Delta_{ally} = 2.3 \text{ in} \quad \text{Per ASTM Specification E985}$$

$$\Delta_{xr1} := 0.393 \text{ in} \quad \text{vertical load - Per RISA Model}$$

$$\Delta_{xr1} = 0.39 \text{ in}$$

$$\Delta_{allrx} := \frac{L}{96}$$

$$\Delta_{allrx} = 0.55 \text{ in} \quad \text{Per ASTM Specification E985}$$

$$M_{yrmax} := \frac{W_h \cdot L^2}{K_1}$$

$$M_{yrmax} = 1463 \text{ lb-in}$$

$$M_{xrmax} := 5447 \text{ Per RISA Model}$$

$$M_{xrmax} = 5447 \text{ lb-in}$$

$$f_{bry1} := \frac{M_{yrmax}}{S_{yr}}$$

$$f_{bry1} = 4488 \text{ psi}$$

$$f_{brx1} := \frac{M_{xrmax}}{S_{xr}}$$

$$f_{brx1} = 16709 \text{ psi}$$

**Case 2 - Point Load:**

$$\Delta_{yr2} := \frac{P \cdot L^3}{K_3 \cdot E_r \cdot I_{ytotr}}$$

$$\Delta_{yr2} = 0.144 \text{ in}$$

$$M_{yrmax2} := \frac{P \cdot L}{K_2}$$

$$M_{yrmax2} = 2120 \text{ lb-in}$$

$$f_{bry2} := \frac{M_{yrmax2}}{S_{yr}}$$

$$f_{bry2} = 6503 \text{ psi}$$

$$F_{bry} := \begin{cases} (f_{bry1} \cdot 1.33) & \text{if IBC} = 1 \\ f_{bry1} & \text{otherwise} \end{cases}$$

$$F_{bry} = 25000 \text{ psi}$$

**Calculation Results:**

$$Int_1 := \left( \frac{f_{brx1}}{F_{bry}} \right) + \left( \frac{f_{bry1}}{F_{bry}} \right)$$

$$Int_1 = 0.85$$

$$Int_2 := \frac{f_{bry2}}{F_{bry}}$$

$$Int_2 = 0.26$$

$$RAILS := \begin{cases} \text{"OK"} & \text{if } \frac{\max(\Delta_{xr1}, \Delta_{yr2})}{\Delta_{allrx}} \wedge \frac{\Delta_{yr1}}{\Delta_{ally}} \leq 1 \wedge \left( \frac{f_{brx1}}{F_{bry}} \right) + \left( \frac{f_{bry1}}{F_{bry}} \right) \leq 1 \wedge \frac{f_{bry2}}{F_{bry}} \leq 1 \\ \text{"FAIL"} & \text{otherwise} \end{cases}$$

$$RAILS = \text{"OK"}$$

<b>RICE</b> <b>ENGINEERING</b> Template: REL-MC-5707	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:	Job No:	R11-09-01H		
		R1843 Austin WTP #4	Engineer:	JDB	Sheet No: K1 A	
			Date:	9/16/11	Rev:	
			Chk By:		Date:	

**Post Analysis:**

$E_p := E_r$

Guardrail "K" Analysis	SHT
	K1 B

$$\Delta_{xp1} := \frac{W_h \cdot L \cdot (h - L_{st})^3}{3 \cdot E_p \cdot I_{xp}}$$

$\Delta_{xp1} = 1.097$  in

$$\Delta_{xp2} := \frac{P \cdot 0.85 \cdot (h - L_{st})^3}{3 \cdot E_p \cdot I_{xp}}$$

$\Delta_{xp2} = 0.844$  in

**Max Deflection:**

$$\Delta_{tot} := \frac{W_h \cdot L \cdot (h - L_{st})^3}{3 \cdot E_p \cdot I_{xp}} + \frac{W_h \cdot L \cdot [h^3 - (h - L_{st})^3]}{3 \cdot [(E_p \cdot I_{xp}) + (E_p \cdot I_{st})]}$$

$\Delta_{tot} = 1.417$  in

$$\Delta_{allp} := \frac{h}{12}$$

$\Delta_{allp} = 3.5$  in Per ASTM E985

**Case 1 - Uniform Load:**

$$M_{xp} := (W_h \cdot L \cdot h) + W_v \cdot L \cdot \Delta_{tot}$$

$$M_{xpmax} := 0.5 \cdot M_{xp} \cdot q1 + M_{xp} \cdot q2 + M_{xp} \cdot q3$$

$M_{xpmax} = 9275$  lb-in

$$M_{xp2} := W_h \cdot L \cdot (h - L_{st}) + W_v \cdot L \cdot \Delta_{xp1}$$

$$M_{xpmax2} := 0.5 \cdot M_{xp2} \cdot q1 + M_{xp2} \cdot q2 + M_{xp2} \cdot q3$$

$M_{xpmax2} = 7950$  lb-in

**Case 2 - Point Load:**

$$M_{xpmax4} := P \cdot (h - L_{st}) \cdot 0.85$$

$M_{xpmax4} = 6120$  lb-in

$$M_{xpmax3} := (P \cdot h \cdot 0.85)$$

$M_{xpmax3} = 7140$  lb-in

**Max Post Stress:**

$$f_{bpx} := \frac{\max(M_{xpmax2}, M_{xpmax4})}{S_{xp}}$$

$f_{bpx} = 24387$  psi

$$F_{bpxw} := \begin{cases} (F_{bpx1} \cdot 1.33) & \text{if IBC} = 1 \\ F_{bpx1} & \text{otherwise} \end{cases}$$

$F_{bpx} = 25000$  psi

**Max Post/Stub Combined Stress:**

$$f_{bpx2} := \max(M_{xpmax}, M_{xpmax3}) \cdot \frac{I_{xp}}{(I_{xp} + I_{st}) \cdot S_{xp}}$$

$f_{bpx2} = 14134$  psi

$F_{bpxw} = 14000$  psi

**Max Stub Stress:**

$$f_{bst} := \max(M_{xpmax}, M_{xpmax3}) \cdot \frac{I_{st}}{(I_{xp} + I_{st}) \cdot S_{st}}$$

$f_{bst} = 11816$  psi

$F_{bst} = 16000$  psi

**Calculation Results:**

$$Intp1 := \max\left(\frac{f_{bpx}}{F_{bpx}}, \frac{f_{bpx2}}{F_{bpxw}}, \frac{f_{bst}}{F_{bst}}\right)$$

$Intp1 = 1.01$  1% Over OK


$$POSTS := \begin{cases} \text{"OK"} & \text{if } Intp1 \leq 1.02 \wedge \frac{\max(\Delta_{xp1}, \Delta_{xp2}, \Delta_{tot})}{\Delta_{allp}} \leq 1 \\ \text{"FAIL"} & \text{otherwise} \end{cases}$$

POSTS = "OK"

<b>RICE</b> <b>ENGINEERING</b> Template: REI-MC-5707	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01H
			Engineer: JDB Sheet No: K1 B
			Date: 9/16/11 Rev:
			Chk By: Date:

$R_{max} := 221 \text{ lb}$   
 $M_{max} := 9275 \cdot \cos(5\text{deg}) = 9240 \text{ lb-in}$

Raked 4 Bolt Base Plate	SHT K2
----------------------------	-----------

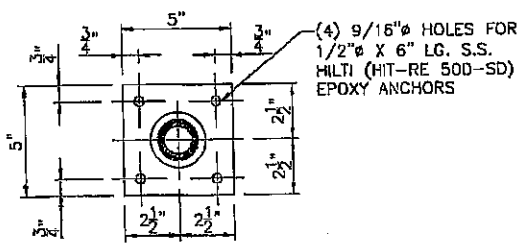

$I_{xp} := 0.310 \text{ in}^4 \text{ Post}$   
 $I_{st} := 0.249 \text{ in}^4 \text{ Stub}$   
 $M_{max1} := M_{max} \cdot \frac{I_{xp}}{I_{xp} + I_{st}} \quad M_{max1} = 5124 \text{ in-lb}$   
 $M_{max2} := M_{max} \cdot \frac{I_{st}}{I_{xp} + I_{st}} \quad M_{max2} = 4116 \text{ in-lb}$

**Chk weld to base plate:**


$t_{w2} := 0.3125 \text{ in (thickness of weld)}$   
 $d_2 := 1.9 \text{ in (post diameter)}$   
 $r_{w2} := 0.5d_2 + 0.5 \cdot (0.707 \cdot t_{w2}) \text{ in (radius of weld)}$   
 $A_{w2} := 0.707 t_{w2} \cdot (2 \cdot \pi \cdot r_{w2}) \quad A_{w2} = 1.47 \text{ in}^2$   
 $S_{w2} := 0.707 t_{w2} \cdot (\pi \cdot r_{w2}^2) \quad S_{w2} = 0.78 \text{ in}^3$   
 $f_{w2} := \frac{M_{max1}}{S_{w2}} \quad f_{w2} = 6564 \text{ psi}$   
 $R_{w2} := 7000 \text{ psi}$

**Use 5/16" fillet weld all around  
5356 filler alloy**

**Chk weld to base plate:**

$t_{w} := 0.25 \text{ in (thickness of weld)}$   
 $d := 1.09 \text{ in}$   
 $r_w := 0.5d + 0.5 \cdot (t_w) \text{ in (radius of weld)}$   
 $V := R_{max}$   
 $A_w := t_w \cdot (2 \cdot \pi \cdot r_w) \quad A_w = 1.05 \text{ in}^2$   
 $S_w := t_w \cdot (\pi \cdot r_w^2) \quad S_w = 0.35 \text{ in}^3$   
 $T := \frac{M_{max2}}{d} \quad T = 3776 \text{ lb}$   
 $f_w := \sqrt{\left(\frac{V}{A_w}\right)^2 + \left(\frac{T}{A_w \cdot 0.5}\right)^2} \quad f_w = 7179 \text{ psi}$   
 $R_w := 7000 \text{ psi}$   
 3% Over OK

**Use 1/4" thk Groove weld all around  
5356 filler alloy**

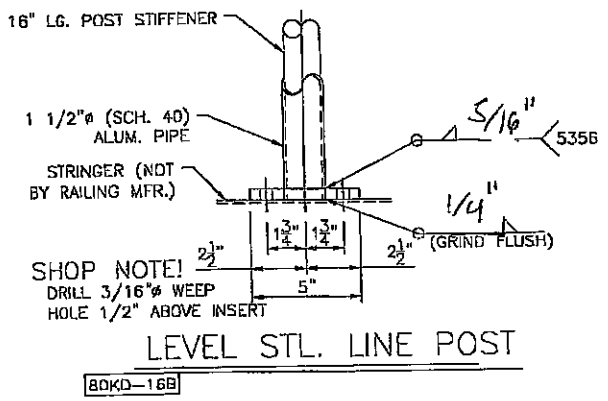

**Chk Aluminum Base Plate:**

$L1 := 5 \text{ in} \quad D1 := 0.75 \text{ in}$   
 $L2 := 5 \text{ in} \quad D2 := 0.75 \text{ in}$   
 assume load is in the direction of L2  
 $L := L2 - (2 \cdot D2)$   
 $A := \frac{L - 1.9}{2} \quad A = 0.8 \text{ in}$   
 $B := L - A \quad B = 2.7 \text{ in}$   
 $P := \frac{M_{max}}{d} \quad P = 8477 \text{ lb}$   
 $M_{pl} := \frac{P \cdot A \cdot B^2}{L^2} \quad M_{pl} = 4036 \text{ in-lb}$   
 $t_{req} := \sqrt{\frac{M_{pl} \cdot 6}{16000 \cdot L1}} \quad t_{req} = 0.55 \text{ in} \quad 5\% \text{ Over OK}$

**Use 1/2" x 5" x 5" AL Plate  
6061-T6 alloy**


**Chk Anchor Bolts (assume f'c=4,000 psi conc.):**

$V_b := \frac{V}{2} \cdot 1.6 \quad V_b = 177 \text{ lb}$   
 $T_b := \frac{M_{max}}{(L2 - D2) \cdot 0.85} \cdot 1.6 \quad T_b = 4092 \text{ lb}$

**Use (4) - 1/2" Dia. S.S. Threaded Rods  
With Hilti HIT-RE 500 Epoxy Adhesive  
Embedment = 4-1/2"  
Edge = 3-1/4" End = 3-1/4"  
Previously Checked with Higher Loads on Sht B3**


<b>RICE</b> ENGINEERING Template:	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01H
			Engineer: JDB Sheet No: K2
			Date: 9/16/11 Rev:
			Chk By: Date:

Miscellaneous Connections	SHT M1
---------------------------	-----------

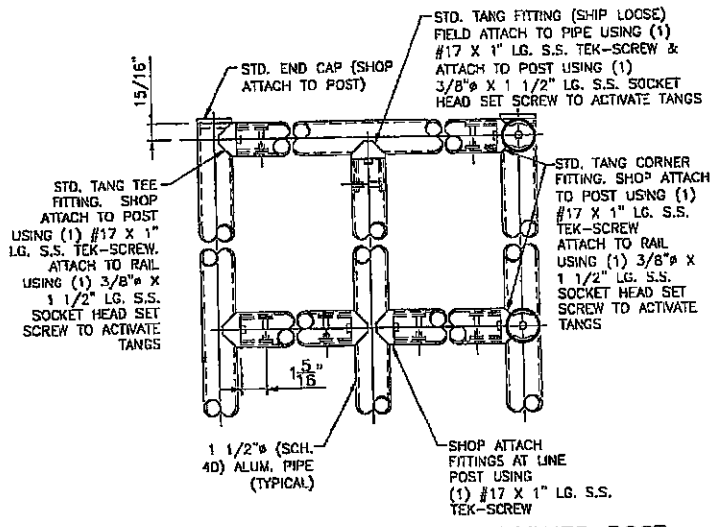

END POST    LINE POST    CORNER POST  
TYPICAL LEVEL RAIL CONNECTIONS

80KD-2

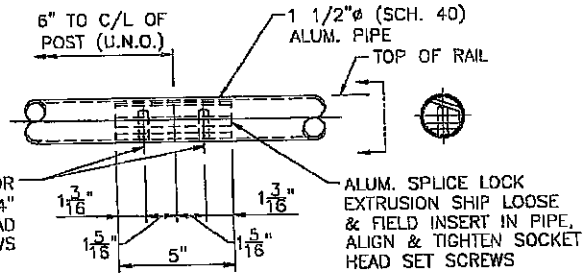

Chk 3/8" Dia. Set Screws @ Splice:

$$V_s := \frac{M_{max}}{2}$$

$V_s = 516$  lb

$$V_{all} := 1614$$
 lb

Use (2) - 3/8" Dia. S.S. Set Screws per Splice  
Cond "CW",  $F_y = 65$  ksi

Chk 3/8" Dia. Set Screws @ Tang/Rail:

$$T := R_{max}$$

$T = 250$  lb

$$T_{all} := 3100 \cdot \frac{0.145}{0.341}$$

$T_{all} = 1318$  lb

Use (1) - 3/8" Dia. S.S. Set Screws per "Tang"  
Cond "CW",  $F_y = 65$  ksi

Chk Splice Piece:  $S_x := 0.06$  in<sup>3</sup>

$$f_b := \frac{M_{max}}{S_x}$$

$f_b = 17183$  psi

$F_b := 21000$  psi

Use Aluminum Splice Piece, As Shown  
6105-T5 or 6061-T6 Alloy

Chk #17 S.S. TEK Screw @ Tee/Post :

$$V_2 := R_{max}$$



$V_2 = 250$  lb

$$V_{all2} := 2184 \cdot 0.25$$

$V_{all2} = 546$  lb

Use (1) #17 S.S. TEK Screw per "Tang"  
300 Series S.S.

<b>RICE</b> ENGINEERING Template:	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01H
			Engineer: JDB    Sheet No: M1
			Date: 9/16/11    Rev:
			Chk By:    Date:

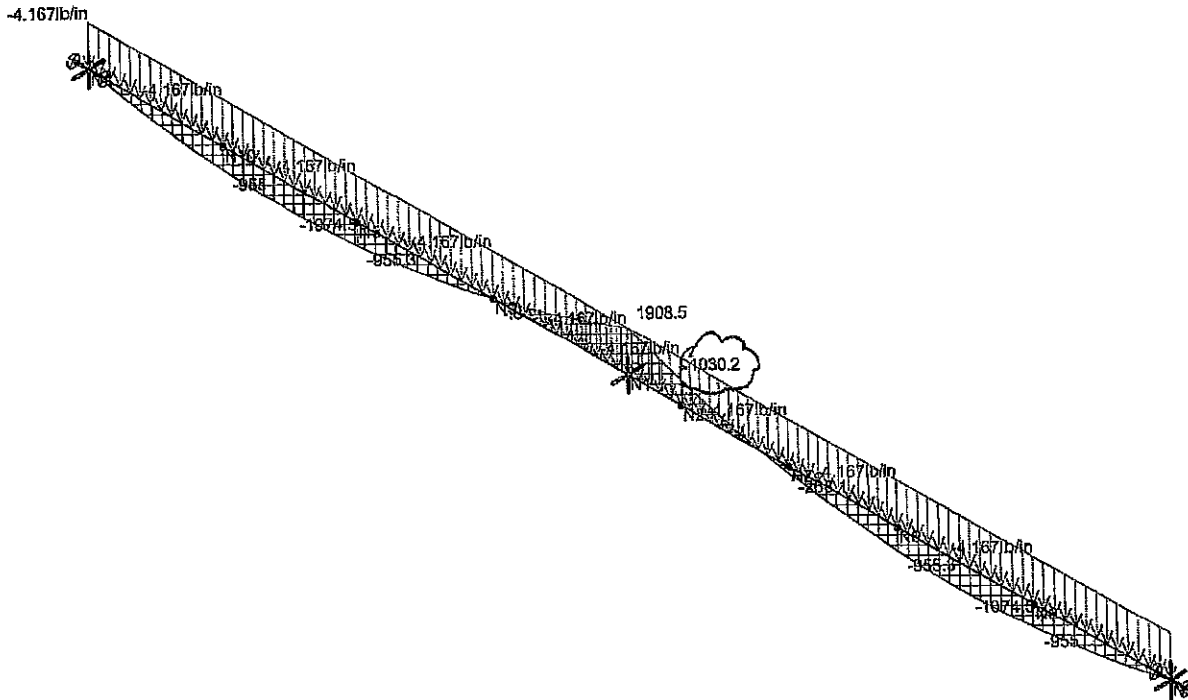

Loads: BLC 1, 50 PLF  
 Results for LC 1, 50 PLF  
 Member z Bending Moments (lb-in)


Rice Engineering	5 ft splice loads	SK - 1
Joe Bauer		Sept 16, 2011 at 1:02 PM
		5 ft Splice Loads.r3d

MIA

**Inputs:**

$L_s := 60$  in (bracket span)       $A := 2.5$  in  
 $w_h := 0$  plf (horiz uniform load)       $B := 2.125$  in  
 $w_v := 50$  plf (vert uniform load)       $C := 2.5$  in  
 $P := 200$  lb (conc. load)       $D := 1.0$  in  
 $F_b := 28000$  psi (Allowable Stress)       $II := 4.313$  in  
  
 $L := 2$  in  
 $t := 0.25$  in  
  
 $\sqrt{4/3}$  Stress Increase Allowed

**ASSUME GROUT FILLED CMU  
DESIGNED BY OTHERS**

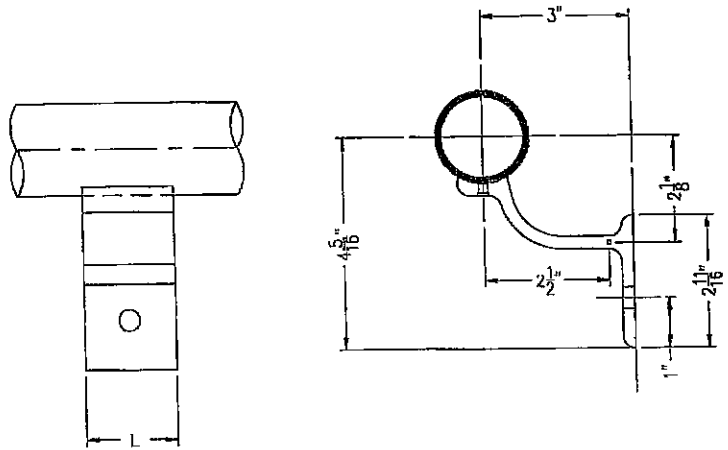

BRACKET DETAIL

**Horizontal Uniform Loading:**

$R_1 := \frac{w_h \cdot L_s}{12}$        $R_1 = 0$  lbs  
 $M_1 := B \cdot R_1$        $M_1 = 0$  in-lb

**Vertical Uniform Loading:**

$R_2 := \frac{w_v \cdot L_s}{12}$        $R_2 = 250$  lbs  
 $M_2 := C \cdot R_2$        $M_2 = 625$  in-lb

**Concentrated Loading:**

$M_3 := P \cdot \max(B, C)$        $M_3 = 500$  in-lb  
  
 $M_b := \max(M_1, M_2, M_3)$        $M_b = 625$  in-lb

**Wall Anchorage (Horizontal Load Case):**

$M_4 := \max(P \cdot H, R_1 \cdot H, R_2 \cdot A)$        $M_4 = 863$  in-lb  
 $T_p := \frac{M_4}{D \cdot 0.85} + P$        $T_p = 1215$  lbs  
 $V := \max(R_2, 200)$        $V = 250$  lbs  
 $T_{all} := 1319$  lbs  
 $V_{all} := 2181$  lbs

$I_b = \left( \frac{T_p}{T_{all}} \right)^{1.67} + \left( \frac{V}{V_{all}} \right)^{1.67}$        $I_b = 0.9$

**Use (1) - 1/2" Dia. S.S. Threaded Rods**  
**W/ Hilti HIT-HY 150 MAX Adhesive**  
 Edge Distance: 4"  
 End Distance: 4"  
 Embedment: 4-1/2"

**Bracket to Grab Rail Screws:**

**Use (2) #1/4-20 S.S. Fasteners**  
**"OK" per inspection**

$F_{b1} := \begin{cases} (F_b \cdot 1.34) & \text{if IBC = 1} \\ F_b & \text{otherwise} \end{cases}$

$t_{req} := \sqrt{\frac{6 \cdot M_b}{F_{b1} \cdot L}}$        $t_{req} = 0.26$  in

**Interaction:**

$I := \frac{t_{req}}{t}$        $I = 1.04 < 5\% \text{ OK}$

**Use Aluminum Wall Bracket,**  
**6105-T5 or 6061-T6 Alloy, 2" Long**

<b>RICE</b> ENGINEERING  Template:	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01H
			Engineer: IDB      Sheet No: M2
			Date: 9/16/11      Rev:
			Chk By:      Date:




Offset Rail Connections	SHT M3
-------------------------	-----------

ARCH/ENG NOTE:  
 HANG-OFF RAIL CORNER NEEDS TO BE ATTACHED WITH A (SCH. 80) TEE FITTING RATHER THAN A (SCH. 40) TEE FITTING TO PROVIDE AMPLE SPACE FOR CONNECTION TO P-END.

$$R_{max} := 200 \text{ lb}$$

$$M_{max} := R_{max} \cdot 3.25 = 650 \text{ lb-in}$$

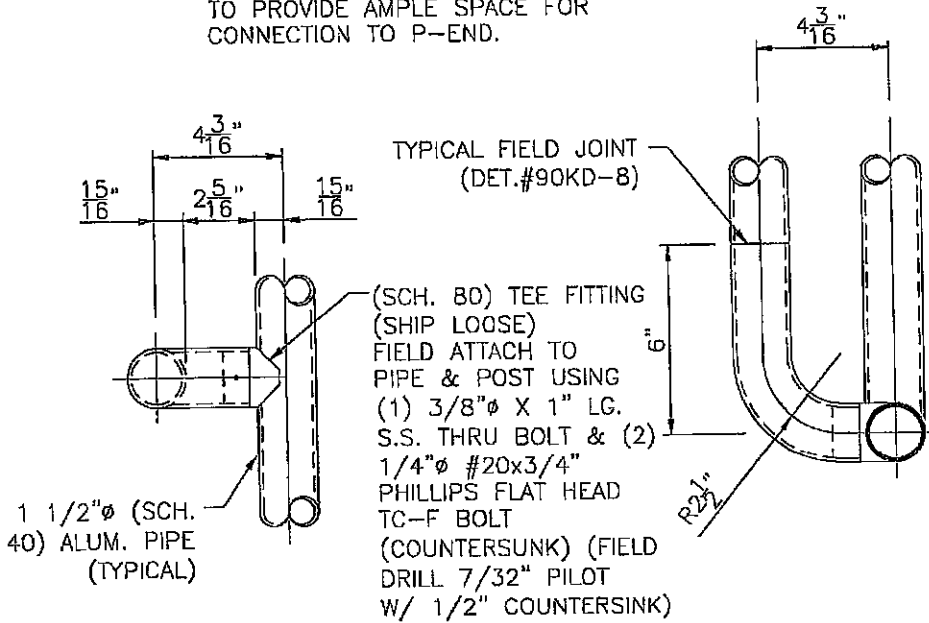

## SPECIAL OFFSET RAIL CONNECTION

80KD-35E |

Chk 1/4- 20 Screws @ Tee:

$$V := \frac{M_{max}}{1.9 \cdot 0.5 \cdot (2)} \quad \boxed{V = 342} \text{ lb}$$

$$\boxed{V_{all} := 647} \text{ lb}$$

Chk Thru-Bolts @ Tee:

$$T := \frac{M_{max}}{1.9 \cdot 0.5} \quad \boxed{T = 684} \text{ lb}$$

$$T_{all} := 3100 \cdot \frac{0.2}{0.553} \quad \boxed{T_{all} = 1121} \text{ lb}$$

**Use (2) - 1/4- 20 S.S. Screws per "Tee"**  
 Cond "CW", Fy= 65 ksi


**Use (1) - 3/8" Dia. S.S. Bolt**  
**Drill & Tap or Thru-Bolt**  
 Cond "CW", Fy= 65 ksi  
 0.200" min. Thread Engagement

<b>RICE</b> ENGINEERING Template:	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01H
			Engineer: JDB Sheet No: M3
			Date: 9/16/11 Rev:
			Chk By: Date:

Grab Rail Bracket Analysis	SHT M4
-------------------------------	-----------

**Inputs:**

$L_s := 60$  in (bracket span)       $A := 3.0$  in  
 $w_H := 0$  plf (horiz uniform load)       $B := 2.125$  in  
 $w_V := 50$  plf (vert uniform load)       $C := 2.5$  in  
 $P := 200$  lb (conc. load)       $D := 1.0$  in  
 $F_b := 28000$  psi (Allowable Stress)       $H := 4.25$  in  
  
 $L := 2$  in  
 $t := 0.25$  in  
  
 $\sqrt{4/3}$  Stress Increase Allowed

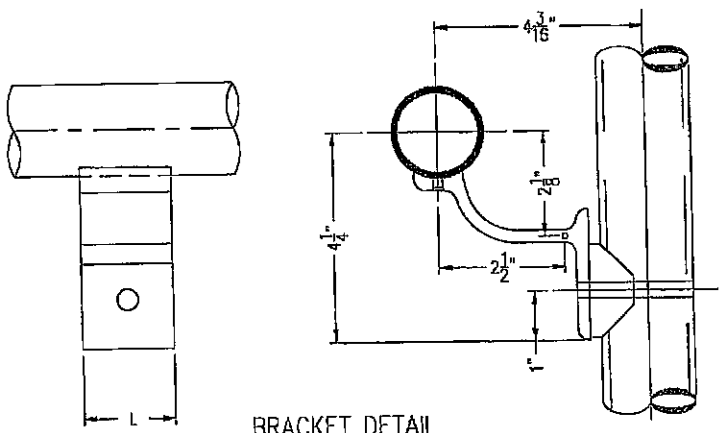

BRACKET DETAIL

**Horizontal Uniform Loading:**

$R_1 := \frac{w_H \cdot L_s}{12}$        $R_1 = 0$  lbs  
 $M_1 := B \cdot R_1$        $M_1 = 0$  in-lb

**Vertical Uniform Loading:**

$R_2 := \frac{w_V \cdot L_s}{12}$        $R_2 = 250$  lbs  
 $M_2 := C \cdot R_2$        $M_2 = 625$  in-lb  
 $M_{b1} := M_1 + M_2$        $M_{b1} = 625$  in-lb

**Concentrated Loading:**

$M_{b2} := P \cdot B$        $M_{b2} = 425$  in-lb  
 $M_b := \max(M_{b1}, M_{b2})$        $M_b = 625$  in-lb

**Anchorage to Post (Horizontal Load Case):**

$M_3 := H \cdot P$        $M_3 = 850$  in-lb  
 $T_p := \frac{M_3}{0.85D} + P$        $T_p = 1200$  lbs  
 $V := \max(R_2, 200)$        $V = 250$  lbs  
 $T_{all} := 3100 \cdot \frac{0.145}{0.341}$        $T_{all} = 1318$  lbs  
 $V_{all} := 1614$  lbs  
 $I_b := \left( \frac{T_p}{T_{all}} \right)^2 + \left( \frac{V}{V_{all}} \right)^2$        $I_b = 0.85$

$F_{b1} := \begin{cases} (F_b \cdot 1.34) & \text{if IBC} = 1 \\ F_b & \text{otherwise} \end{cases}$

$t_{req} := \sqrt{\frac{6M_b}{F_{b1} \cdot L}}$        $t_{req} = 0.26$  in

**Interaction:**

$I := \frac{t_{req}}{t}$        $I = 1.04 < 5\% \text{ Over OK}$

**Use (1) - 3/8" Dia. S.S. Thru Bolts**  
Cond "CW",  $F_y = 65$  ksi



**Bracket to Grab Rail Screws:**

**Use (2) #1/4-20 S.S. Fasteners**  
"OK" per inspection

**Use Aluminum Rail Bracket,**  
**6105-T5 or 6061-T6 Alloy, 2" Long**

<b>RICE</b> ENGINEERING Template:	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (920)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01H
			Engineer: IDB      Sheet No: M4
			Date: 9/16/11      Rev:
			Chk By:      Date:

2 Bolt Raked Base Plate	SHT M5
----------------------------	-----------

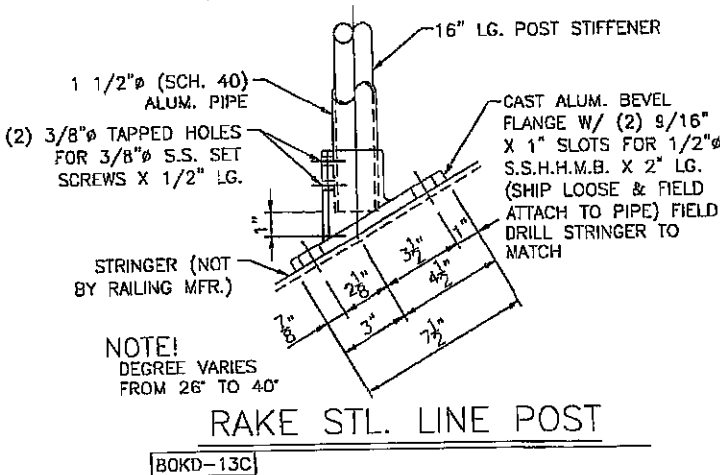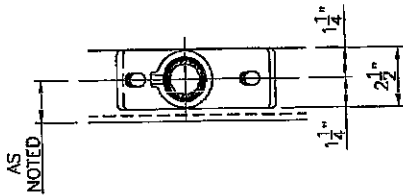

**Actual Loads:**

$L_r := 60$  in Rail Length  
 $h := 42$  in Rail Height  
 $R_1 := 4.17 \cdot (L_r) = 250$  lb  
 $M_1 := \max(R_1 \cdot h, 200 \cdot 0.85 \cdot h) = 10508$  in-lb  
 $M_{max1} := \cos(32deg) \cdot M_1 = 8912$  in-lb  
 $d := 2.5$  in (sleeve dia.)

**Maximum Loads:**

$R_{max} := 250$  lb  
 $M := R_{max} \cdot 42 = 10500$  in-lb  
 $M_{max} := \cos(32deg) \cdot M = 8905$  in-lb  
 $\sigma_{max} := 14182$  psi Based on Algor Model  
 $\sigma_{eff} := \frac{M_{max}}{\sigma_{max}} = 0.63$  in<sup>3</sup> Based on Algor Model

**Chk shear on shoe wall:**

$P := \frac{M_{max1}}{0.67 \cdot (2.375)} \quad P = 5600$  lb  
 $f_v := \frac{(P + R_{max})}{2 \cdot (0.315) \cdot (2)} \quad f_v = 4643$  psi  
 $F_v := \frac{0.57 \cdot (18000)}{1.65} \quad F_v = 6218$  psi  
 $I := \frac{f_v}{F_v} \quad I = 0.75$  Shear Stress "OK"

**Chk Bolts to Steel Stringer:**

$V_b := \frac{R_{max}}{2} \quad V_b = 125$  lb  
 $T_b := \frac{M_{max1}}{2 \cdot (0.5 \cdot 1.2)} \quad T_b = 3565$  lb  
 $V_{all} := 0.196 \cdot 23094 \quad V_{all} = 4526$  lb  
 $T_{all} := 0.142 \cdot 40000 \cdot \frac{0.375}{0.456} \quad T_{all} = 4671$  lb  
 $I_3 := \left( \frac{V_b}{V_{all}} \right)^2 + \left( \frac{T_b}{T_{all}} \right)^2 \quad I_3 = 0.58$

**Chk Aluminum Base Plate:**

$L_1 := 7.5$  in  $D_1 := 1$  in  
 $L_2 := 2.5$  in  $D_2 := 1.25$  in  
 $t := 0.5$  in  
 $\sigma_{actual} := \frac{M_{max1}}{\sigma_{eff}} \quad \sigma_{actual} = 14193$  psi  
 $\sigma_{all} := \frac{1.3 \cdot (18000)}{1.65} \quad \sigma_{all} = 14182$  psi  
 $I_2 := \frac{\sigma_{actual}}{\sigma_{all}} \quad I_2 = 1$

**Use Cast Aluminum Base, as shown**  
535 casting alloy, Fu = 35 ksi min.

**Use (2) - 1/2" Dia. S.S. Thru-Bolts or Drill & Tap w/ 3/8" Min. Thread Engagement**  
300 Series, Fy = 65 ksi Minimum

Note: Model based on 5'-0" max post spacing measured along rail and a post height of 3'-6" See next page for worst case Algor model results


<b>RICE ENGINEERING</b> Template:	105 School Creek Trail Luxemburg, WI 54217 Phone: (920)845-1042 Fax: (820)845-1048 www.rice-inc.com	Project Description:  R1843 Austin WTP #4	Job No: R11-09-01H
			Engineer: IDB Sheet No: M5
			Date: 9/16/11 Rev:
			Chk By: Date:

Stress  
units: psi  
15.0 (in.²)

114382  
107538  
11540.0  
8627.4  
8508.2  
700.1  
30728  
32540  
2008.4  
1418.2

R = 250 lb


Rail Height = 3'-6"

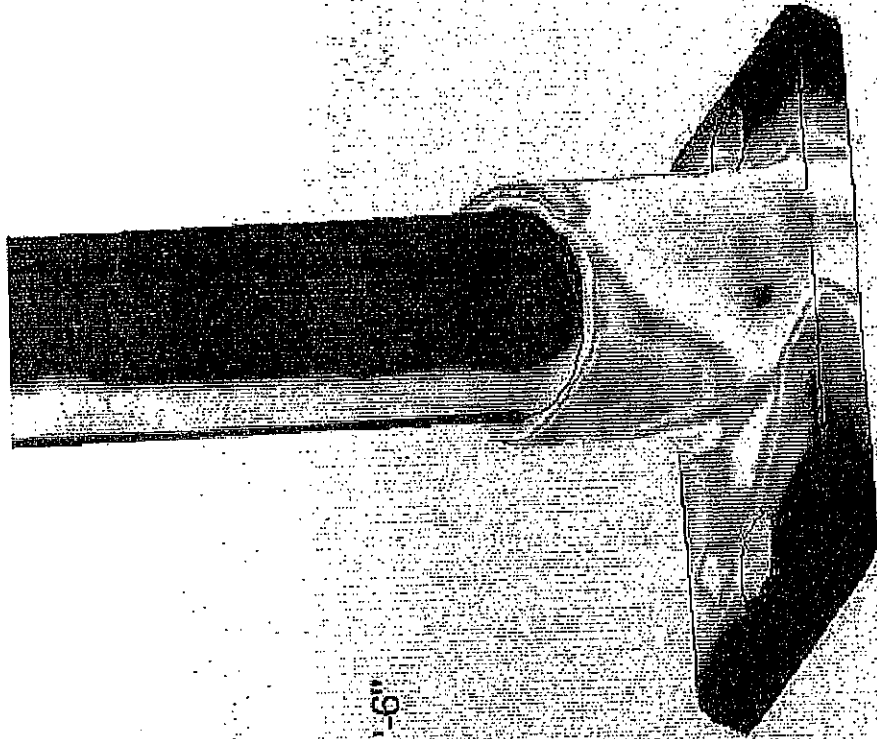

Load Case: 1001

Maximum Value: 114382 (in.²)

Minimum Value: -1418.2 (in.²)







Attached are page(s) from the 2008 Hilti North American Product Technical Guide. For complete details on this product, including data development, product specifications, general suitability, installation, corrosion, and spacing & edge distance guidelines, please refer to the Technical Guide, or contact Hilti.

---

**Hilti, Inc.**  
5400 South 122<sup>nd</sup> East Avenue  
Tulsa, OK 74146

1-800-879-8000  
[www.hilti.com](http://www.hilti.com)




## PROFIS: The World's Most Powerful Anchor Design Software

- Easy to Learn – Start working in just minutes
- Fast and Powerful – Produce detailed designs quickly
- Specify with Confidence – The largest number of approvals and latest design codes

No charge.

Download now at [www.us.hilti.com](http://www.us.hilti.com)  
or [www.hilti.ca](http://www.hilti.ca)

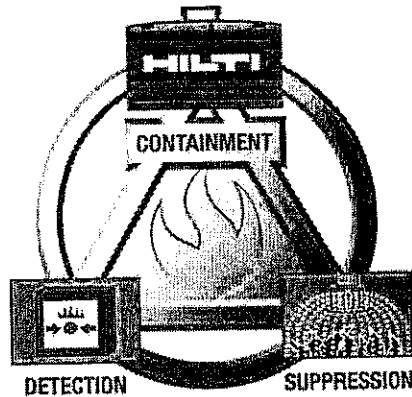

## Firestop Systems

When it comes to Life Safety and building code compliance, Hilti provides complete solutions with a wide range of products and unmatched technical support.


- Firestop Systems Guides
  - Through Penetrations
  - Joint Penetrations
- FACT Program
- FS 411
- BASIC Training
- Engineering Judgements
- Firestop Design Center online at [www.us.hilti.com](http://www.us.hilti.com) or [www.hilti.ca](http://www.hilti.ca)



## Hilti Diaphragm Deck Design


The Hilti Diaphragm Deck Design Program allows designers to quickly and accurately design roof deck and composite floor deck diaphragms.

- Ability to design with innovative Hilti fasteners for frame and sidelap connection
- Creates easy to use load tables with span ranges based on user input
- Allows for different safety factors depending on load type, building code and field quality control
- Direct link to Hilti website

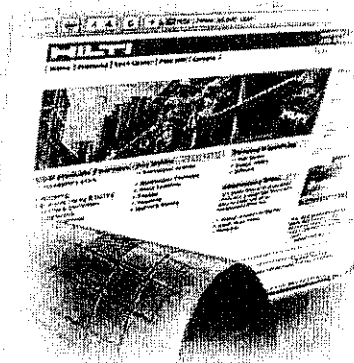

## Hilti Online

- Technical Library
- Design Centers
- Interactive Product Advisors
- Full-line Product Catalog
- Online Ordering
- Maps to Hilti locations
- "Contact Us" program to answer your questions

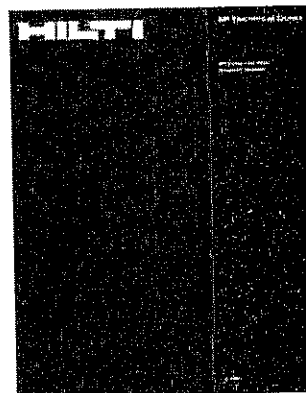

## MI - Industrial Pipe Support Technical Guide

A guide to specifying the Hilti modular pipe support system for medium to heavy loads without welding.


- MI System is the ideal solution for pipes up to 24 in. diameter
- Reliable fastenings without welds
- Easily installed

# HIT-RE 500 Epoxy Adhesive Anchoring System 4.2.7

## 4.2.7.1 Product Description

- 4.2.7.1 Product Description
- 4.2.7.2 Material Specifications
- 4.2.7.3 Technical Data
- 4.2.7.4 Installation Instructions
- 4.2.7.5 Ordering Information

### Fastener Components

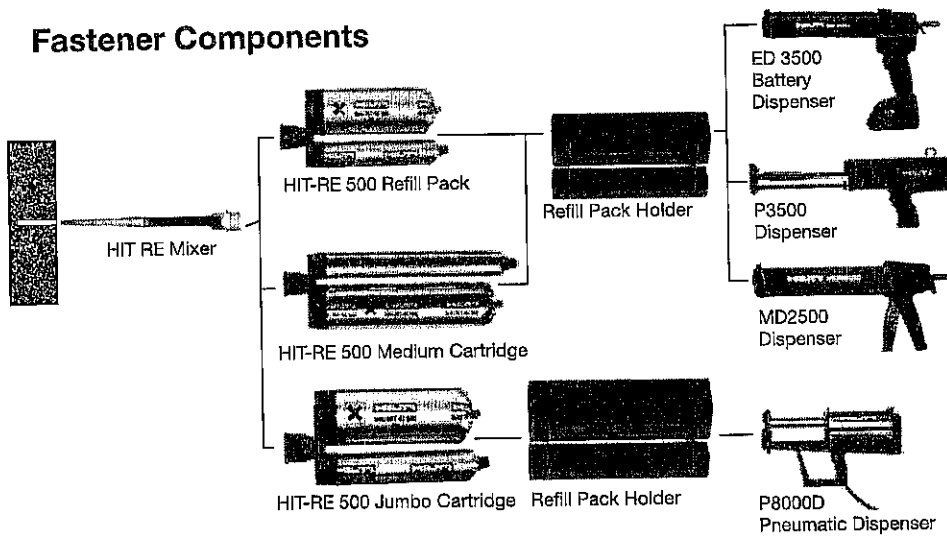

### Listings/Approvals

City of Los Angeles  
 Research Report #25514  
 NSF/ANSI Std 61  
 certification for use in potable water  
 European Technical Approval  
 ETA-04/0027  
 ETA-04/0028  
 ETA-04/0029



### Code Compliance

IBC®/IRC® 2003 (ICC-ES AC58)  
 IBC®/IRC® 2000 (ICC-ES AC58)  
 UBC® 1997 (ICC-ES AC58)  
 LEED®: Credit 4.1-Low Emitting  
 Materials







The Leadership in Energy and Environmental Design (LEED®) Green Building Rating system™ is the nationally accepted benchmark for the design, construction and operation of high performance green buildings.

The Hilti HIT-RE 500 System is a high strength, two part epoxy adhesive. The system consists of a side-by-side adhesive refill pack, a mixing nozzle, a HIT dispenser with refill pack holder, and either a threaded rod, rebar, HIS internally threaded insert or smooth epoxy coated bar. HIT-RE 500 is specifically designed for fastening into solid base materials such as concrete, grout, stone or solid masonry. HIT-RE 500 may be used in underwater fastenings and for oversized holes up to 2 times the rod diameter (2-1/2" rod and 3" max. hole diameter) and for diamond-cored holes.

### Product Features

- Superior bond performance
- Use in diamond cored or pneumatic drilled holes and under water up to 165 feet (50 m)
- Meets DOT requirements for most states; contact the Hilti Technical Staff
- Meets requirements of ASTM C 881-90, Type IV, Grade 2 and 3, Class A, B, C except gel times
- Meets requirements of AASHTO specification M235, Type IV, Grade 3, Class A, B, C except gel times
- Mixing tube provides proper mixing, eliminates measuring errors and minimizes waste
- Contains no styrene; virtually odorless
- Extended temperature range from 23°F to 104°F (-5°C to 40°C)
- Excellent weathering resistance; Resistance against elevated temperatures
- Suitable for oversized holes
- Seismic qualified per IBC®/IRC® 2003, IBC®/IRC® 2000 and UBC® 1997 (ICC-ES AC58). Please refer to ESR-1682.

### Components

-  HAS Threaded Rods
-  HIS Internally Threaded Inserts
-  Rebar (supplied by contractor)
-  Smooth, epoxy coated bar (supplied by contractor)



## 4.2.7 HIT-RE 500 Epoxy Adhesive Anchoring System

### Guide Specifications

#### Master Format Section:

03250 (Concrete accessories)

#### Related Sections:

03200 (Concrete Reinforcing-Reinforcing Accessories)

05050 (Metal Fabrication)

05120 (Structural Steel; Masonry Accessories)

Injectable adhesive shall be used for installation of all reinforcing steel dowels or threaded anchor rods and inserts into new or existing concrete. Adhesive shall be furnished in side-by-side refill packs which keep component A and component B separate. Side-by-side packs shall be designed to compress during use to minimize waste volume. Side-by-side packs shall also be designed to accept static mixing nozzle

which thoroughly blends component A and component B and allows injection directly into drilled hole. Only injection tools and static mixing nozzles as supplied by manufacturer shall be used. Manufacturer's instructions shall be followed. Injection adhesive shall be formulated to include resin and hardener to provide optimal curing speed as well as high strength and stiffness. Typical curing time at 68°F (20°C) shall be approximately 12 hours.

Injection adhesive shall be HIT-RE 500, as furnished by Hilti.


**Anchor Rods** Shall be furnished with chamfered ends so that either end will accept a nut and washer. Alternatively, anchor rods shall be furnished with a 45 degree chisel point on one end to allow for easy insertion into the adhesive-filled hole. Anchor rods shall be manufactured to meet the following requirements:

1. ISO 898 Class 5.8
2. ASTM A 193, Grade B7 (high strength carbon steel anchor);
3. AISI 304 or AISI 316 stainless steel, meeting the requirements of ASTM F 593 (condition CW).

Special order length HAS Rods may vary from standard product.

**Nuts and Washers** Shall be furnished to meet the requirements of the above anchor rod specifications.

### Fastener Components

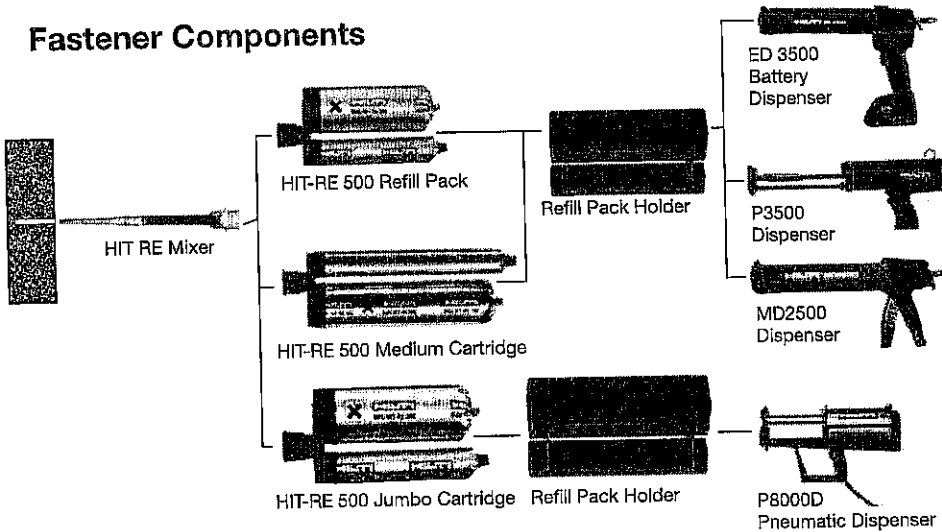

# HIT-RE 500 Epoxy Adhesive Anchoring System 4.2.7

## 4.2.7.2 Material Specifications

### Material Properties for HIT-RE 500 – Cured Adhesive

Bond Strength ASTM C882-91 <sup>1</sup> 2 day cure 7 day cure	12.4 MPa 12.4 MPa	1800 psi 1800 psi
Compressive Strength ASTM D-695-96 <sup>1</sup>	82.7 MPa	12,000 psi
Compressive Modulus ASTM D-695-96 <sup>1</sup>	1493 MPa	0.22 x 10 <sup>6</sup> psi
Tensile Strength 7 day ASTM D-638-97	43.5 MPa	6310 psi
Elongation at break ASTM D-638-97	2.0%	2.0%
Heat Deflection Temperature ASTM D-648-95	63°C	146°F
Absorption ASTM D-570-95	0.06%	0.06%
Linear Coefficient of Shrinkage on Cure ASTM D-2566-86	0.004	0.004
Electrical resistance DIN IEC 93 (12.93)	6.6 x 10 <sup>13</sup> Ω/m	1.7 x 10 <sup>12</sup> Ω/in.

1 Minimum values obtained as the result of tests at three cure temperatures (23, 40, 60°F).

### Material Specifications

Standard HAS-E rod material meets the requirements of ISO 898 Class 5.8

High Strength or 'Super HAS' rod material meets the requirements of ASTM A 193, Grade B7

Stainless HAS rod material meets the requirements of ASTM F 593 (304/316) Condition CW 3/8" - 5/8"

Stainless HAS rod material meets the requirements of ASTM F 593 (304/316) Condition CW 3/4" - 1 1/4"

HIS Insert 11MnPb30+C Carbon Steel conforming to DIN 10277-3

HIS-R Insert X5CrNiMo17122 K700 Stainless Steel conforming to DIN EN 10088-3

HAS Super & HAS-E Standard Nut material meets the requirements of ASTM A 563, Grade DH

HAS Stainless Steel Nut material meets the requirements of ASTM F 594

HAS-E Carbon Steel and Stainless Steel Washers meet dimensional requirements of ANSI B18.22.1 Type A Plain

HAS Super & HAS-E Standard Washers meet the requirements of ASTM F 436

All HAS-E & HAS Super Rods (except 7/8") & HAS-E Standard, HIS Inserts, nuts & washers are zinc plated to ASTM B 633 SC 1

7/8" Standard HAS-E & HAS Super rods hot-dip galvanized in accordance with ASTM A 153


**Note:** Special Order steel rod material may vary from standard steel rod materials.

## 4.2.7.3 Technical Data

### HIT-RE 500 Installation Specification Table for HAS Threaded Rods

Details		HAS Rod Size	in.	3/8	1/2	5/8	3/4	7/8	1	1-1/4
			(mm)	(9.5)	(12.7)	(15.9)	(19.1)	(22.2)	(25.4)	(31.8)
<b>d<sub>bit</sub></b>	bit diameter <sup>1</sup>		in.	7/16	9/16	3/4	7/8	1	1-1/8	1-3/8
<b>h<sub>nom</sub></b>	std. depth of embed.		in.	3-3/8	4-1/2	5-5/8	6-3/4	7-7/8	9	11-1/4
			(mm)	(90)	(110)	(143)	(171)	(200)	(229)	(286)
<b>T<sub>max</sub></b> max. tightening torque	HAS-E Rods	Embed. ≥ h <sub>nom</sub>	ft lb (N·m)	18 (24)	30 (41)	75 (102)	150 (203)	175 (237)	235 (319)	400 (540)
	HAS SS HAS-Super	Embed. < h <sub>nom</sub>	ft lb (N·m)	15 (20)	20 (27)	50 (68)	105 (142)	125 (169)	165 (224)	280 (375)
<b>h</b>	min. base material thickness		(in.)	1.5 h <sub>ef</sub>						
<b>Approx. number of fastenings per cartridge at standard embedment<sup>2</sup></b>										
Small Cartridge				52	28	11	7	5	4	2
Medium Cartridge				84	45	18	11	8	6	3
Jumbo Cartridge				255	137	56	37	27	19	12

Mechanical Properties	
f <sub>y</sub> ksi (MPa)	min. f <sub>u</sub> ksi (MPa)
58 (400)	72.5 (500)
105 (724)	125 (862)
65 (448)	100 (689)
45 (310)	85 (586)
54.4 (375)	66.7 (460)
50.8 (350)	101.5 (700)

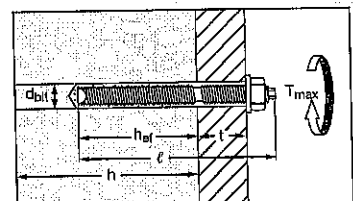


- 1 Use matched tolerance carbide tipped bits or Hilti matched tolerance DD-B or DD-C diamond core bits.
- 2 Assumes no waste.

## 4.2.7 HIT-RE 500 Epoxy Adhesive Anchoring System

HIT-RE 500 Installation Specification Table for HIS Inserts

HIS Insert		in.	3/8	1/2	5/8	3/4
Details		(mm)	(9.5)	(12.7)	(15.9)	(19.1)
$d_{bit}$	bit diameter <sup>1,2</sup>	in.	11/16	7/8	1-1/8	1-1/4
$h_{nom}$	std. embed. depth	in. (mm)	4-1/4 (110)	5 (125)	6-5/8 (170)	8-1/4 (210)
$e_{th}$	useable thread length	in. (mm)	1 (25)	1-3/16 (30)	1-1/2 (40)	2 (50)
$T_{max}$	Max. tightening torque	ft lb (N·m)	18 (24)	35 (47)	80 (108)	160 (217)
$h$	min. base material thickness	in. (mm)	6-3/8 (162)	7-1/2 (191)	10 (254)	12-3/8 (314)
Approx. number of fastenings per cartridge at standard embedment <sup>2</sup>						
Small Cartridge			27	16	6	4
Medium Cartridge			49	30	11	8
Jumbo Cartridge			168	105	38	27

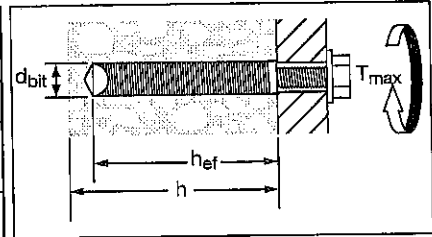

- 1 Use matched tolerance carbide tipped bits or Hilti matched tolerance DD-B or DD-C diamond core bits.
- 2 Assumes no waste.

HIT-RE 500 Installation Specification Table for Rebar in Concrete

Rebar Size:		No. 3	No. 4	No. 5	No. 6	No. 7	No. 8	No. 9	No. 10	No. 11
Details										
Bit diameter <sup>1,2,3</sup>	in.	1/2	5/8	3/4	7/8	1	1-1/8	1-3/8	1-1/2	1-3/4
$h_{nom}$	std. embed. depth (mm)	3-3/8 (86)	4-1/2 (114)	5-5/8 (143)	6-3/4 (171)	7-7/8 (200)	9 (229)	10-1/8 (257)	11-1/4 (286)	12-3/8 (314)
Approx. number of fastenings per cartridge at standard embedment <sup>3</sup>										
Small Cartridge		44	25	16	11	8	6	3	2	1
Medium Cartridge		72	41	27	18	13	10	5	3	2
Jumbo Cartridge		221	125	83	56	41	31	14	11	7

- 1 Rebar diameters may vary. Use smallest drill bit which will accommodate rebar.
- 2 Use matched tolerance carbide tipped bits or Hilti matched tolerance DD-B or DD-C diamond core bits.
- 3 Assumes no waste.

HIT-RE 500 Installation Specification Table for Metric Rebar in Concrete (Canada Only)

Rebar Size:		10M	15M	20M	25M	30M	35M
Details							
Bit diameter <sup>1,2</sup>	in.	5/8	3/4	1	1-1/8	1-3/8	1-3/4
$h_{nom}$	std. embed. depth (mm)	115	145	200	230	260	315
Approx. number of fastenings per cartridge at standard embedment <sup>2</sup>							
Small Cartridge		20	17	5	6	3	1
Medium Cartridge		32	28	9	10	5	2
Jumbo Cartridge		98	84	27	31	16	7

- 1 Rebar diameters may vary. Use smallest bit which will accommodate rebar.
- 2 Assumes no waste.

### Combined Shear and Tension Loading

$$\left(\frac{N_d}{N_{rec}}\right)^{5/3} + \left(\frac{V_d}{V_{rec}}\right)^{5/3} \leq 1.0 \text{ (Ref. Section 4.1.8.3)}$$

# HIT-RE 500 Epoxy Adhesive Anchoring System 4.2.7

HIT-RE 500 Allowable and Ultimate Bond/Concrete Capacity for HAS Rods in Normal Weight Concrete<sup>1,2,3,4</sup>

Anchor Diameter in (mm)	Embedment Depth in (mm)	HIT-RE 500 Allowable Bond/Concrete Capacity				HIT-RE 500 Ultimate Bond/Concrete Capacity			
		Tensile		Shear		Tensile		Shear	
		$f'_c = 2000$ psi (13.8 MPa) lb (kN)	$f'_c = 4000$ psi (27.6 MPa) lb (kN)	$f'_c = 2000$ psi (13.8 MPa) lb (kN)	$f'_c = 4000$ psi (27.6 MPa) lb (kN)	$f'_c = 2000$ psi (13.8 MPa) lb (kN)	$f'_c = 4000$ psi (27.6 MPa) lb (kN)	$f'_c = 2000$ psi (13.8 MPa) lb (kN)	$f'_c = 4000$ psi (27.6 MPa) lb (kN)
3/8 (9.5)	1-3/4 (44)	645 (2.9)	1095 (4.9)	1510 (6.7)	2135 (9.5)	2580 (11.5)	4370 (19.4)	4530 (20.2)	6405 (28.4)
	3-3/8 (86)	2190 (9.7)	2585 (11.5)	3155 (14.0)	4460 (19.8)	8760 (39.0)	10345 (46.0)	9460 (42.1)	13380 (59.5)
	4-1/2 (114)	2420 (10.8)	2585 (11.5)	4855 (21.6)	6860 (30.5)	9685 (43.1)	10335 (46.0)	14560 (64.8)	20580 (91.5)
1/2 (12.7)	2-1/4 (57)	1130 (5.0)	1965 (8.7)	2510 (11.2)	3550 (15.8)	4530 (20.2)	7860 (35.0)	7525 (33.5)	10640 (47.3)
	4-1/2 (114)	4045 (18.0)	5275 (23.5)	5610 (25.0)	7935 (35.3)	16185 (72.0)	21095 (93.8)	16820 (74.8)	23800 (105.9)
	6 (152)	4775 (21.2)	5380 (23.9)	8635 (38.4)	12210 (54.3)	19095 (84.9)	21520 (95.7)	25900 (115.2)	36620 (162.9)
5/8 (15.9)	2-7/8 (73)	1690 (7.5)	3045 (13.5)	5245 (23.3)	7420 (33.0)	6770 (30.1)	12175 (54.2)	15735 (70.0)	22250 (99.0)
	5-5/8 (143)	6560 (29.2)	7355 (32.7)	8760 (39.0)	12395 (55.1)	26240 (116.7)	29420 (130.9)	26280 (116.9)	37180 (165.4)
	7-1/2 (190)	7320 (32.6)	7515 (33.4)	13615 (60.6)	19080 (84.9)	29290 (130.3)	30060 (133.7)	40480 (180.1)	57240 (254.6)
3/4 (19.1)	3-3/8 (86)	2310 (10.3)	4515 (20.1)	7335 (32.6)	10370 (46.1)	9250 (41.1)	18065 (80.4)	22000 (97.9)	31108 (138.4)
	6-3/4 (172)	8670 (38.6)	10755 (47.8)	12615 (56.1)	17840 (79.4)	34685 (154.3)	43020 (191.4)	37840 (168.3)	53520 (238.1)
	9 (229)	10385 (46.2)	12995 (57.8)	19430 (86.4)	27470 (122.2)	41535 (184.8)	51985 (231.2)	58280 (259.2)	82400 (366.5)
7/8 (22.2)	4 (101)	3005 (13.4)	5665 (25.2)	7795 (34.7)	11020 (49.0)	12030 (53.5)	22670 (100.8)	23375 (104.0)	33050 (147.0)
	7-7/8 (200)	12495 (55.6)	15875 (70.6)	17175 (76.4)	24290 (108.0)	49975 (222.3)	63495 (282.4)	51520 (229.2)	72860 (324.1)
	10-1/2 (267)	14705 (65.4)	16185 (72.0)	26440 (117.6)	37390 (166.3)	58820 (261.6)	64730 (287.9)	79320 (352.8)	112160 (498.9)
1 (25.4)	4-1/2 (114)	3945 (17.5)	8440 (37.5)	10035 (44.6)	14190 (63.1)	15790 (70.2)	33765 (150.2)	30104 (133.9)	42565 (189.3)
	9 (229)	13845 (61.6)	17365 (77.2)	22435 (99.8)	31720 (141.1)	55380 (246.3)	69465 (309.0)	67300 (299.4)	95160 (423.3)
	12 (305)	17935 (79.8)	17935 (79.8)	34535 (153.6)	48830 (217.2)	71740 (319.1)	71740 (319.1)	103600 (460.8)	146480 (651.6)
1-1/4 (31.8)	5-5/8 (143)	5760 (25.6)	12815 (57.0)	14760 (65.7)	20870 (92.8)	23045 (102.5)	51270 (228.1)	44280 (197.0)	62610 (278.5)
	11-1/4 (286)	24610 (109.5)	31620 (140.7)	35050 (155.9)	49570 (220.5)	98430 (437.8)	126480 (562.6)	105140 (467.7)	148710 (661.5)
	15 (381)	34130 (151.8)	35270 (156.9)	53960 (240.0)	76300 (339.4)	136525 (607.3)	141090 (627.6)	161880 (720.1)	228900 (1018.2)

1 Influence factors for spacing and/or edge distance are applied to concrete/bond values above, and then compared to the steel value. The lesser of the values is to be used for the design.

2 Average ultimate concrete shear capacity based on Concrete Capacity Design (CCD) method for standard and deep embedment and based on testing for shallow embedment.

3 All values based on holes drilled with carbide bit and cleaned with brush per manufacturer's instructions. Ultimate tensile concrete/bond loads represent the average values obtained in testing.

4 For underwater applications up to 165 feet/50m depth reduce the tabulated concrete/bond values 30% to account for reduced mechanical properties of saturated concrete.

## 4.2.7 HIT-RE 500 Epoxy Adhesive Anchoring System

### Allowable Steel Strength for Carbon Steel & Stainless Steel HAS Rods<sup>1</sup>

Rod Diameter in. (mm)	HAS-E Standard ISO 898 Class 5.8		HAS Super ASTM A 193 B7		HAS SS AISI 304/316 SS	
	Tensile lb (kN)	Shear lb (kN)	Tensile lb (kN)	Shear lb (kN)	Tensile lb (kN)	Shear lb (kN)
<b>3/8</b> (9.5)	<b>2640</b> (11.7)	<b>1360</b> (6.0)	<b>4555</b> (20.3)	<b>2345</b> (10.4)	<b>3645</b> (16.2)	<b>1875</b> (8.3)
<b>1/2</b> (12.7)	<b>4700</b> (20.9)	<b>2420</b> (10.8)	<b>8100</b> (36.0)	<b>4170</b> (18.5)	<b>6480</b> (28.8)	<b>3335</b> (14.8)
<b>5/8</b> (15.9)	<b>7340</b> (32.7)	<b>3780</b> (16.8)	<b>12655</b> (56.3)	<b>6520</b> (29.0)	<b>10125</b> (45.0)	<b>5215</b> (23.2)
<b>3/4</b> (19.1)	<b>10570</b> (47.0)	<b>5445</b> (24.2)	<b>18225</b> (81.1)	<b>9390</b> (41.8)	<b>12390</b> (55.1)	<b>6385</b> (28.4)
<b>7/8</b> (22.2)	<b>14385</b> (64.0)	<b>7410</b> (33.0)	<b>24805</b> (110.3)	<b>12780</b> (56.9)	<b>16865</b> (75.0)	<b>8690</b> (38.6)
<b>1</b> (25.4)	<b>18790</b> (83.6)	<b>9680</b> (43.0)	<b>32400</b> (144.1)	<b>16690</b> (74.2)	<b>22030</b> (98.0)	<b>11350</b> (50.5)
<b>1-1/4</b> (31.8)	<b>29360</b> (130.6)	<b>15125</b> (67.3)	<b>50620</b> (225.2)	<b>26080</b> (116.0)	<b>34425</b> (153.1)	<b>17735</b> (78.9)

<sup>1</sup> Steel strength as defined in AISC Manual of Steel Construction (ASD):

$$\text{Tensile} = 0.33 \times F_u \times \text{Nominal Area}$$

$$\text{Shear} = 0.17 \times F_u \times \text{Nominal Area}$$

### Ultimate Steel Strength for Carbon Steel & Stainless Steel HAS Rods<sup>1</sup>

Rod Diameter in. (mm)	HAS-E Standard ISO 898 Class 5.8			HAS Super ASTM A 193 B7			HAS SS AISI 304/316 SS		
	Yield lb (kN)	Tensile lb (kN)	Shear lb (kN)	Yield lb (kN)	Tensile lb (kN)	Shear lb (kN)	Yield lb (kN)	Tensile lb (kN)	Shear lb (kN)
<b>3/8</b> (9.5)	<b>4495</b> (20.0)	<b>6005</b> (26.7)	<b>3605</b> (16.0)	<b>8135</b> (36.2)	<b>10350</b> (43.4)	<b>6210</b> (27.6)	<b>5035</b> (22.4)	<b>8280</b> (36.8)	<b>4970</b> (22.1)
<b>1/2</b> (12.7)	<b>8230</b> (36.6)	<b>10675</b> (47.5)	<b>6405</b> (28.5)	<b>14900</b> (66.3)	<b>18405</b> (79.0)	<b>11040</b> (49.1)	<b>9225</b> (41.0)	<b>14720</b> (65.5)	<b>8835</b> (39.3)
<b>5/8</b> (15.9)	<b>13110</b> (58.3)	<b>16680</b> (74.2)	<b>10010</b> (44.5)	<b>23730</b> (105.6)	<b>28760</b> (125.7)	<b>17260</b> (76.8)	<b>14690</b> (65.3)	<b>23010</b> (102.4)	<b>13805</b> (61.4)
<b>3/4</b> (19.1)	<b>19400</b> (86.3)	<b>24020</b> (106.9)	<b>14415</b> (64.1)	<b>35120</b> (156.2)	<b>41420</b> (185.7)	<b>24850</b> (110.5)	<b>15050</b> (66.9)	<b>28165</b> (125.3)	<b>16800</b> (75.2)
<b>7/8</b> (22.2)	<b>26780</b> (119.1)	<b>32695</b> (145.4)	<b>19620</b> (87.3)	<b>48480</b> (215.7)	<b>56370</b> (256.9)	<b>33825</b> (150.5)	<b>20775</b> (92.4)	<b>38335</b> (170.5)	<b>23000</b> (102.3)
<b>1</b> (25.4)	<b>35130</b> (156.3)	<b>42705</b> (190.0)	<b>25625</b> (114.0)	<b>63600</b> (282.9)	<b>73630</b> (337.0)	<b>44180</b> (196.5)	<b>27255</b> (121.2)	<b>50070</b> (222.7)	<b>30040</b> (133.6)
<b>1-1/4</b> (31.8)	<b>56210</b> (250.0)	<b>66730</b> (296.8)	<b>40035</b> (178.1)	<b>101755</b> (452.6)	<b>115050</b> (511.8)	<b>69030</b> (307.1)	<b>43610</b> (194.0)	<b>78235</b> (348.0)	<b>46940</b> (208.8)

<sup>1</sup> Steel strength as defined in AISC Manual of Steel Construction 2nd Ed. (LRFD):

$$\text{Yield} = F_y \times \text{Tensile Stress Area}$$

$$\text{Tensile} = 0.75 \times F_u \times \text{Nominal Area}$$

$$\text{Shear} = 0.45 \times F_u \times \text{Nominal Area}$$

## HIT-RE 500 Epoxy Adhesive Anchoring System 4.2.7

### HIT-RE 500 Allowable Bond/Concrete Capacity and Steel Strength for HIS Carbon Steel and HIS-R Stainless Steel Internally Threaded Inserts

Anchor Diameter in. (mm)	Embedment Depth in. (mm)	HIT-RE 500 Allowable Bond/Concrete Capacity <sup>2</sup>		Steel Bolt Strength <sup>1,2</sup>			
		Tensile $f'_c \geq 2000$ psi (13.8 MPa) lb (kN)	Shear $f'_c \geq 2000$ psi (13.8 MPa) lb (kN)	ASTM A 325 Carbon Steel		ASTM F 593 Stainless Steel	
				Tensile <sup>1</sup> lb (kN)	Shear <sup>1</sup> lb (kN)	Tensile <sup>1</sup> lb (kN)	Shear <sup>1</sup> lb (kN)
3/8 (9.5)	4-1/4 (108)	2870 (12.8)	1565 (7.0)	4370 (19.4)	2250 (10.0)	3645 (16.2)	1875 (8.3)
1/2 (12.7)	5 (127)	4530 (20.1)	2890 (12.9)	7775 (34.6)	4005 (17.8)	6480 (28.8)	3335 (14.8)
5/8 (15.9)	6-5/8 (168)	8255 (36.7)	4635 (20.6)	12150 (54.0)	6260 (27.8)	10125 (45.0)	5215 (23.2)
3/4 (19.1)	8-1/4 (210)	9030 (40.1)	6695 (29.8)	17945 (77.8)	9010 (40.1)	12395 (55.1)	6385 (28.4)

### HIT-RE 500 Ultimate Bond/Concrete Capacity and Steel Strength for HIS Carbon Steel and HIS-R Stainless Steel Internally Threaded Inserts

Anchor Diameter in. (mm)	Embedment Depth in. (mm)	HIT-RE 500 Ultimate Bond/Concrete Capacity <sup>2</sup>		Ultimate Bolt Strength <sup>1,2</sup>			
		Tensile $f'_c \geq 2000$ psi (13.8 MPa) lb (kN)	Shear $f'_c \geq 2000$ psi (13.8 MPa) lb (kN)	ASTM A 325 Carbon Steel		ASTM F 593 Stainless Steel	
				Tensile <sup>1</sup> lb (kN)	Shear <sup>1</sup> lb (kN)	Tensile <sup>1</sup> lb (kN)	Shear <sup>1</sup> lb (kN)
3/8 (9.5)	4-1/4 (108)	11480 (51.0)	6260 (27.8)	9935 (44.2)	5960 (26.5)	8280 (36.8)	4970 (22.1)
1/2 (12.7)	5 (127)	18115 (80.5)	11565 (51.4)	17665 (78.6)	10600 (47.2)	14720 (65.5)	8835 (39.3)
5/8 (15.9)	6-5/8 (168)	33025 (146.9)	18550 (82.5)	27610 (122.8)	16565 (73.7)	23010 (102.4)	13805 (61.4)
3/4 (19.1)	8-1/4 (210)	36125 (160.6)	26775 (119.1)	39760 (176.9)	23855 (106.1)	28165 (125.3)	16900 (75.1)

<sup>1</sup> Steel values in accordance with AISC

ASTM A 325 bolts:  $F_y = 92$  ksi,  $F_u = 120$  ksi  
 ASTM F 593 (AISI 304/316):  $F_y = 65$  ksi,  $F_u = 100$  ksi for 3/8" thru 5/8"  
 $F_y = 45$  ksi,  $F_u = 85$  ksi for 3/4"

#### Allowable Load Values

$$\text{Tension} = 0.33 \times F_u \times A_{nom}$$

$$\text{Shear} = 0.17 \times F_u \times A_{nom}$$

#### Ultimate Load Values

$$\text{Tension} = 0.75 \times F_u \times A_{nom}$$

$$\text{Shear} = 0.45 \times F_u \times A_{nom}$$

<sup>2</sup> Use lower value of either bond/concrete capacity or steel strength.

## 4.2.7 HIT-RE 500 Epoxy Adhesive Anchoring System

### HIT-RE 500 Ultimate Bond Strength and Steel Strength for Rebar in Concrete<sup>1</sup>

Nominal Rebar Size	Embed. Depth in. (mm)	Concrete Compressive Strength						Grade 60 Rebar	
		$f'_c = 2000 \text{ psi (13.8 MPa)}$			$f'_c = 4000 \text{ psi (27.6 MPa)}$			Yield Strength lb (kN)	Tensile Strength lb (kN)
		Ultimate Bond Strength lb (kN)	Embed. to Develop Yield Strength <sup>1</sup> in. (mm)	Embed. to Develop Tensile Strength <sup>1</sup> in. (mm)	Ultimate Bond Strength lb (kN)	Embed. to Develop Yield Strength <sup>1</sup> in. (mm)	Embed. to Develop Tensile Strength <sup>1</sup> in. (mm)		
#3	3-3/8 (86)	10105 (45.0)	2-1/4 (57)	3-3/8 (86)	10810 (48.1)	2-1/8 (54)	3-1/4 (84)	6600 (29.4)	9900 (44.0)
	4-1/2 (114)	10920 (48.6)			10810 (48.1)				
#4	4-1/2 (114)	15980 (71.1)	3-3/8 (86)	5-5/8 (143)	18540 (82.5)	3 (76)	4-3/8 (111)	12000 (53.4)	18000 (80.1)
	6 (152)	18830 (83.8)			18655 (83.0)				
#5	5-5/8 (143)	20630 (91.8)	5-1/8 (130)	8-7/8 (225)	27790 (123.6)	3-7/8 (98)	5-3/4 (146)	18600 (82.7)	27900 (124.1)
	7-1/2 (191)	24870 (110.6)			27790 (128.6)				
#6	6-3/4 (171)	33695 (149.9)	5-3/8 (136)	9-3/8 (238)	44675 (198.7)	4 (102)	6 (152)	26400 (117.4)	39600 (176.2)
	9 (229)	38960 (173.3)			44870 (200.0)				
#7	7-7/8 (200)	40525 (180.3)	7 (178)	12-3/8 (314)	59340 (264.0)	4-7/8 (124)	7-1/4 (184)	36000 (160.1)	54000 (240.2)
	10-1/2 (267)	48460 (215.6)			61720 (274.6)				
#8	9 (229)	63940 (284.4)	8-1/4 (210)	12-7/8 (327)	72820 (323.9)	5-7/8 (149)	8-7/8 (225)	47400 (210.9)	71100 (316.3)
	12 (305)	69610 (309.7)			72950 (324.5)				
#9	10-1/8 (257)	72245 (321.4)	8-1/2 (216)	13 (330)	81235 (361.4)	7-1/2 (191)	12 (305)	60000 (266.9)	90000 (400.4)
	13-1/2 (343)	94205 (419.1)			84015 (373.7)				
#10	11-1/4 (286)	92000 (409.3)	9-3/8 (238)	17-7/8 (454)	96725 (430.3)	8-7/8 (225)	14 (356)	76200 (339.0)	114300 (508.5)
	15 (381)	95850 (426.4)			97070 (431.8)				
#11	12-3/8 (314)	118615 (527.6)	9-7/8 (251)	18-3/4 (476)	123120 (547.7)	9-1/2 (241)	16-1/2 (419)	93600 (416.4)	140400 (624.6)
	16-1/2 (419)	123570 (549.7)			123790 (550.7)				

<sup>1</sup> Based on comparison of average ultimate adhesive bond test values versus minimum yield and ultimate tensile strength of rebar. For more information, contact Hilti.

## HIT-RE 500 Epoxy Adhesive Anchoring System 4.2.7

HIT-RE 500 Bond Strength and Steel Strength for Metric Rebar in Concrete (Canada Only) 1, 2, 3, 4, 5, 6, 7

Rebar Size	HIT-RE 500 Tensile Bond Strength					Strength Properties of Metric Rebar	
	Embedment Depth mm (in)	$f'_c = 14 \text{ MPa}$		$f'_c = 28 \text{ MPa}$		$f_y = 400 \text{ MPa}$	$f_u = 600 \text{ MPa}$
		Ultimate Bond kN (lb)	Allowable Bond kN (lb)	Ultimate Bond kN (lb)	Allowable Bond kN (lb)	Yield Strength kN (lb)	Tensile Strength kN (lb)
10M	115 (4-1/2)	71.1 (15980)	17.8 (3995)	82.5 (18540)	20.6 (4635)	40 (8990)	60 (13490)
	150 (6)	83.8 (18830)	20.9 (4705)	83.0 (18655)	20.7 (4665)		
15M	145 (5-5/8)	91.8 (20630)	22.9 (5155)	123.7 (27810)	30.9 (6950)	80 (17985)	120 (26975)
	190 (7-1/2)	110.6 (24870)	27.6 (6215)	123.6 (27790)	30.9 (6945)		
20M	200 (7-7/8)	180.3 (40525)	45.1 (10130)	264 (59340)	66 (14835)	120 (26975)	180 (40465)
	265 (10-1/2)	215.6 (48460)	53.9 (12115)	274.6 (61720)	68.6 (15430)		
25M	230 (9)	284.4 (63940)	71.0 (15985)	323.9 (72820)	81.0 (18205)	200 (44960)	300 (67440)
	305 (12)	309.7 (69610)	77.4 (17400)	324.5 (72950)	81.1 (18235)		
30M	260 (10-1/8)	321.4 (72245)	80.3 (18060)	361.4 (81235)	90.3 (20305)	280 (62945)	420 (94415)
	345 (13-1/2)	419.1 (94205)	104.8 (23550)	373.7 (84015)	93.4 (21000)		
35M	315 (12-3/8)	527.6 (118615)	131.9 (29650)	547.7 (123120)	136.9 (30780)	400 (89920)	600 (134880)
	420 (16-1/2)	549.7 (123570)	137.4 (30890)	550.7 (123790)	137.6 (30945)		

- 1 Based on minimum steel strength and nominal cross-sectional area of rebar.
- 2 Use lesser value of bond strength or steel strength.
- 3 Minimum concrete thickness must be equal to 1.5 times the anchor embedment.
- 4 Testing done with imperial rebar in same size holes.

- 5 Allowable tension for adhesive bond based on a safety factor of 4.0.
- 6 For anchor spacing and edge distance guidelines, please refer to the following pages.
- 7 Ultimate tensile concrete/bond loads represent the average values obtained in testing.


### HIT-RE 500 Ultimate Tensile Strength for Smooth Epoxy Coated Dowel Bars in Concrete $\geq 2410 \text{ psi}$ (15.9 MPa)

Anchor Diameter in. (mm)	Drill Bit Diameter in. (mm)	Embedment Depth in. (mm)	Ultimate Tensile Load lb (kN)
1 (25.4)	1-1/8 (29)	9 (229)	40385 (179.7)
1-1/4 (31.8)	1-3/8 (34.9)		
1-1/2 (38.1)	1-5/8 (41)		



## 4.2.7 HIT-RE 500 Epoxy Adhesive Anchoring System

### Anchor Spacing and Edge Distance Guidelines in Concrete

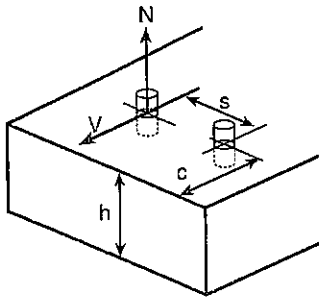

#### Anchor Spacing Adjustment Factors

$s$  = Actual spacing  
 $h_{ef}$  = Actual embedment  
 $s_{min} = 0.5 h_{ef}$   
 $s_{cr} = 1.5 h_{ef}$

#### Edge Distance Adjustment Factors

$c$  = Actual edge distance  
 $h_{ef}$  = Actual embedment  
 $c_{min} = 0.5 h_{ef}$  Tension and shear  
 $c_{cr} = 1.5 h_{ef}$  Tension  
 $= 2.0 h_{ef}$  Shear  
 $\perp$  = Perpendicular to edge  
 $\parallel$  = Parallel to edge

**Note:** Tables apply for listed embedment depths. Reduction factors for other embedment depths must be calculated using equations below.

#### Spacing Tension/Shear

$s_{min} = 0.5 h_{ef}$ ,  $s_{cr} = 1.5 h_{ef}$   
 $f_A = 0.3(s/h_{ef}) + 0.55$   
 for  $s_{cr} > s > s_{min}$

#### Edge Distance Tension



$c_{min} = 0.5 h_{ef}$ ,  $c_{cr} = 1.5 h_{ef}$   
 $f_{RN} = 0.3(c/h_{ef}) + 0.55$   
 for  $c_{cr} > c > c_{min}$

#### Edge Distance Shear ( $\perp$ toward edge)

$c_{min} = 0.5 h_{ef}$ ,  $c_{cr} = 2.0 h_{ef}$   
 $f_{RV1} = 0.54(c/h_{ef}) - 0.09$   
 for  $c_{cr} > c > c_{min}$

#### Edge Distance Shear ( $\parallel$ to or away from edge)

$c_{min} = 0.5 h_{ef}$ ,  $c_{cr} = 2.0 h_{ef}$   
 $f_{RV2} = 0.36(c/h_{ef}) + 0.28$   
 for  $c_{cr} > c > c_{min}$

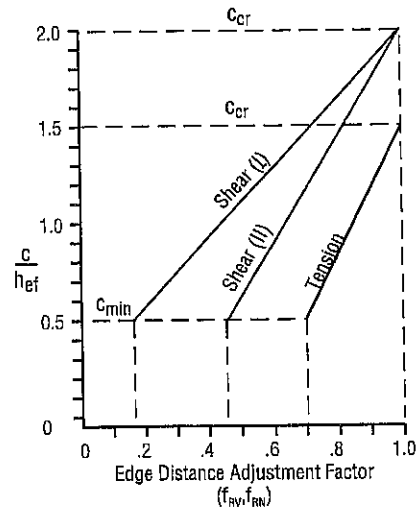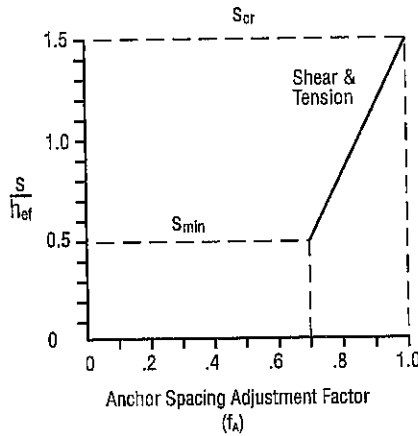

#### Load Adjustment Factors for 3/8" Diameter Anchor

Anchor Diameter: 3/8" diameter													
Adjustment Factor	Spacing Tension/Shear, $f_A$			Edge Distance Tension, $f_{RN}$			Edge Distance Shear, $f_{RV1}$ ( $\perp$ toward edge)			Edge Distance Shear, $f_{RV2}$ ( $\parallel$ to or away from edge)			
	Embed. Depth (in.)	1-3/4	3-3/8	4-1/2	1-3/4	3-3/8	4-1/2	1-3/4	3-3/8	4-1/2	1-3/4	3-3/8	4-1/2
Spacing (s)/Edge Distance (c), in.	7/8	0.70			0.70			0.18			0.46		
	1	0.72			0.72			0.22			0.49		
	1 11/16	0.84	0.70		0.84	0.70		0.43	0.18		0.63	0.46	
	2	0.89	0.73		0.89	0.73		0.53	0.23		0.69	0.49	
	2 1/4	0.94	0.75	0.70	0.94	0.75	0.70	0.60	0.27	0.18	0.74	0.52	0.46
	2 5/8	1.00	0.78	0.73	1.00	0.78	0.73	0.72	0.33	0.23	0.82	0.56	0.49
	3		0.82	0.75		0.82	0.75	0.84	0.39	0.27	0.90	0.60	0.52
	3 1/2		0.86	0.78		0.86	0.78	1.00	0.47	0.33	1.00	0.65	0.56
	4		0.91	0.82		0.91	0.82		0.55	0.39		0.71	0.60
	5 1/16		1.00	0.89		1.00	0.89		0.72	0.52		0.82	0.69
	5 1/2			0.92			0.92		0.79	0.57		0.87	0.72
	6			0.95			0.95		0.87	0.63		0.92	0.76
	6 3/4			1.00			1.00		1.00	0.72		1.00	0.82
8											0.87		0.92
9											1.00		1.00

# HIT-RE 500 Epoxy Adhesive Anchoring System 4.2.7

## Anchor Spacing and Edge Distance Guidelines in Concrete

Note: Tables apply for listed embedment depths. Reduction factors for other embedment depths must be calculated using equations below.

Load Adjustment Factors for 1/2" Diameter Anchor													
Anchor Diameter:		1/2" diameter											
Adjustment Factor	Spacing Tension/Shear, $f_A$			Edge Distance Tension, $f_{R1}$			Edge Distance Shear, $f_{RV1}$ (⊥ toward edge)			Edge Distance Shear, $f_{RV2}$ (   to or away from edge)			
	Embed. Depth (in.)	2-1/4	4-1/2	6	2-1/4	4-1/2	6	2-1/4	4-1/2	6	2-1/4	4-1/2	6
Spacing (s)/Edge Distance (c), in.	1												
	1-1/8	0.70			0.70			0.18			0.46		
	1-1/2	0.75			0.75			0.27			0.52		
	1-3/4	0.78			0.78			0.33			0.56		
	2	0.82			0.82			0.39			0.60		
	2-1/4	0.85	0.70		0.85	0.70		0.45	0.18		0.64	0.46	
	2-1/2	0.88	0.72		0.88	0.72		0.51	0.21		0.68	0.48	
	3	0.95	0.75	0.70	0.95	0.75	0.70	0.63	0.27	0.18	0.76	0.52	0.46
	3-3/8	1.00	0.78	0.72	1.00	0.78	0.72	0.72	0.32	0.21	0.82	0.55	0.48
	4		0.82	0.75		0.82	0.75	0.87	0.39	0.27	0.92	0.60	0.52
	4-1/2		0.85	0.78		0.85	0.78	1.00	0.45	0.32	1.00	0.64	0.55
	5		0.88	0.80		0.88	0.80		0.51	0.36		0.68	0.58
6		0.95	0.85		0.95	0.85		0.63	0.45		0.76	0.64	
6-3/4		1.00	0.89		1.00	0.89		0.72	0.52		0.82	0.69	
7			0.90			0.90		0.75	0.54		0.84	0.70	
8			0.95			0.95		0.87	0.63		0.92	0.76	
9			1.00			1.00		1.00	0.72		1.00	0.82	
10									0.81			0.88	
11									0.90			0.94	
12									1.00			1.00	

**Spacing Tension/Shear**  
 $s_{min} = 0.5 h_{ef}$   $s_{cr} = 1.5 h_{ef}$   
 $f_A = 0.3(s/h_{ef}) + 0.55$   
 for  $s_{cr} > s > s_{min}$

**Edge Distance Tension**  
 $c_{min} = 0.5 h_{ef}$   $c_{cr} = 1.5 h_{ef}$   
 $f_{RN} = 0.3(c/h_{ef}) + 0.55$   
 for  $c_{cr} > c > c_{min}$

**Edge Distance Shear (⊥ toward edge)**  
 $c_{min} = 0.5 h_{ef}$   $c_{cr} = 2.0 h_{ef}$   
 $f_{RV1} = 0.54(c/h_{ef}) - 0.09$   
 for  $c_{cr} > c > c_{min}$

**Edge Distance Shear (|| to or away from edge)**  
 $c_{min} = 0.5 h_{ef}$   $c_{cr} = 2.0 h_{ef}$   
 $f_{RV2} = 0.36(c/h_{ef}) + 0.28$   
 for  $c_{cr} > c > c_{min}$

Load Adjustment Factors for 5/8" and 3/4" Diameter Anchors																										
Anchor Diameter		5/8" diameter										3/4" diameter														
Adjustment Factor	Spacing Tension/Shear, $f_A$			Edge Distance Tension, $f_{R1}$			Edge Distance Shear, $f_{RV1}$ (⊥ toward edge)				Spacing Tension/Shear, $f_A$			Edge Distance Tension, $f_{R1}$			Edge Distance Shear, $f_{RV1}$ (⊥ toward edge)			Edge Distance Shear, $f_{RV2}$ (   to or away from edge)						
	Embed. Depth (in.)	2-7/8	5-5/8	7-1/2	2-7/8	5-5/8	7-1/2	2-7/8	5-5/8	7-1/2	2-7/8	5-5/8	7-1/2	3-3/8	6-3/4	9	3-3/8	6-3/4	9	3-3/8	6-3/4	9	3-3/8	6-3/4	9	
Spacing (s)/Edge Distance (c), in.	1-7/16	0.70			0.70			0.18			0.46															
	1-11/16	0.73			0.73			0.23			0.49			0.70			0.70			0.18					0.46	
	2	0.76			0.76			0.29			0.53			0.73			0.73			0.23					0.49	
	2-13/16	0.84	0.70		0.84	0.70		0.44	0.18		0.63	0.46		0.80			0.80			0.36					0.58	
	3-3/8	0.90	0.73		0.90	0.73		0.54	0.23		0.70	0.50		0.85	0.70		0.85	0.70		0.45	0.18		0.64	0.46		
	3-3/4	0.94	0.75	0.70	0.94	0.75	0.70	0.61	0.27	0.18	0.75	0.52	0.46	0.88	0.72		0.88	0.72		0.51	0.21		0.68	0.48		
	4-5/16	1.00	0.78	0.72	1.00	0.78	0.72	0.72	0.32	0.22	0.82	0.56	0.49	0.93	0.74		0.93	0.74		0.60	0.26		0.74	0.51		
	4-1/2		0.79	0.73		0.79	0.73		0.76	0.34	0.23	0.84	0.57	0.50	0.95	0.75	0.70	0.95	0.75	0.70	0.63	0.27	0.18	0.76	0.52	0.46
	5-1/16		0.82	0.75		0.82	0.75		0.86	0.40	0.27	0.91	0.60	0.52	1.00	0.78	0.72	1.00	0.78	0.72	0.72	0.32	0.21	0.82	0.55	0.48
	5-5/8		0.85	0.78		0.85	0.78		0.97	0.45	0.32	0.98	0.64	0.55	0.80	0.74		0.80	0.74		0.81	0.36	0.25	0.88	0.58	0.51
	5-3/4		0.86	0.78		0.86	0.78		1.00	0.46	0.32	1.00	0.65	0.56	0.81	0.74		0.81	0.74		0.83	0.37	0.26	0.89	0.59	0.51
	6-3/4		0.91	0.82		0.91	0.82		0.56	0.40		0.71	0.60	0.85	0.78		0.85	0.78		1.00	0.45	0.32	1.00	0.64	0.55	
	8-7/16		1.00	0.89		1.00	0.89		0.72	0.52		0.82	0.69	0.93	0.83		0.93	0.83		0.59	0.42		0.73	0.62		
	10-1/8			0.96			0.96		0.88	0.64		0.93	0.77	1.00	0.89		1.00	0.89		0.72	0.52		0.82	0.69		
	11-1/4			1.00			1.00		1.00	0.72		1.00	0.82		0.93			0.93		0.81	0.59		0.88	0.73		
	12									0.77			0.86		0.95			0.95		0.87	0.63		0.92	0.76		
	13-1/2									0.88			0.93		1.00			1.00		1.00	0.72		1.00	0.82		
	15									1.00			1.00					1.00		1.00	0.81			0.88		
16												0.86		0.95			0.95		0.87	0.63		0.92	0.76			
18												1.00					1.00		1.00	0.81			0.88			

## 4.2.7 HIT-RE 500 Epoxy Adhesive Anchoring System

### Anchor Spacing and Edge Distance Guidelines in Concrete

Note: Tables apply for listed embedment depths. Reduction factors for other embedment depths must be calculated using equations below.

Load Adjustment Factors for 7/8" Diameter Anchor													
Anchor Diameter:		7/8" diameter											
Embed. Depth (in.)	Adjustment Factor	Spacing Tension/Shear, $f_A$			Edge Distance Tension, $f_{EW}$			Edge Distance Shear, $f_{RV1}$ ( $\perp$ toward edge)			Edge Distance Shear, $f_{RV2}$ ( $\parallel$ to or away from edge)		
		4	7-7/8	10-1/2	4	7-7/8	10-1/2	4	7-7/8	10-1/2	4	7-7/8	10-1/2
2		0.70			0.70			0.18			0.46		
2-1/2		0.74			0.74			0.25			0.51		
3		0.78			0.78			0.32			0.55		
3-1/2		0.81			0.81			0.38			0.60		
3-15/16		0.85	0.70		0.85	0.70		0.44	0.18		0.63	0.46	
4-1/2		0.89	0.72		0.89	0.72		0.52	0.22		0.69	0.49	
5		0.93	0.74		0.93	0.74		0.59	0.25		0.73	0.51	
5-1/4		0.94	0.75	0.70	0.94	0.75	0.70	0.62	0.27	0.18	0.75	0.52	0.46
6		1.00	0.78	0.72	1.00	0.78	0.72	0.72	0.32	0.22	0.82	0.55	0.49
6-1/2			0.80	0.74		0.80	0.74	0.79	0.36	0.24	0.87	0.58	0.50
7			0.82	0.75		0.82	0.75	0.86	0.39	0.27	0.91	0.60	0.52
8			0.85	0.78		0.85	0.78	1.00	0.46	0.32	1.00	0.65	0.55
10			0.93	0.84		0.93	0.84		0.60	0.42		0.74	0.62
11-13/16			1.00	0.89		1.00	0.89		0.72	0.52		0.82	0.69
12				0.89			0.89		0.73	0.53		0.83	0.69
14				0.95			0.95		0.87	0.63		0.92	0.76
15-3/4				1.00			1.00		1.00	0.72		1.00	0.82
18										0.84			0.90
20										0.94			0.97
21										1.00			1.00

**Spacing Tension/Shear**

$$s_{min} = 0.5 h_{ef}, s_{cr} = 1.5 h_{ef}$$

$$f_A = 0.3 (s/h_{ef}) + 0.55$$

for  $s_{cr} > s > s_{min}$

---

**Edge Distance Tension**

$$c_{min} = 0.5 h_{ef}, c_{cr} = 1.5 h_{ef}$$

$$f_{RN} = 0.3 (c/h_{ef}) + 0.55$$

for  $c_{cr} > c > c_{min}$

---

**Edge Distance Shear ( $\perp$  toward edge)**

$$c_{min} = 0.5 h_{ef}, c_{cr} = 2.0 h_{ef}$$

$$f_{RV1} = 0.54 (c/h_{ef}) - 0.09$$

for  $c_{cr} > c > c_{min}$

---

**Edge Distance Shear ( $\parallel$  to or away from edge)**

$$c_{min} = 0.5 h_{ef}, c_{cr} = 2.0 h_{ef}$$

$$f_{RV2} = 0.36 (c/h_{ef}) + 0.28$$

for  $c_{cr} > c > c_{min}$

Load Adjustment Factors for 1" and 1-1/4" Diameter Anchors																				
Anchor Diameter		1" diameter										1-1/4" diameter								
Embed. Depth (in.)	Adjustment Factor	Spacing Tension/Shear, $f_A$			Edge Distance Tension, $f_{EW}$			Edge Distance Shear, $f_{RV1}$ ( $\perp$ toward edge)				Edge Distance Shear, $f_{RV2}$ ( $\parallel$ to or away from edge)								
		4-1/2	9	12	4-1/2	9	12	4-1/2	9	12	4-1/2	9	12	5-5/8	11-1/4	15	5-5/8	11-1/4	15	
2-1/4		0.70			0.70			0.18			0.46									0.46
2-3/4		0.73			0.73			0.24			0.50			0.70			0.70			0.47
3		0.75			0.75			0.27			0.52			0.71			0.71			0.54
4		0.82			0.82			0.39			0.60			0.76			0.76			0.57
4-1/2		0.85	0.70		0.85	0.70		0.45	0.18		0.64	0.46		0.79			0.79			0.60
5		0.88	0.72		0.88	0.72		0.51	0.21		0.68	0.48		0.82			0.82			0.64
5-5/8		0.93	0.74		0.93	0.74		0.59	0.25		0.73	0.51		0.85	0.70		0.85	0.70	0.45	0.18
6		0.95	0.75	0.70	0.95	0.75	0.70	0.63	0.27	0.18	0.76	0.52	0.46	0.87	0.71		0.87	0.71	0.49	0.20
6-3/4		1.00	0.78	0.72	1.00	0.78	0.72	0.72	0.32	0.21	0.82	0.55	0.48	0.91	0.73		0.91	0.73	0.56	0.23
7-1/2			0.80	0.74		0.80	0.74	0.81	0.36	0.25	0.88	0.58	0.51	0.95	0.75	0.70	0.95	0.75	0.70	0.63
8-1/4			0.83	0.76		0.83	0.76	0.90	0.41	0.28	0.94	0.61	0.53	0.99	0.77	0.72	0.99	0.77	0.72	0.70
9			0.85	0.78		0.85	0.78	1.00	0.45	0.32	1.00	0.64	0.55		0.79	0.73		0.79	0.73	0.77
10			0.88	0.80		0.88	0.80		0.51	0.36		0.68	0.58	0.82	0.75		0.82	0.75	0.87	0.39
11			0.92	0.83		0.92	0.83		0.57	0.41		0.72	0.61	0.84	0.77		0.84	0.77	1.00	0.44
12			0.95	0.85		0.95	0.85		0.63	0.45		0.76	0.64	0.87	0.79		0.87	0.79		0.49
13-1/2			1.00	0.89		1.00	0.89		0.72	0.52		0.82	0.69	0.91	0.82		0.91	0.82		0.56
14				0.90			0.90		0.75	0.54		0.84	0.70	0.92	0.83		0.92	0.83		0.58
16-7/8				0.97			0.97		0.92	0.67		0.96	0.79	1.00	0.89		1.00	0.89		0.72
18				1.00			1.00		1.00	0.72		1.00	0.82		0.91			0.91		0.77
20										0.81			0.88		0.95			0.95		0.87
22-1/2										0.92			0.96		1.00			1.00		1.00
24										1.00			1.00							0.77
27																				0.88
30																				1.00

# HIT-RE 500 Epoxy Adhesive Anchoring System 4.2.7

## Resistance of HIT-RE 500 to Chemicals

Chemical	Chemicals Tested	Resistant	Not Resistant
Alkalinize (Base material concrete)	Concrete drilling mud (10%) pH=12.6	+	
	Concrete drilling mud (10%) pH=13.2	+	
	Concrete potash solution (10%) pH=14.0	+	
Acids	Acetic acid (10%)	concrete was dissolved by acid	-
	Nitric acid (10%)		-
	Hydrochloric acid (10%) 3 month -		-
	Sulfuric acid (10%)		-
Solvents	Benzyl alcohol		-
	Ethanol		-
	Ethyl acetate		-
	Methyl ethyl ketone (MEK)		-
	Trichlorethylene		-
	Xylene (mixture)	+	
Chemicals used on job sites	Concrete plasticizer	+	
	Diesel oil	+	
	Oil	+	
	Petrol	+	
	Oil for form work (forming oil)	+	
Environmental Chemicals	Salt water	+	
	de-mineralized water	+	
	salt spraying test	+	
	SO <sub>2</sub>	+	
	Environment / Weather	+	

Samples of the HIT-RE 500 resin were immersed in the various chemical compounds for up to one year. At the end of the test period, the samples were analyzed. Any samples showing no visible damage and having less than a 25% reduction in bending (flexural) strength were classified as "Resistant." Samples that were heavily damaged or destroyed were classified as "Not Resistant."

**Note:** In actual use, the majority of the resin is encased in the base material, leaving very little surface area exposed.


### Full Cure Time Table1 (100% of working load)

Base Material Temperature		Approx. Full Curing Time
°F	°C	
23	-5	72 hours
32	0	50 hours
50	10	24 hours
68	20	12 hours
86	30	8 hours
104	40	4 hours

### Initial Cure Time Table1 (25% of working load)

Base Material Temperature		Approx. Initial Cure Time
°F	°C	
23	-5	36 hours
32	0	25 hours
50	10	12 hours
68	20	6 hours
86	30	4 hours
104	40	2 hours

### Influence of Temperature on Bond Strength

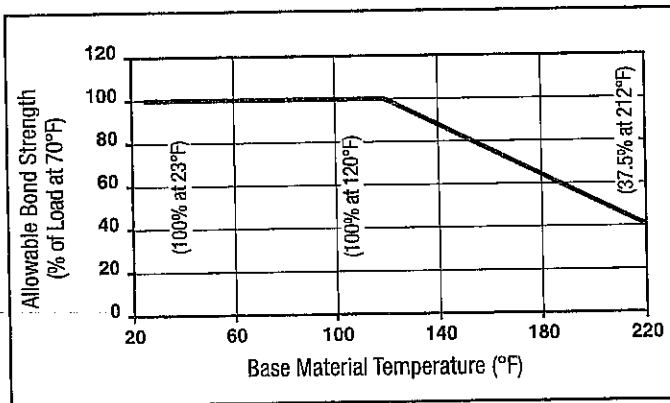

**Note:** Test procedure involves the concrete being held at the elevated temperature for 24 hours then removing it from the controlled environment and testing to failure.

Long term creep test in accordance with AC58 is available; please contact Hilti Technical Services.


### Gel Time Table1 (Approximate)

Base Material Temperature		Approx. Gel Time
°F	°C	
23	-5	4 hours
32	0	3 hours
50	10	2 hours
68	20	30 minutes
86	30	20 minutes
104	40	12 minutes

1 Minimum product temperature must be maintained above 41°F (5°C) prior/during installation.

## 4.2.7 HIT-RE 500 Epoxy Adhesive Anchoring System

### 4.2.7.4 Installation Instructions

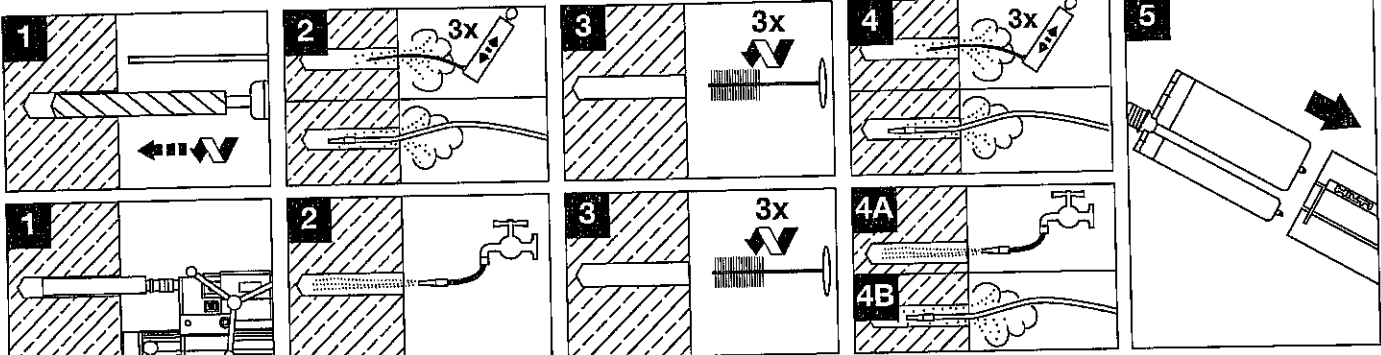


1. Drill anchor hole using carbide or diamond core bits.

2. Insert air nozzle to bottom of hole and blow out hole using a pump, or compressed air. For underwater applications and diamond coring, flush until water runs clear from hole.

3. Clean hole with a nylon or wire brush. Proper hole cleaning is essential.

4. Insert air nozzle to bottom of hole and blow out hole using a pump, or compressed air. For underwater applications and diamond coring, flush until water runs clear from hole. Remove water (e.g. vacuum or comp. air).

5. Insert refill pack into holder. Remove cap covering threaded projection.

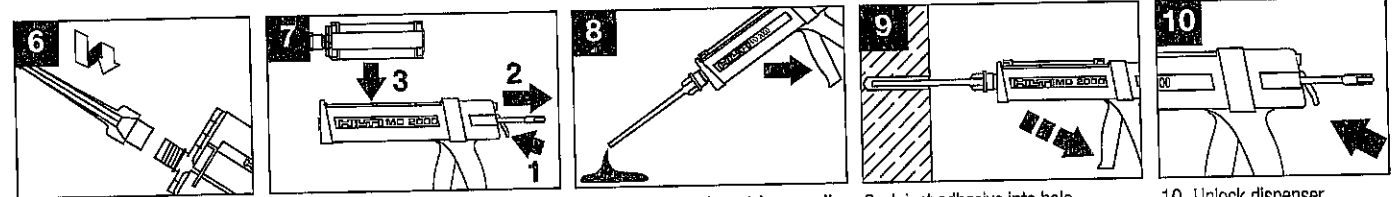




6. Screw on static mixer.

7. Put holder into dispenser.

8. Discard first three trigger pulls of adhesive from each refill pack or cartridge.

9. Inject adhesive into hole starting at the bottom until 1/2 to 2/3 full. Use mixer filler tube extensions when needed to reach the hole bottom.

10. Unlock dispenser

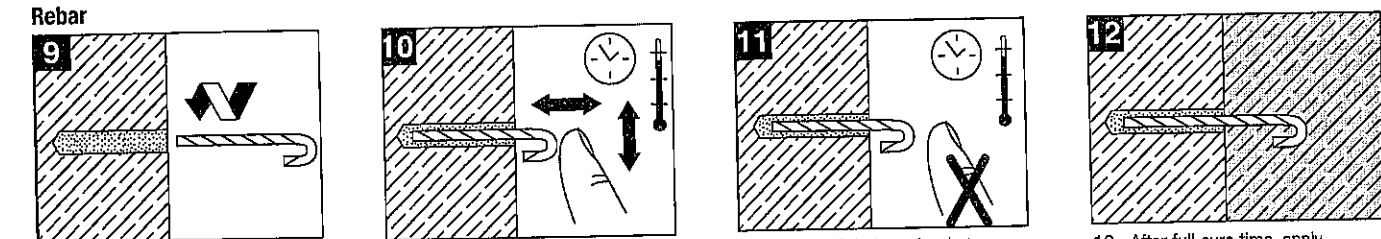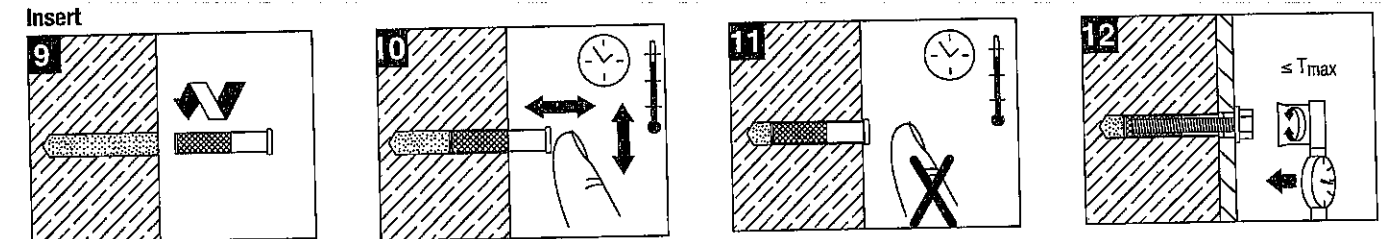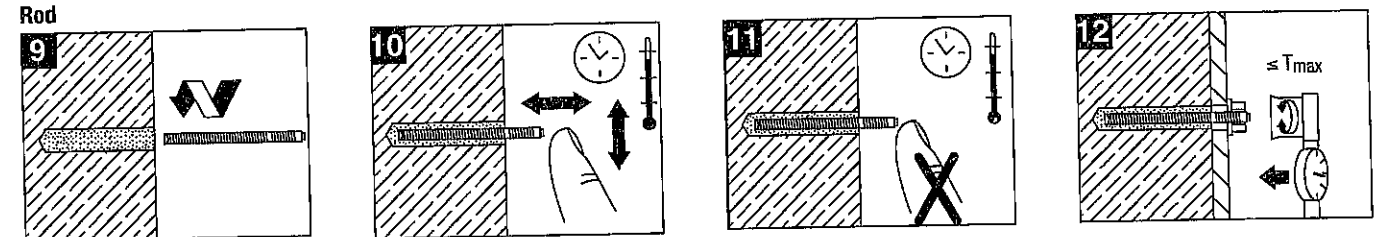

9. Insert rod, threaded insert or rebar. Twist during installation.

10. Fastener may be adjusted during specified gel time.

11. Do not disturb anchor between specified gel time and initial cure time. At the initial cure time the fastener has 25% of full working load. Work may proceed (e.g. tying rebar, setting steel) which will not exceed 25% of the full working load. Do not torque anchor.

12. After full cure time, apply specified torque as required to secure items to be fastened. Do not exceed maximum torque specified.

# HIT-RE 500 Epoxy Adhesive Anchoring System 4.2.7

## HIT HIT-RE 500 Volume Charts

### Threaded Rod Installation

Rod Diameter (in.)	Drill Bit <sup>1</sup> Diameter (in.)	Adhesive Volume Required per Inch of embedment (in <sup>3</sup> )
1/4	5/16	0.055
3/8	7/16	0.095
1/2	9/16	0.133
5/8	3/4	0.261
3/4	7/8	0.326
7/8	1	0.391
1	1-1/8	0.478
1-1/4	1-3/8	0.626

#### EXAMPLE:

Determine approximate fastenings for 5/8" rod embedded 10" deep.

$10 \times 0.261 = 2.61$  in<sup>3</sup> of adhesive per anchor  
 $16.5 \div 2.61 = 6$  fastenings per small cartridge  
 $81.8 \div 2.61 = 31$  fastenings per jumbo cartridge

### Rebar Installation

Rod Diameter (in.)	Drill Bit <sup>1</sup> Diameter (in.)	Adhesive Volume Required per Inch of embedment (in <sup>3</sup> )
#3 or 3/8	1/2	0.110
#4 or 1/2	5/8	0.146
#5 or 5/8	3/4	0.176
#6 or 3/4	7/8	0.218
#7 or 7/8	1	0.252
#8 or 1	1-1/8	0.299
#9 or 1-1/8	1-3/8	0.601
#10 or 1-1/4	1-1/2	0.659
#11 or 1-3/8	1-3/4	1.037


**NOTE:** Useable volume of HIT-RE 500 refill cartridge is 16.5 in<sup>3</sup> (270 ml).  
 Useable volume of HIT-RE 500 medium refill cartridge is 26.9 in<sup>3</sup> (440 ml).  
 Useable volume of HIT-RE 500 jumbo refill cartridge is 81.8 in<sup>3</sup> (1340 ml).

### Metric Rebar Installation (Canada Only)

Bar Diameter	Drill Bit <sup>1</sup> Diameter (in.)	Adhesive Volume Required per Inch of embedment (in <sup>3</sup> )
10M	5/8	0.186
15M	3/4	0.170
20M	1	0.388
25M	1-1/8	0.289
30M	1-3/8	0.481
35M	1-3/4	0.996

1 Rebar diameter may vary. Use smallest drill bit which will accommodate rebar.

## 4.2.7.5 Ordering Information

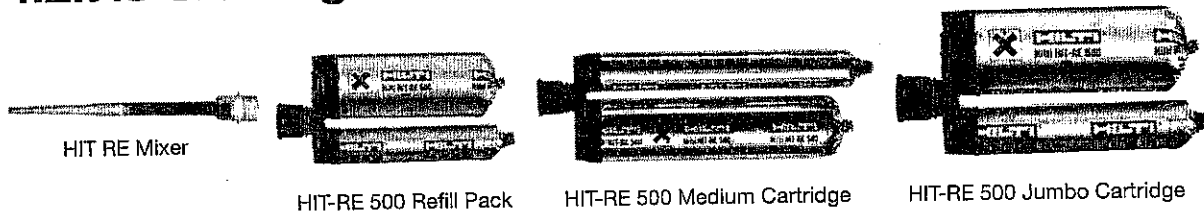

### HIT Adhesives

Item No.	Description
340225	HIT-RE 500 11.1 oz (330 ml) Includes (1) Refill Pack and (1) Mixer with filler tube
369251	HIT-RE 500 MC 11.1 oz (330 ml) Includes (25) Refill Packs and (25) Mixers with filler tube
369110	HIT-RE 500 Medium 16.9 oz (500 ml) Includes (20) Refill Packs and (20) Mixers with filler tube
373958	HIT-RE 500 Jumbo 47.3 oz (1400 ml) Includes (4) Jumbo Refill Packs and (4) Mixers

## 4.2.7 HIT-RE 500 Epoxy Adhesive Anchoring System

### Dispensers

#### Battery Powered

Item No.	Ordering designation	
3245363	ED3500 2.0 Ah kit	①

#### Manual


Item No.	Ordering designation	
371291	MD 1000 Manual Dispenser for HIT-ICE	②
229154	MD 2000 dispenser — includes foil pack holder	③
338853	MD 2500 Manual Dispenser	④
229170	Refill Holder Replacement for MD2000, ED 3500 or P-3000HY dispensers	⑤

#### Pneumatic Dispenser with 1/4" internally threaded compressed air coupling

Item No.	Ordering designation	
354180	P-3500 dispenser (for foil packs)	⑥
373959	HIT-P8000D pneumatic dispenser (for jumbo cartridges)	⑦
373960	Jumbo pack holder replacement for P8000D	

### Mixers and Filler Tubes

Item No.	Ordering designation	Qty/pkg
337111	HIT-RE-M static mixer (suitable for foil pack and jumbo cartridges)	1

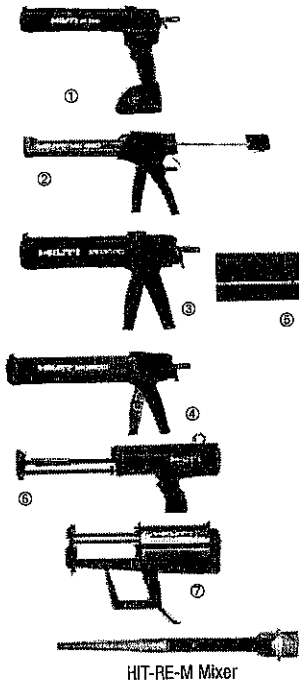

# HIT-RE 500 Epoxy Adhesive Anchoring System 4.2.7



## Threaded Rods

HAS Rods 5.8				HAS Super A193, B7 High Strength Rods			HAS-R Rods 304 Stainless Steel			HAS-R Rods 316 Stainless Steel		
Item No. (Box)	Master Carton (MC)	Description (in.)	Qty Box/MC	Item No.	Description	Qty Box	Item No.	Description	Qty Box	Item No.	Description	Qty Box
385417	3432178	3/8 x 3	10/360									
385418	3432179	3/8 x 4-3/8	10/240									
385419	3432180	3/8 x 5-1/8	20/240	68657	3/8x5-1/8	10	385462	3/8x5-1/8	10	3024335	3/8x5-1/8	1
385420	3432181	3/8-8	10/160				385463	3/8 x 8	10			
385421	3432182	3/8 x 12	10/90									
385422	3432183	1/2 x 3-1/8	10/240									
385423	3432184	1/2 x 4-1/2	10/160									
385424	3432185	1/2 x 6-1/2	20/160	68658	1/2x6-1/2	10	385464	1/2x6-1/2	10	3024336	1/2x6-1/2	1
385425	3432239	1/2 x 8	10/120				385465	1/2x8	1			
385426	3432186	1/2 x 10	10/120				385466	1/2x10	1			
										3024337	1/2x11	1
385427	3432187	1/2 x 12	10/80									
385428	3432188	5/8 x 8	20/80	333783	5/8x7-5/8	10	385467	5/8x7-5/8	10	333781	5/8x7-5/8	10
							385468	5/8x10	1			
385429	3432189	5/8 x 9	10/60							3024338	5/8x9	1
385430	3432190	5/8 x 12	10/60							3024339	5/8x12	1
385431	3432191	5/8 x 17	10/40									
385432	3432052	3/4 x 10	10/40	68660	3/4x9-5/8	5	385469	3/4x9-5/8	5	3024340	3/4x9-5/8	1
385433	3432163	3/4 x 11	10/30									
385434	3432164	3/4 x 12	10/30				385470	3/4x12	1			
385435	3432165	3/4 x 14	10/30	3006083	3/4 x 14	5	385471	3/4x14	1			
							385472	3/4x16	1			
385436	3432166	3/4 x 17	10/20									
385437	3432167	3/4 x 19	10/20									
385438	3432168	3/4 x 21	10/20									
385439	3432169	3/4 x 25	10/20									
385440	3432170	7/8 x 10	10/20	68661	7/8x10 (HDG) <sup>1</sup>	5	385473	7/8x10	1			
				3006077	7/8x12 (HDG) <sup>1</sup>	5						
385441	3432171	7/8 x 13	10/20	45259	7/8x16 (HDG) <sup>1</sup>	5						
385442	3432172	1 x 12	4/16	68662	1x12	5	385474	1x12	1	3024341	1x12	4/16
385443	3432173	1 x 14	2/16	3006079	1x14	5						
385444	3432174	1 x 16	2/12	3006080	1x16	5						
385445	3432175	1 x 20	2/12	3006081	1x21	5						
385446	3432176	1-1/4 x 16	4/8	333779	1-1/4x16	4						
385447	3432177	1-1/4 x 22	4/8									
				3006082	1-1/4x23	5						

<sup>1</sup> Hot dipped galvanized (7/8" rod only). Coating thickness 2 mils (50.8 µm).



## HIS Internally Threaded Inserts

HIS Item No.	HIS-R Item No.	Description	Useable Thread Length (in.)	Qty Box
258020	258029	3/8x4-1/4	1	10
258021	258030	1/2x5	1-3/16	5
258022	258031	5/8x6-5/8	1-1/2	5
258023	258032	3/4x8-1/4	2	5




## In The United States

<b>PAYMENT TERMS:</b>	Net 30 days from date of invoice. Customer agrees to pay all costs incurred by Hilti in collecting any delinquent amounts, including attorney's fees.
<b>FREIGHT:</b>	All sales are F.O.B. Destination with transportation allowed via Hilti designated mode. Delivery dates are estimates only. Additional charges for expedited shipments, special handling requirements, and orders below certain dollar amounts shall be the responsibility of Customer. Fuel surcharges may apply depending on market conditions.
<b>CREDIT:</b>	All orders sold on credit are subject to Credit Department approval.
<b>RETURN POLICY:</b>	Products must be in saleable condition to qualify for return. Saleable condition is defined as unused items in original undamaged packaging and unbroken quantities and in as-new condition. All returns are subject to Hilti inspection and acceptance, and a \$125 restocking charge if returned more than 90 days after invoice date. Proof of purchase is required for all returned materials. Special orders products and discontinued items are not eligible for return credit. Dated materials are only returnable in case quantity, and within 30 days after invoice date.
<b>WARRANTY:</b>	Hilti warrants that for a period of 12 months from the date it sells a product it will, at its sole option and discretion, refund the purchase price, repair, or replace such product if it contains a defect in material or workmanship. Absence of Hilti's receipt of notification of any such defect within this 12-month period shall constitute a waiver of all claims with regard to such product.  THE FOREGOING WARRANTY IS IN LIEU OF ALL OTHER WARRANTIES, EXPRESS OR IMPLIED, INCLUDING BUT NOT LIMITED TO THE IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE. Hilti shall in no event be liable for, and Customer hereby agrees to indemnify Hilti against all claims related to special, direct, indirect, incidental, consequential, or any other damages arising out of or related to the sale, use, or inability to use the product.
<b>ACCEPTANCE OF ORDER:</b>	Acceptance is limited to the express terms contained herein, and terms are subject to change by Hilti without notice. Additional or different terms proposed by Customer are deemed material and are objected to and rejected, but such rejection shall not operate as a rejection of the offer unless it contains variances in the terms of the description, quantity, price or delivery schedule of the goods. Orders are not deemed "accepted" by Hilti unless and until it ships the associated items.
<b>DOMESTIC ORIGIN:</b>	Any non-domestic Hilti product will be so identified on shipping documents and invoices for customers who properly identify themselves as a federal government entity. All other customers may obtain such information by written request to Hilti, Inc., Contract Compliance, P.O. Box 21148, Tulsa, Oklahoma 74121. Hilti's Quality Department personnel are the only individuals authorized to warrant the country of origin of Hilti products.
<b>BUSINESS SIZE:</b>	Hilti is a large business.
<b>PRICES:</b>	Prices are those stated on the order, and unless otherwise noted are based on purchasing all items on the order — pricing for individual products may vary for purchases of different quantities or item combinations. Hilti does not maintain most favored customer records, makes no representation with respect to same, and rejects any price warranty terms proposed by Customer. Hilti's published net price list is subject to change without notice.
<b>CONSENT TO JURISDICTION:</b>	All transactions made pursuant hereto shall be deemed to have been made and entered into in Tulsa, Oklahoma. Any and all disputes arising directly or indirectly from such transactions shall be resolved in the courts of the County of Tulsa, State of Oklahoma, to the exclusion of any other court, and any resulting judgment may be enforced by any court having jurisdiction of such an action. All transactions shall be governed by and construed in accordance with the laws of the State of Oklahoma.
<b>INDEMNIFICATION:</b>	Customer hereby agrees to indemnify Hilti for any costs, including attorney's fees, incurred by Hilti as a result, in whole or in part, of any violation by Customer of any Federal, State or Local statute or regulation, or of any nationally accepted standard. It shall be Customer's sole responsibility to comply with all applicable laws and regulations regarding the handling, use, transportation, or disposal of products upon taking possession of same.
<b>AUTHORIZATION:</b>	HILTI LEGAL DEPARTMENT PERSONNEL ARE THE ONLY INDIVIDUALS AUTHORIZED TO MODIFY THESE TERMS AND CONDITIONS, WARRANT PRODUCT SUITABILITY FOR SPECIFIC APPLICATIONS, OR EXECUTE CUSTOMER DOCUMENTS, AND ANY SUCH ACTION IS NULL AND VOID UNLESS IN WRITTEN FORM SIGNED BY SUCH INDIVIDUAL.

## In Canada


<b>PAYMENT TERMS:</b>	Net 30 days from date of invoice. Customer agrees to pay all costs incurred by Hilti in collecting delinquent amounts, if any, including reasonable attorney's fees.
<b>FREIGHT:</b>	Sales are F.O.B. Destination Point with transportation allowed via Hilti designated mode. Additional charges may apply for expedited delivery, special handling requirements, and order under certain limits. A fuel surcharge may apply depending on market conditions.
<b>CREDIT:</b>	All orders sold on credit are subject to Credit Department approval.
<b>RETURN POLICY:</b>	Product may be returned prepaid (unless otherwise authorized) to Hilti provided:  i) it is returned by the original purchaser ii) it is not dated product returned more than 30 days after the original delivery date iii) it is not discontinued, clearance or special order product iv) it is unused, in original packaging and in unbroken quantities.  Hilti will inspect product and, if the above requirements are satisfied, will credit to customer the original purchase price. A 15% restocking fee may apply.
<b>WARRANTY:</b>	Other than the manufacturer's published warranty, no warranties or conditions, express or implied, written or oral, statutory or otherwise are implied. Any and all conditions and warranties implied by law or by the Sale of Goods Act or any similar statutes of any Province are hereby expressly waived.
<b>TITLE TO PRODUCT:</b>	Title to product remains with Hilti until the total purchase price of product is paid.
<b>PRICES:</b>	Customer agrees to pay Hilti prices set out on invoice. Customer agrees to pay taxes as indicated on invoice unless Hilti receives acceptable exemption certificates.
<b>INDEMNIFICATION:</b>	Customer agrees to use product at own risk and to indemnify Hilti against all liabilities, including legal fees, to third parties arising out of the use or possession thereof. Hilti shall in no event be liable for special, incidental or consequential damages.
<b>CHANGES:</b>	Hilti sales personnel are not authorized to modify these Terms and Conditions or modify Customer's credit terms. Terms are subject to change by Hilti with reasonable notice to Customer.
<b>CASH SALES:</b>	Payment in full is due prior to goods being released.
<b>QUOTATIONS:</b>	All terms and conditions apply once customer agrees to purchase product. Quotations on special promotion products are only valid until end of promotion period.



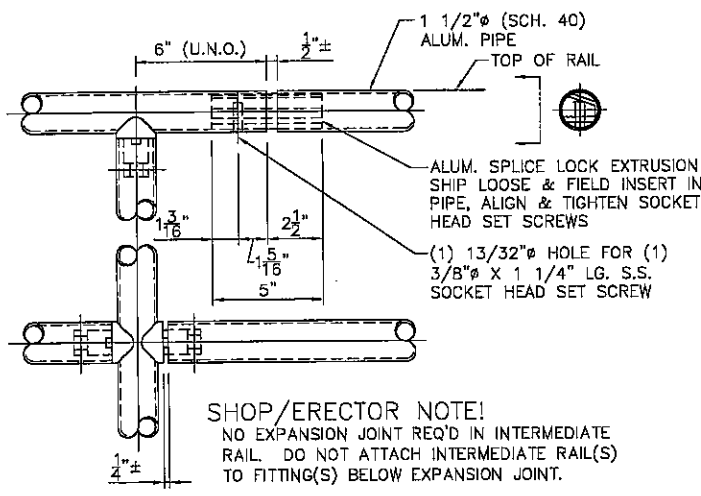


TYPICAL EXPANSION JOINT

BOKD-9 (TYPICAL AT BUILDING EXPANSION JOINT & AT 24'-0" MAX. O/C)

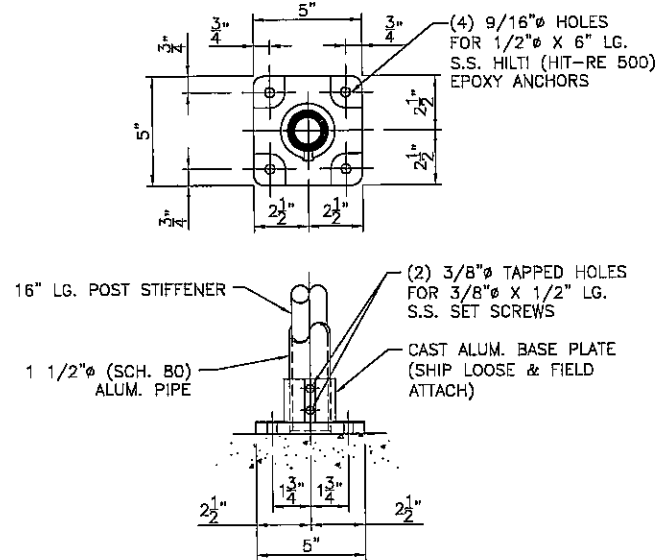


LEVEL CONC. LINE POST

BOKD-16E

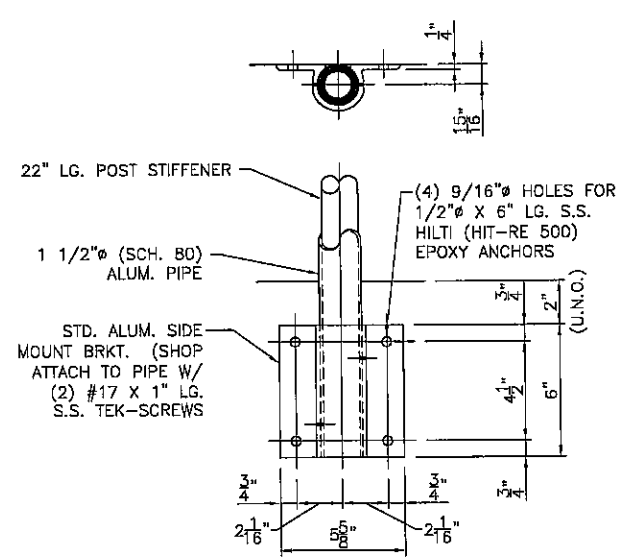


CONC. SIDE MOUNT 4-HOLE

BOKD-18A

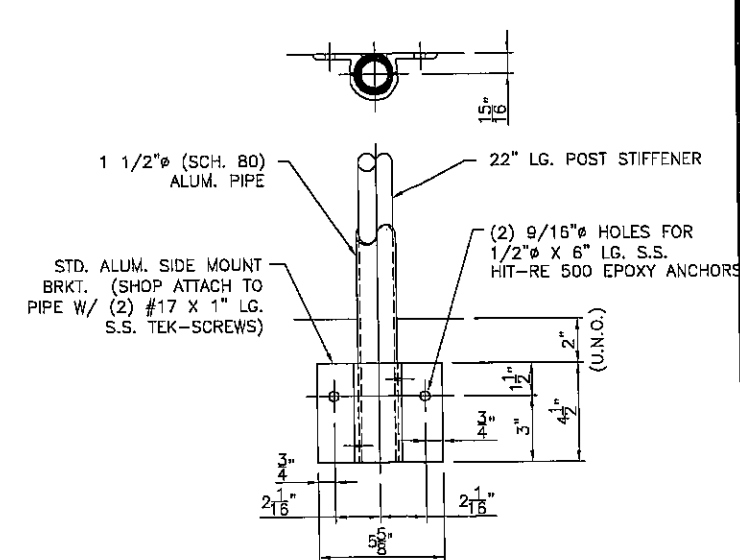


CONC. SIDE MOUNT 2-HOLE

BOKD-18E

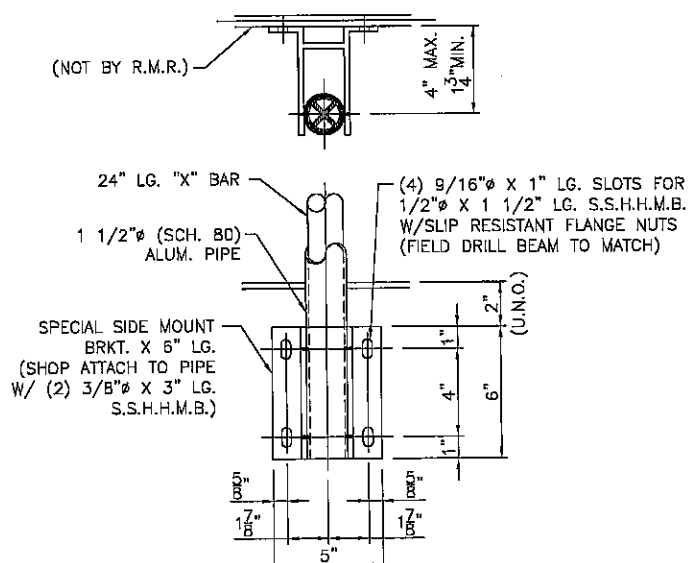


SPECIAL SIDE MOUNT 4-HOLE

BOKD-19D

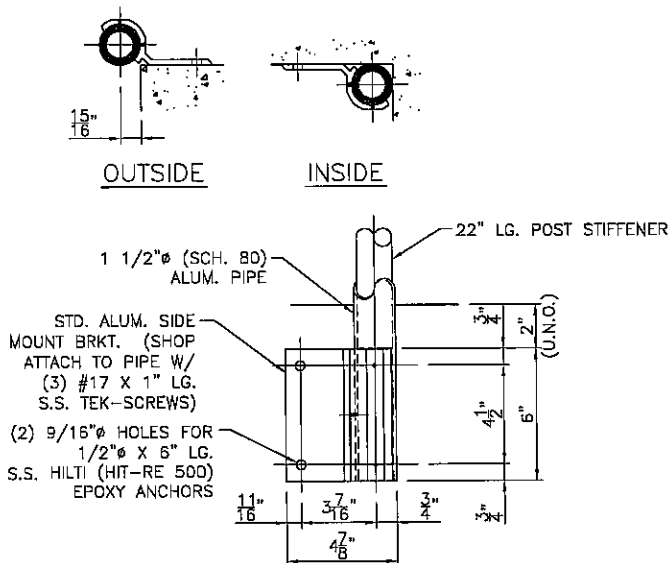


CONC. CORNER SIDE MOUNT

BOKD-22A

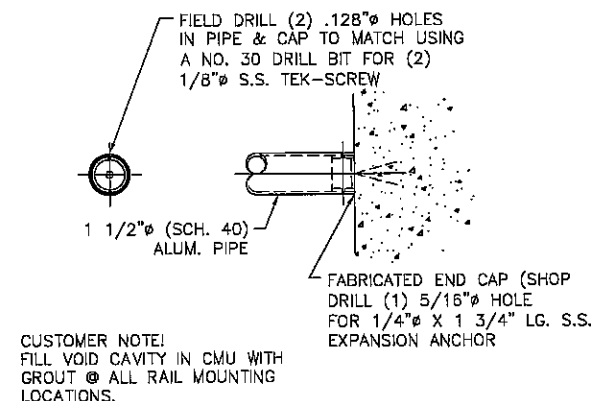


WALL MOUNT END CAP

BOKD-33

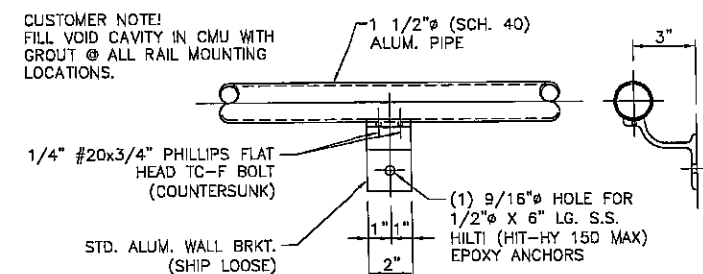


WALL BRACKET

BOKD-35

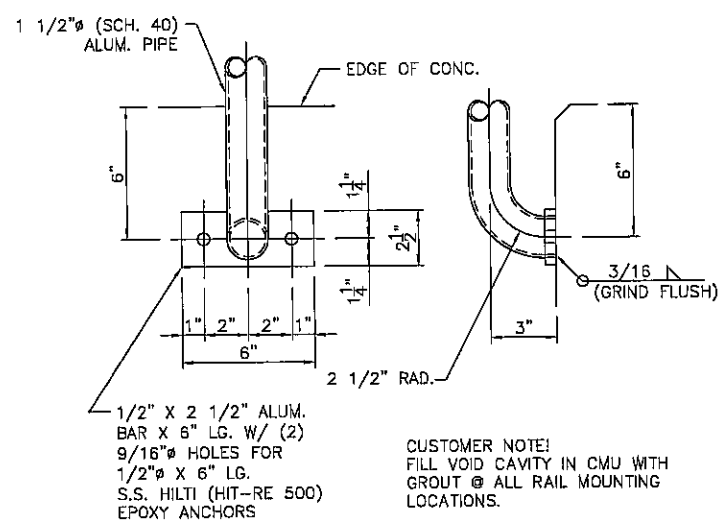


WALL RAIL LINE POST

BOKD-35A

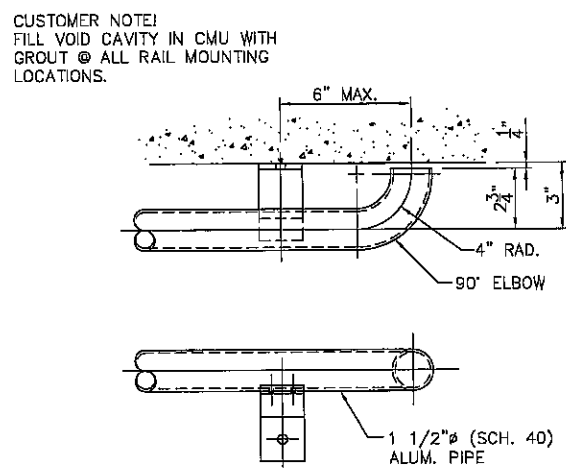

WALL RAIL END RETURN

BOKD-36

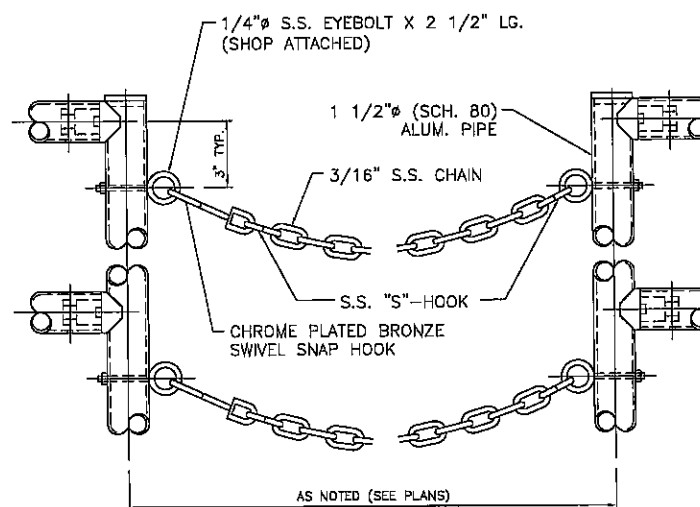

CHAIN OPENING

CH-3A


THESE DRAWINGS ARE THE PROPERTY OF TUTTLE ALUMINUM & BRONZE, INC., ROBERTS, INDIANA AND SHALL NOT BE REPRODUCED OR COPIED OR USED AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS SHOWN WITHOUT PERMISSION.  
THIS DRAWING IS TABCO'S INTERPRETATION OF THE ENGINEER'S/ARCHITECT'S DESIGN INTENT. ANY EDGE NONCOMPLIANCE IS THE RESPONSIBILITY OF THE ENGINEER'S/ARCHITECT'S.

<p><b>ROCKY MOUNTAIN RAILINGS</b> 11839 E 81st AVE DENVER, CO 80239 PHONE (303) 432-0003 FAX (303) 432-2038 HAROLD D. THOMPSON W.R.F.</p>		DESIGNER	GSM INC.
		CUSTOMER	WEAVER CONSTRUCTION
DETAILS B000 KNOCK DOWN		CONTRACTOR	
FINISH M10C22A41			
DR. DDB	DATE 7/26/11	SCALE AS NOTED	NO. OF REVISIONS
ERECTED BY OTHERS		APPROVAL	DATE
FIELD CHECKED BY OTHERS			
CUSTOMER P.O./JOB 2908-05470			
JOB NO.		R1940	
DRAWING NO.		D-2	



THESE DRAWINGS ARE THE PROPERTY OF TUTTLE ALUMINUM & BRONZE, INC. FOUNTAIN, COLORADO AND SHALL NOT BE REPRODUCED OR COPIED OR USED AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS SHOWN WITHOUT PERMISSION.  
 THIS DRAWING IS THE ENGINEER'S/ARCHITECT'S DESIGN INTENT.  
 ANY CODE NONCOMPLIANCE IS THE RESPONSIBILITY OF THE ENGINEER/ARCHITECT.


TOTAL POST	43
BASE MT.	11
EMBED	N/A
SIDE MT.	32

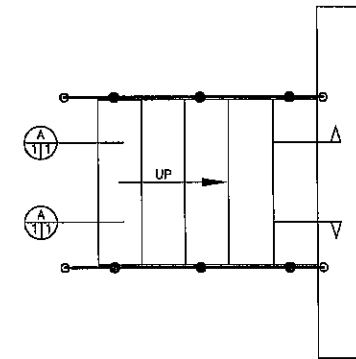

### HEADWORKS BUILDING




SCALE: 3/8" = 1'-0"

SEE SHEET: HW-5

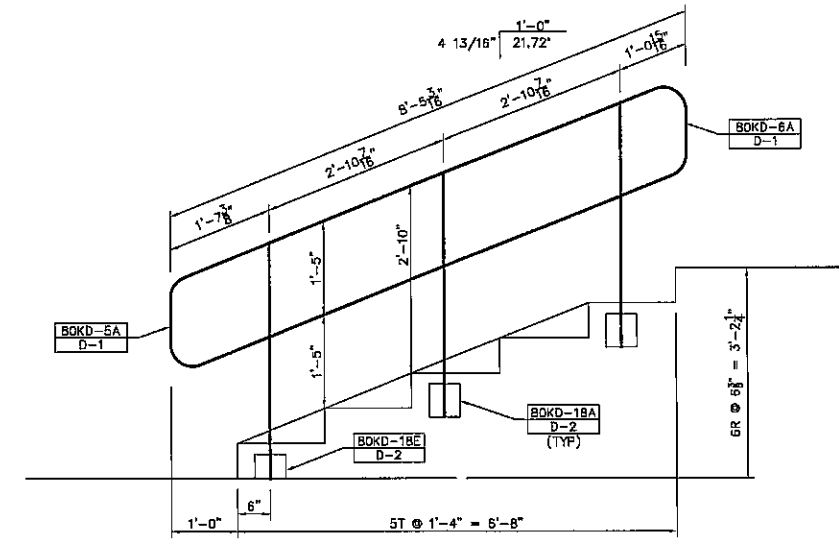

### SECTION A-1

SCALE: 3/4" = 1'-0"  
 TWO WEEDS = ONE AS SHOWN  
 ONE OTHER HAND

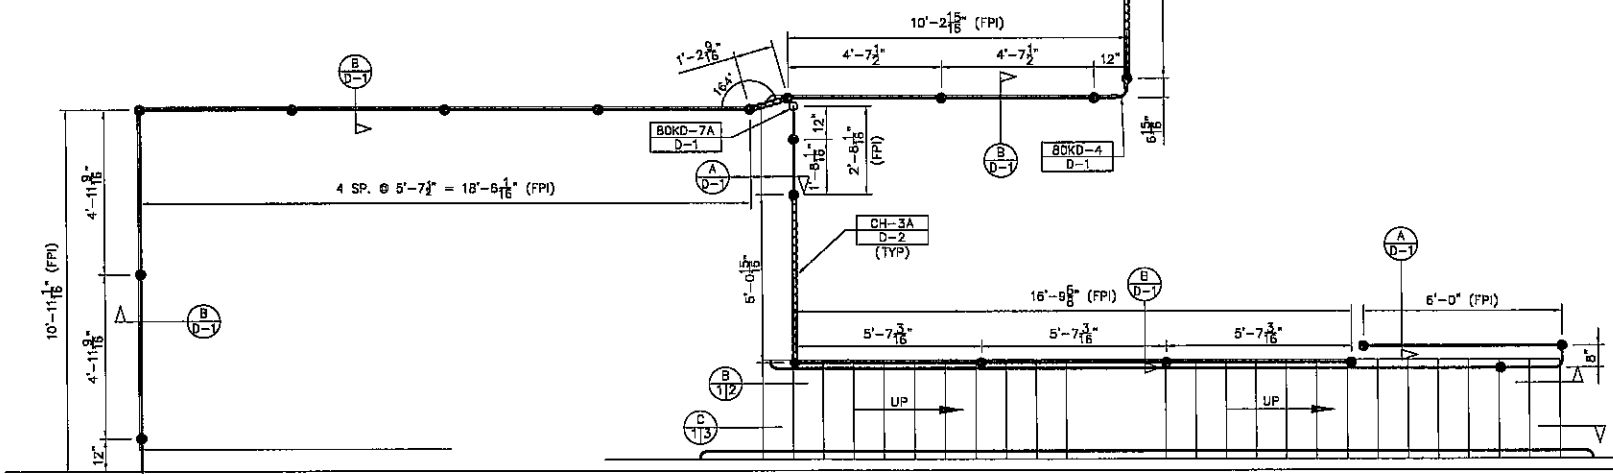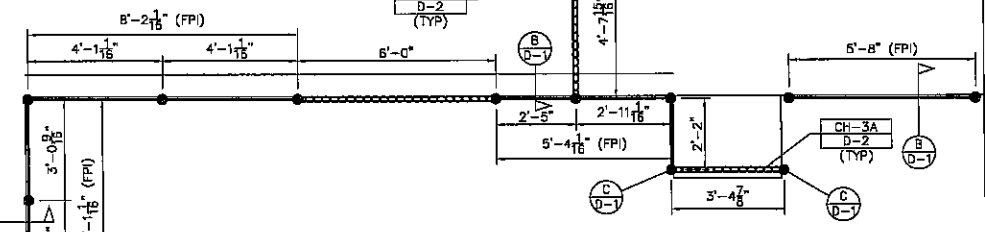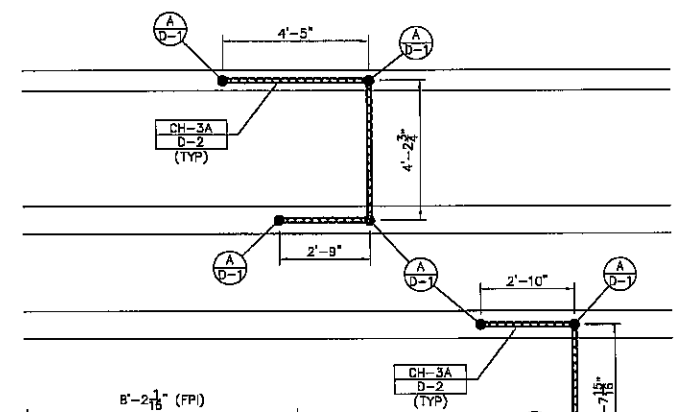

BOKD-33  
 D-2  
 (TYP)

### HEADWORKS BUILDING

SCALE: 3/8" = 1'-0"

SEE SHEET: HW-19


PLEASE VERIFY ALL CONCRETE STAIR DIMENSIONS PRIOR TO FABRICATION.

		<b>ROCKY MOUNTAIN RAILINGS</b> 11839 E 51st AVE DENVER, CO 80239 PHONE (303) 432-0005 FAX (303) 432-2038	
BY	HAROLD D. THOMPSON W.R.F.	DESIGNER	GSM INC.
DATE	7/26/11	CUSTOMER	WEAVER CONSTRUCTION
PROJECT	HEADWORKS BLDG.	CONTRACTOR	
NO.	M10C22A41	SCALE	AS NOTED
DR.	DDB	DATE	7/26/11
ERECTOR	OTHERS	NO.	PRINTS FOR APPROVAL
FIELD CHECKED BY	OTHERS	DATE	07-28-11
CUSTOMER P.O./JOB	2908-05470	JOB NO.	R1940
		DRAWING NO.	1


REFER TO CONTRACT DWG. DWG. NO.



THESE DRAWINGS ARE THE PROPERTY OF TUTTLE ALUMINUM & BRONZE, INC., FISHERS, INDIANA, AND SHALL NOT BE REPRODUCED OR COPIED OR USED AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS SHOWN WITHOUT PERMISSION.  
 THIS DRAWING IS TAILORED INTERPRETATION OF THE ENGINEER'S/ARCHITECT'S DESIGN INTENT. ANY CODE NONCOMPLIANCE IS THE RESPONSIBILITY OF THE ENGINEER/ARCHITECTS.

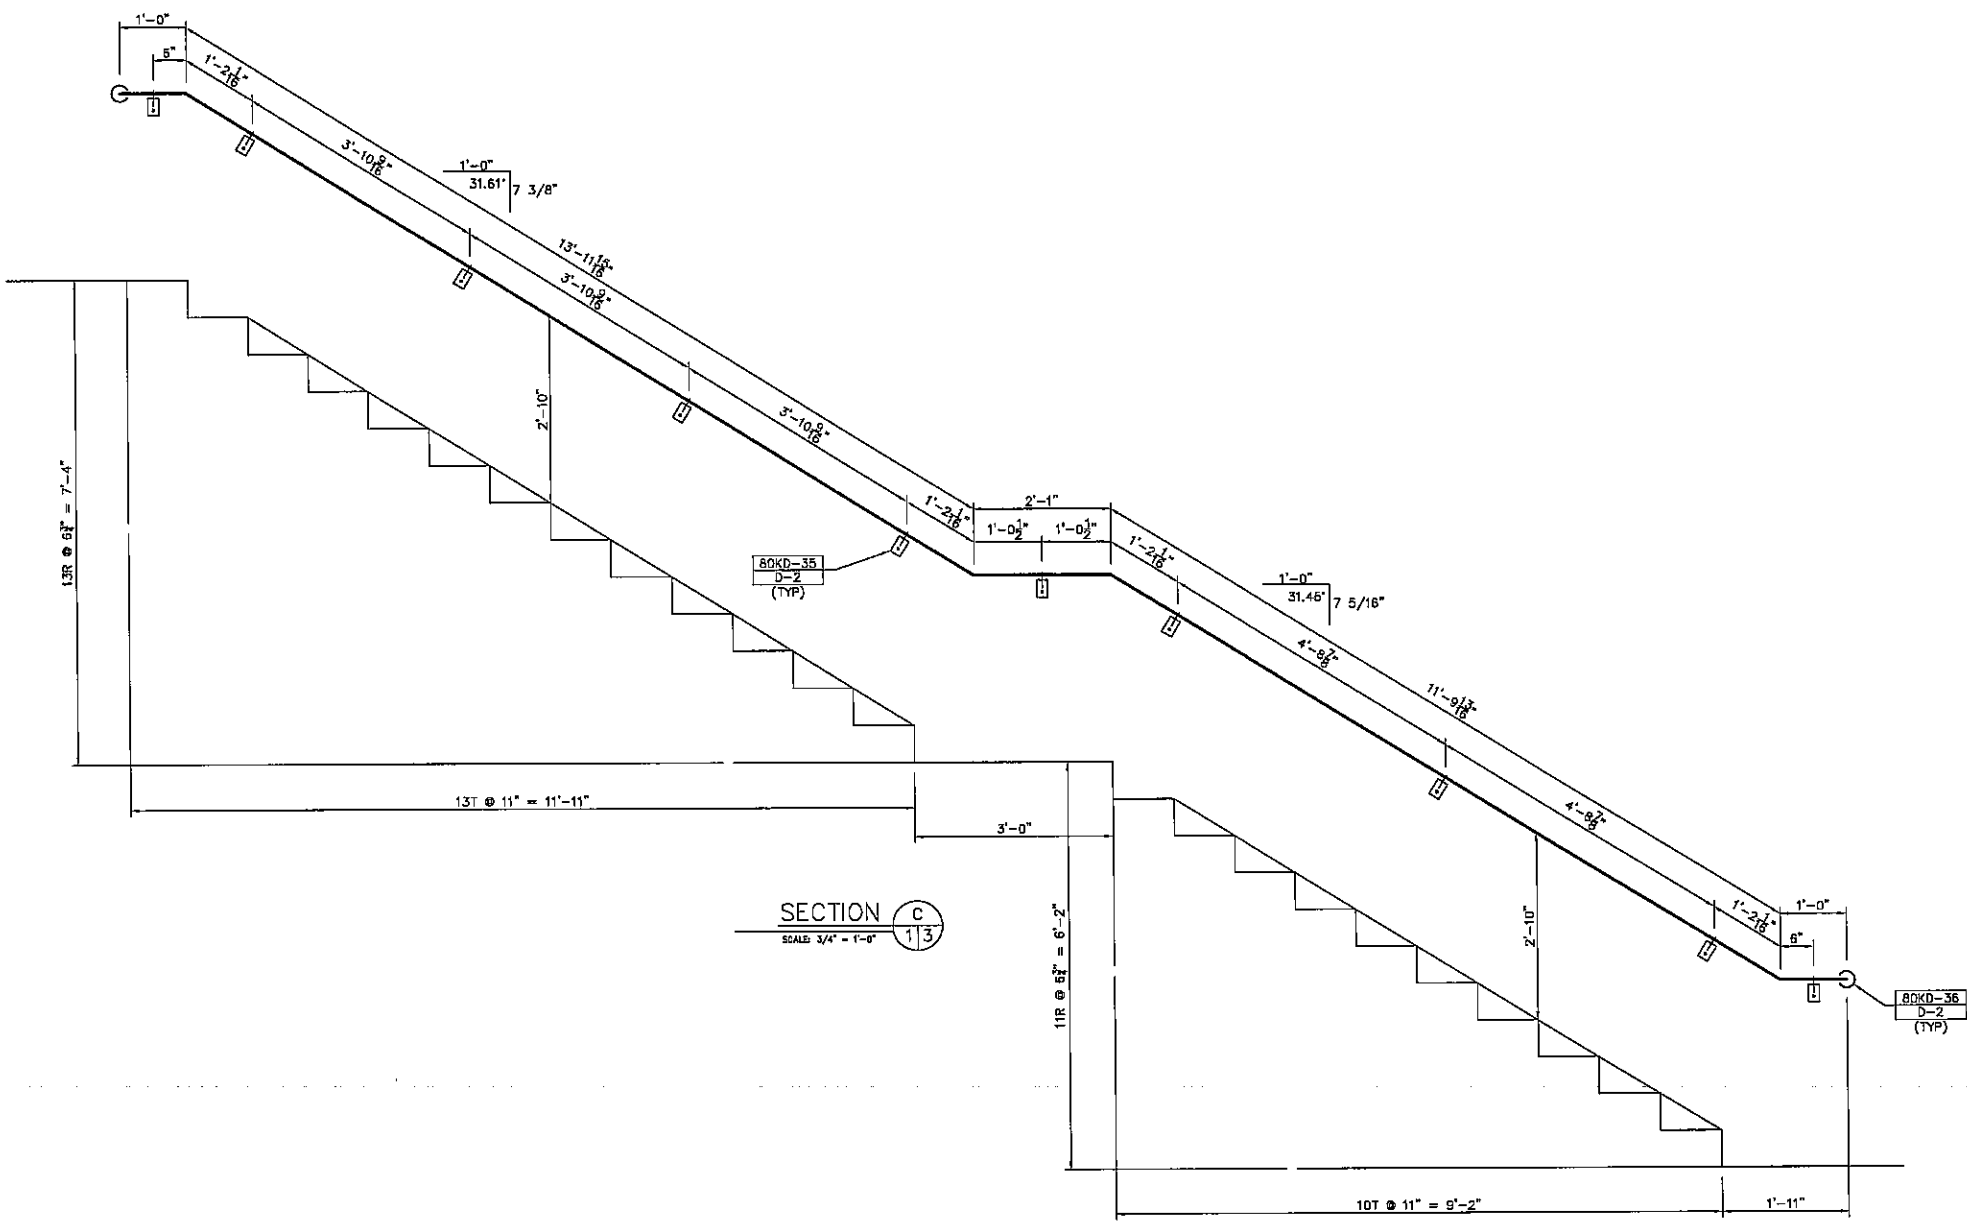



PLEASE VERIFY ALL CONCRETE STAIR DIMENSIONS PRIOR TO FABRICATION.

				<b>ROCKY MOUNTAIN RAILINGS</b>	
		11839 E 51st AVE DENVER, CO 80239		PHONE (303) 432-0003 FAX (303) 432-2038	
BY	HAROLD D. THOMPSON W.R.F.	DESIGNER	GSM INC.		
	FOUNTAIN, CO.	CUSTOMER	WEAVER CONSTRUCTION		
DETAILS STAIR SECTION		CONTRACTOR			
NO.	DATE	SCALE	NO.	DATE	JOB NO.
DR. DDB	7/26/11	AS NOTED	DATE	07-28-11	R1940
ERECTION BY	OTHERS				DRAWING NO.
FIELD CHECKED BY	OTHERS				3
CUSTOMER P.O./JOB	2908-05470				
NO.	L/P				

REFER TO CONTRACT SPEC. PAGE NO.


THESE DRAWINGS ARE THE PROPERTY OF TITEL ALUMINUM & BRONZE, INC. FISHERS INDIANA AND SHALL NOT BE REPRODUCED OR COPIED OR USED AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS SHOWN WITHOUT PERMISSION.  
 THIS DRAWING IS TITEL'S INTERPRETATION OF THE ENGINEER'S/ARCHITECT'S DESIGN INTENT. ANY CONF. NONCOMPLIANCE IS THE RESPONSIBILITY OF THE ENGINEER/ARCHITECT.

TOTAL POST \_\_\_\_\_ 11  
 BASE MT. \_\_\_\_\_ N/A  
 EMBED \_\_\_\_\_ N/A  
 SIDE MT. \_\_\_\_\_ 11

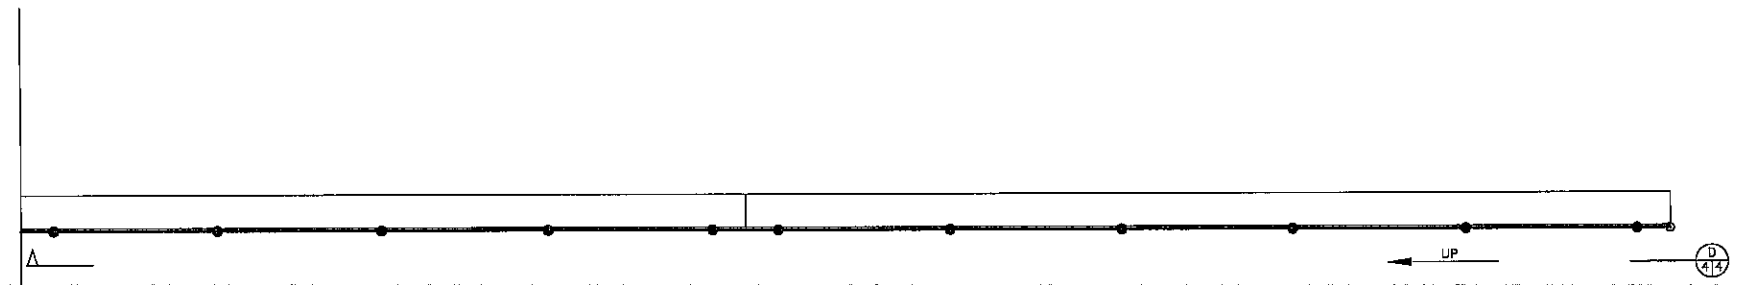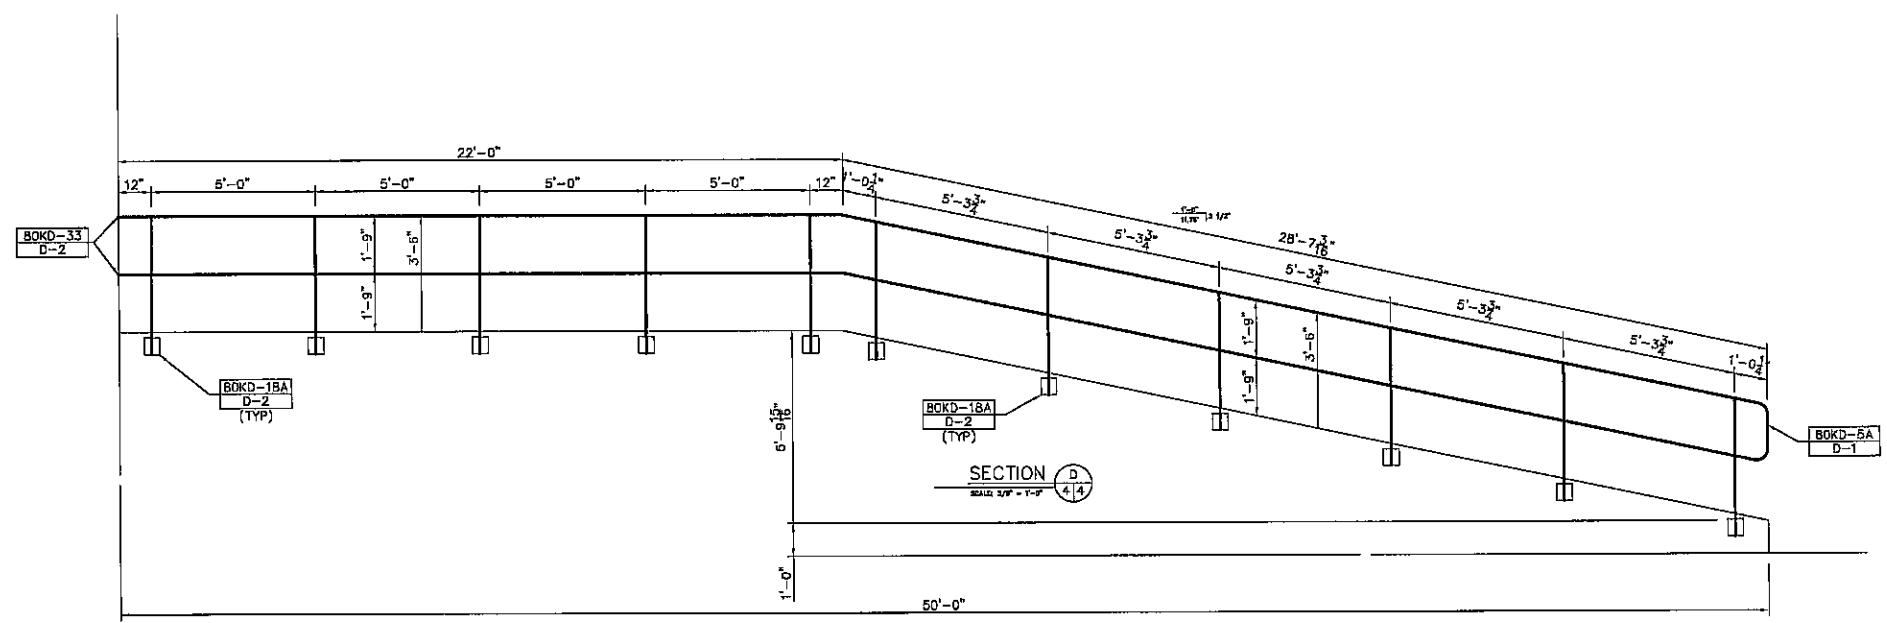

HEADWORKS BUILDING — RETAINING WALL  
 SCALE: 3/8" = 1'-0" SEE SHEET: HW-5

PLEASE VERIFY ALL CONCRETE STAIR DIMENSIONS PRIOR TO FABRICATION.

DATE		 <b>ROCKY MOUNTAIN RAILINGS</b> 11839 E 51st AVE DENVER, CO 80239 PHONE (303) 432-0003 FAX (303) 432-2038	
BY			
DESIGNER		HAROLD D. THOMPSON W.R.F.	
CUSTOMER		GSM INC.	
CONTRACTOR		WEAVER CONSTRUCTION	
DETAILS RETAINING WALL DETAIL			
FINISH: M10C22A41			
DR. DDB	DATE 7/26/11	SCALE AS NOTED	NO. PRINTS FOR APPROVAL
ERECTOR BY OTHERS		DATE 07-28-11	
FIELD CHECKED BY OTHERS		JOB NO. R1940	
CUSTOMER P.O. / JOB 2908-05470		DRAWING NO. 4	

REFER TO CONTRACT DMSL SHEET NO.